

South Taranaki Water Supplies
Monitoring Programme
Annual Report
2013-2014

Technical Report 2014-121

ISSN: 1178-1467 (Online)
Document: 1448134 (Word)
Document: 1538383 (Pdf)

Taranaki Regional Council
Private Bag 713
STRATFORD

September 2015

Executive summary

The South Taranaki District Council (STDC) operates a total of 11 water supply schemes throughout the district. STDC holds 35 resource consents which include 322 conditions setting out the requirements that must be satisfied. STDC holds 15 consents to take water, 11 consents to discharge to both land and water, and nine consents to construct and maintain in-stream structures.

Oaonui Water Supply Limited (OWSL) operates the Oaonui Water Supply scheme. It took over the scheme from STDC in September 2000. OWSL holds two resource consents which include a total of 15 conditions setting out requirements that must be satisfied. OWSL holds one consent to abstract water and one consent to maintain an in-stream structure.

The Nukumarū Water Scheme Society Incorporated (NWSSI) operates a rural water supply scheme. NWSSI holds one consent to take groundwater, this consent has seven conditions.

Cold Creek Water Supply Limited (CCWSL) operates a private water scheme in the Cold Creek catchment. This scheme was, until February 2014, owned and operated by STDC however due to law changes it was returned to the original operator and all consents were transferred to CCWSL. There are three consents with a total of 27 conditions. One to abstract water, one to maintain an in-stream structure, and one to discharge treated backwash.

This report for the period July 2013-June 2014 describes the monitoring programme implemented by the Taranaki Regional Council (the Council) to assess the environmental performance of the three organisations during the period under review, and the results and environmental effects of their activities.

During the monitoring period, STDC demonstrated an overall high level of environmental performance.

During the monitoring period, OWSL demonstrated an overall high level of environmental performance.

During the monitoring period, NWSSI demonstrated an overall high level of environmental performance.

During the monitoring period, CCWSL demonstrated an overall good level of environmental performance.

During the 2013-2014 monitoring period the Council's monitoring programme included an annual inspection of each water supply scheme abstracting from surface water, the collection of eight water samples for physicochemical analysis, three biomonitoring surveys of receiving water, one fish passage survey, eight hydrometric gaugings and the review of abstraction data provided by the consent holders.

Chemical sampling of discharges and receiving waters, macroinvertebrate surveys and fish surveys, all indicated that the water supply schemes did not appear to be causing any significant adverse environmental effects.

A review of abstraction records showed that there were some minor non-compliances at Cold Creek, Patea, and Waimate West plants in regards to daily volumes or abstraction rates. However all of these plants were compliant for over 98% of the monitoring period.

During the monitoring period, STDC demonstrated an overall high level of environmental performance and a good level of administrative performance. There were seven incidents logged in regards to exceedance of abstraction rates by STDC plants, however these all were found to be caused by operational events, such pump starts, air in the flow meters, and data handling errors rather than actual non-compliances and/or sustained abstraction exceedances.

During the monitoring period, OWSL demonstrated an overall high level of environmental performance and high level of administrative performance.

During the monitoring period, NWSSI demonstrated an overall high level of environmental and a good level of administrative performance. No incidents were logged in regards to NWSSI's operation.

During the monitoring period, CCWSL demonstrated an overall good level of environmental performance and a good level of administrative performance. Two incidents were logged in regards to the CCWSL plant, one was to record their intention to take extra water under emergency works provisions, and one was to record equipment failure. An abatement notice was issued in regard to upgrading equipment to the required standard.

For reference, in the 2013-2014 year, 60% of consent holders in Taranaki monitored through tailored compliance monitoring programmes achieved a high level of environmental performance and compliance with their consents, while another 29% demonstrated a good level of environmental performance and compliance with their consent.

This report includes recommendation for the 2015-2016 year.

Table of contents

	Page
1. Introduction	1
1.1 Compliance monitoring programme reports and the Resource Management Act 1991	1
1.1.1 Introduction	1
1.1.2 Structure of this report	1
1.1.3 The Resource Management Act 1991 and monitoring	2
1.1.4 Evaluation of environmental and administrative performance	2
1.2 Process description	4
1.3 Resource consents	10
1.3.1 Cold Creek water supply	10
1.3.2 Eltham water supply	12
1.3.3 Hawera water supply	13
1.3.4 Inaha water supply	17
1.3.5 Opunake water supply	20
1.3.6 Patea water supply	21
1.3.7 Pope water supply	22
1.3.8 Rahotu water supply	22
1.3.9 Wai-inu Beach water supply	23
1.3.10 Waimate West water supply	23
1.3.11 Waverley water supply	27
1.3.12 Waverley Beach water supply	27
1.3.13 Oaonui water supply	28
1.3.14 Nukumarū water supply	29
1.4 Monitoring programme	29
1.4.1 Introduction	29
1.4.2 Programme liaison and management	29
1.4.3 Site inspections	30
1.4.4 Chemical sampling	30
1.4.5 Receiving environment monitoring	30
1.4.6 Hydrological Surveys	30
1.4.7 Review of abstraction data	30
2. Results	31
2.1 Inspections	31
2.1.1 Cold Creek water supply	31
2.1.2 Eltham water supply	31
2.1.3 Inaha water supply	31
2.1.4 Opunake water supply	31
2.1.5 Rahotu water supply	32
2.1.6 Waimate West water supply	32
2.1.7 Hawera water supply	33
2.1.8 Patea water supply	33

2.2	Results of discharge monitoring	34
2.2.1	Hawera WTP (Kapuni)	34
2.2.2	Rahotu WTP	35
2.2.3	Eltham WTP	36
2.3	Results of receiving environment monitoring	36
2.3.1	Hawera WTP macroinvertebrate survey (Kapuni)	36
2.3.2	Waimate West WTP macroinvertebrate survey (Mangawhero-iti)	37
2.3.3	Cold Creek macroinvertebrate survey	38
2.3.4	Hawera WTP fish survey (Kapuni)	39
2.4	Hydrological monitoring	40
2.5	Abstraction data	40
2.5.1	Cold Creek water supply	41
2.5.2	Eltham water supply	42
2.5.3	Hawera water supply	43
2.5.4	Inaha water supply	44
2.5.5	Opunake water supply	46
2.5.6	Patea water supply	46
2.5.7	Rahotu water supply	47
2.5.8	Wai-inu Beach water supply	48
2.5.9	Waimate West water supply	48
2.5.10	Waverley water supply	51
2.5.11	Waverley Beach water supply	54
2.5.12	Oaonui water supply	54
2.5.13	Nukumarū water supply	55
2.6	Investigations, interventions, and incidents	55
3.	Discussion	59
3.1	Discussion of site performance	59
3.1.1	STDC WTP's	59
3.1.2	Cold Creek WTP	59
3.1.3	Oaonui Water Supply	59
3.1.4	Nukumarū Water Supply	59
3.2	Environmental effects of exercise of consents	60
3.3	Evaluation of performance	61
3.3.1	Cold Creek water supply	61
3.3.2	Eltham water supply	63
3.3.3	Hawera water supply	65
3.3.4	Inaha water supply	69
3.3.5	Opunake water supply	73
3.3.6	Patea water supply	74
3.3.7	Pope water supply	75
3.3.8	Rahotu water supply	76
3.3.9	Wai-inu Beach water supply	77
3.3.10	Waimate West water supply	77
3.3.11	Waverley water supply	82
3.3.12	Waverley Beach water supply	83
3.3.13	Oaonui water supply	83
3.3.14	Nukumarū water supply	85

3.4	Recommendations from the 2012-2013 Annual Report	85
3.5	Alterations to monitoring programmes for 2014-2015	86
3.6	Exercise of optional review of consent	86
4.	Recommendations	86
	Glossary of common terms and abbreviations	87
	Bibliography and references	89
	Appendix I Resource consents held by STDC, OWSL NWSSI, and CCWSL	
	Appendix II Biomonitoring reports and fish survey reports	

List of tables

Table 1	South Taranaki water supplies resource consents and processes	5
Table 2	Kapuni WTP sample results 30 May 2014	34
Table 3	Results of sampling at the Rahotu WTP 6 March 2014	35
Table 4	Results of sampling at the Eltham WTP 6 March 2014	36
Table 5	Hydrological gaugings undertaken during the monitoring period	40
Table 6	Compliance with abstraction rates at the Patea bores	46
Table 7	Compliance with consents 0634, 0635 and 3911	49
Table 8	Compliance with abstraction rates at the Waverley bores	52
Table 9	Summary of compliance in regards to abstraction rates, volumes and data	60
Table 10	Summary of performance for Consent 1134-3 to take water from Cold Stream to supply the Cold Creek Water Supply Scheme	61
Table 11	Summary of performance for Consent 5454-1 to erect, place, use and maintain a water intake structure on the bed of Cold Creek for water abstraction purposes	62
Table 12	Summary of performance for Consent 6077-1 to discharge filter backwash water and supernatant from the Cold Creek water treatment plant into the Cold Stream	62
Table 13	Summary of performance for Consent 0213-3 to take and use water from the Waingongoro River for municipal water supply purposes	63
Table 14	Summary of performance for Consent 0989-3 to discharge reservoir from the Eltham Water Supply Reservoir onto land adjacent to the Waingongoro River	63
Table 15	Summary of performance for Consent 1810-3 to discharge overflow and reservoir drainage water from the Eltham water supply reservoir	64
Table 16	Summary of performance for Consent 1811-3 to discharge filter backwash from the Eltham water treatment plant	64
Table 17	Summary of performance for Consent 0146-2 to take and use water from the Kapuni Stream for municipal water supply purposes	65
Table 18	Summary of performance for Consent 0933-3 to discharge up to 227 cubic meters/day of settling pond supernatant from a water treatment plant into the Kapuni Stream	65
Table 19	Summary of performance for Consent 5596-1 to construct, place, use and maintain two existing intake structures in the Kapuni Stream for the Hawera water supply	66
Table 20	Summary of performance for Consent 7002-1 to take and use groundwater for municipal, rural, industrial, and recreational supply purposes	67
Table 21	Summary of performance for Consent 7413-1 to erect, use and maintain a water intake structure on the bed of the Kapuni Stream	67
Table 22	Summary of performance for Consent 7446-1 to discharge membrane backwash water and cleaning wastewater into the Kapuni Stream	68
Table 23	Summary of performance for Consent 7447-1 to install, use and maintain an outfall structure on the bank of the Kapuni Stream	68
Table 24	Summary of performance for Consent 1185-3 to take water from the Mangatoki Stream in the Waingongoro catchment for Inaha rural water supply purposes	69
Table 25	Summary of performance for Consent 1186-3 to take water from the Waingongoro River for Inaha rural water supply purposes	70

Table 26	Summary of performance for Consent 3927-2 to discharge backwash wastes from the Inaha water supply treatment plant into an unnamed tributary of the Mangatoki Stream	71
Table 27	Summary of performance for Consent 3928-2 to discharge uncontaminated overflow water from the Inaha rural water supply treatment plant	71
Table 28	Summary of performance for Consent 4102-2 to construct a low-level weir and fish pass across the Mangatoki Stream to improve water intake efficiencies	71
Table 29	Summary of performance for Consent 5364-1 to take and use water from the Mangatoki Stream for Inaha rural supply scheme purposes	72
Table 30	Summary of performance for Consent 5365-1 to erect, place and maintain a low level intake weir in the Mangatoki Stream for Inaha rural water supply scheme purposes	72
Table 31	Summary of performance for Consent 0232-4 to take and use water from the Waiaua River for Opunake town water supply purposes	73
Table 32	Summary of performance for Consent 5574-2 to discharge water treatment residuals and pond drainage water from the Opunake Water Treatment Plant into the Waiaua River	73
Table 33	Summary of performance for Consent 9473-1 to construct, place and use a water intake structure on the bed of the Waiaua River for water abstraction purposes	74
Table 34	Summary of performance for Consent 3388-3 To take and use groundwater from three bores (known as Bore 1, Bore 2 and Bore 4) for Patea Township water supply purposes	74
Table 35	Summary of performance for Consent 4446-2 to discharge treated backwash water from the Pope Rural Water Supply Treatment Plant	75
Table 36	Summary of performance for Consent 3696-3 to take and use water from the Pungaereere Stream for the Rahotu community water supply scheme	76
Table 37	Summary of performance for Consent 6038-1 to discharge filter backwash water and settling tank waste from the Rahotu water treatment plant into the Pungaereere Stream	76
Table 38	Summary of performance for Consent 3770-3 to take and use groundwater for Wai-inu Beach water supply purposes	77
Table 39	Summary of performance for Consent 0129-3 to discharge treated wash water from the Waimate Water Supply Scheme into an unnamed tributary of Kelly's Creek	77
Table 40	Summary of performance for Consent 0634-3 to take water from the Mangawhero-iti Stream for the Waimate West water supply	78
Table 41	Summary of performance for Consent 0635-3 to take water from the Mangawhero Stream to add to the flow of the Mangawhero-iti Stream for water supply purposes	79
Table 42	Summary of performance for Consent 3911-2 to take water from the Otakeho Stream for the Pope and Waimate West water supply schemes	79
Table 43	Summary of performance for Consent 4826-2 to place, use and maintain a water intake structure and associated structures on the bed of the Otakeho Stream	80
Table 44	Summary of performance for Consent 5451-1 to erect, place, use and maintain a water intake structure on the bed of the Mangawhero-iti Stream for water abstraction purposes	81

Table 45	Summary of performance for Consent 5452-1 to erect, place, use and maintain a water intake structure on the bed of the Mangawhero Stream for water abstraction	81
Table 46	Summary of performance for Consent 3313-3 to take and use groundwater from the Fookes, Chester and Swinbourne Street bores for Waverley municipal supply purposes	82
Table 47	Summary of performance for Consent 9563-1 to take and use water groundwater for Waverley Beach water supply purposes	83
Table 48	Summary of performance for Consent 0231-3 to take and use water from the Oaonui Stream for a rural community water supply scheme and the Maui Production Station	83
Table 49	Summary of performance for Consent 5453-1 to erect, place, use and maintain a water intake structure on the bed of the Oaonui Stream for water abstraction purposes	84
Table 50	Summary of performance for Consent 6451-1 to take and use groundwater from up to two bores for the purpose of supplying the Nukumarū community rural water scheme	85

List of figures

Figure 1	Location of South Taranaki District Council, CCWSL and Oaonui Water Supply Limited resource consents	8
Figure 2	Location of South Taranaki District Council, Nukumarū Water Scheme Society resource consents	9
Figure 3	Aerial photo showing locations of the old and new WTPs, and relevant sampling sites	34
Figure 4	Graph of the daily abstraction for the Cold Creek water supply (L/s)	41
Figure 5	Graph of the daily abstraction for the Eltham water supply (m ³ /day)	42
Figure 6	Graph of the daily abstraction for the Hawera water supply (m ³ /day) from the Kapuni Stream	43
Figure 7	Graph of the daily abstraction from the Kapuni bore (m ³ /day)	43
Figure 8	Graph of the daily abstraction from the Waingongoro River for the Inaha water supply (m ³ /day)	45
Figure 9	Graph of the daily combined abstraction from the Mangatoki Stream for the Inaha water supply	45
Figure 10	Graph of the daily abstraction for the Opunake water supply	46
Figure 11	Graph showing combined daily abstractions from the Patea groundwater bores	47
Figure 12	Graph of the abstraction for the Rahotu water supply (m ³ /day)	47
Figure 13	Graph of daily abstractions for the Wai-inu Beach water supply (m ³ /day)	48
Figure 14	Mangawhero-iti rate of abstraction (L/s)	49
Figure 15	Otakeho rate of abstraction (L/s)	50
Figure 16	Mangawhero rate of abstraction (L/s)	50
Figure 17	Residual flow in the Mangawhero-iti Stream	51
Figure 18	Graph of daily abstractions from the Chester Street bore	52
Figure 19	Graph of the daily abstraction from the Fookes Street bore (m ³ /day)	53
Figure 20	Graph of the daily abstraction from the Swinbourne Street bore (m ³ /day)	53
Figure 21	Graph of the average daily abstraction from the Waverley Beach bore	54
Figure 22	Graph of the daily abstraction from the Oaonui Stream for the Oaonui water supply (m ³ /day)	54
Figure 23	Graph of the average daily abstraction for the Nukumarū water supply	55

List of photos

Photo 1	New membrane filters at Rahotu WTP	32
----------------	------------------------------------	----

1. Introduction

1.1 Compliance monitoring programme reports and the Resource Management Act 1991

1.1.1 Introduction

This report is the Annual Report for the period July 2013-June 2014 by the Taranaki Regional Council (the Council) on the monitoring programme associated with resource consents held by the South Taranaki District Council (STDC), Nukumarū Water Scheme Society Incorporated (NWSSI), Oaonui Water Supply Limited (OWSL) and Cold Creek Water Supply Limited (CCWSL). STDC operates 11 water supply schemes and NWSSI, OWSL and CCWSL operate one water supply scheme each in the South Taranaki District.

This report covers the results and findings of the monitoring programme implemented by the Council in respect of the consents held by STDC, NWSSI, OWSL and CCWSL that relate to water supply schemes within the South Taranaki District

One of the intents of the *Resource Management Act 1991* (RMA) is that environmental management should be integrated across all media, so that a consent holder's use of water, air, and land should be considered from a single comprehensive environmental perspective. Accordingly, the Council generally implements integrated environmental monitoring programmes and reports the results of the programmes jointly. This report discusses the environmental effects of the Company's use of water, land and air, and is the 15th combined annual report by the Council for the water supply industry in the South Taranaki District.

1.1.2 Structure of this report

Section 1 of this report is a background section. It sets out general information about compliance monitoring under the RMA and the Council's obligations and general approach to monitoring sites through annual programmes, the resource consents held by STDC, NWSSI, OWSL and CCWSL, the nature of the monitoring programme in place for the period under review, and a description of the activities and operations conducted at the consent holders' sites.

Section 2 presents the results of monitoring during the period under review, including scientific and technical data.

Section 3 discusses the results, their interpretations, and their significance for the environment.

Section 4 presents recommendations to be implemented in the 2014-2015 monitoring year.

A glossary of common abbreviations and scientific terms, and a bibliography, are presented at the end of the report.

1.1.3 The Resource Management Act 1991 and monitoring

The *Resource Management Act 1991* (RMA) primarily addresses environmental 'effects' which are defined as positive or adverse, temporary or permanent, past, present or future, or cumulative. Effects may arise in relation to:

- (a) the neighbourhood or the wider community around an activity, and may include cultural and social-economic effects;
- (b) physical effects on the locality, including landscape, amenity and visual effects;
- (c) ecosystems, including effects on plants, animals, or habitats, whether aquatic or terrestrial;
- (d) natural and physical resources having special significance (eg, recreational, cultural, or aesthetic);
- (e) risks to the neighbourhood or environment.

In drafting and reviewing conditions on discharge permits, and in implementing monitoring programmes, the Council is recognising the comprehensive meaning of 'effects' inasmuch as is appropriate for each activity. Monitoring programmes are not only based on existing permit conditions, but also on the obligations of the RMA to assess the effects of the exercise of consents. In accordance with section 35 of the RMA, the Council undertakes compliance monitoring for consents and rules in regional plans, and maintains an overview of the performance of resource users and consent holders. Compliance monitoring, including both activity and impact monitoring, enables the Council to continually re-evaluate its approach and that of consent holders to resource management and, ultimately, through the refinement of methods and considered responsible resource utilisation, to move closer to achieving sustainable development of the region's resources.

1.1.4 Evaluation of environmental and administrative performance

Besides discussing the various details of the performance and extent of compliance by the consent holder/s during the period under review, this report also assigns a rating as to each Company's environmental and administrative performance.

Environmental performance is concerned with actual or likely effects on the receiving environment from the activities during the monitoring year. **Administrative performance** is concerned with the Company's approach to demonstrating consent compliance in site operations and management including the timely provision of information to Council (such as contingency plans and water take data) in accordance with consent conditions.

Events that were beyond the control of the consent holder and unforeseeable (i.e. a defence under the provisions of the RMA can be established) may be excluded with regard to the performance rating applied. For example loss of data due to a flood destroying deployed field equipment.

The categories used by the Council for this monitoring period, and their interpretation, are as follows:

Environmental Performance

- **High** No or inconsequential (short-term duration, less than minor in severity) breaches of consent or regional plan parameters resulting from the activity; no adverse effects of significance noted or likely in the receiving environment. The Council did not record any verified unauthorised incidents involving significant environmental impacts and was not obliged to issue any abatement notices or infringement notices in relation to such impacts.
- **Good** Likely or actual adverse effects of activities on the receiving environment were negligible or minor at most. There were some such issues noted during monitoring, from self reports, or in response to unauthorised incident reports, but these items were not critical, and follow-up inspections showed they have been dealt with. These minor issues were resolved positively, co-operatively, and quickly. The Council was not obliged to issue any abatement notices or infringement notices in relation to the minor non-compliant effects; however abatement notices may have been issued to mitigate an identified potential for an environmental effect to occur.

For example:

- High suspended solid values recorded in discharge samples, however the discharge was to land or to receiving waters that were in high flow at the time;
- Strong odour beyond boundary but no residential properties or other recipient nearby.
- **Improvement required** Likely or actual adverse effects of activities on the receiving environment were more than minor, but not substantial. There were some issues noted during monitoring, from self reports, or in response to unauthorised incident reports. Cumulative adverse effects of a persistent minor non-compliant activity could elevate a minor issue to this level. Abatement notices and infringement notices may have been issued in respect of effects.
- **Poor** Likely or actual adverse effects of activities on the receiving environment were significant. There were some items noted during monitoring, from self reports, or in response to unauthorised incident reports. Cumulative adverse effects of a persistent moderate non-compliant activity could elevate an 'improvement required' issue to this level. Typically there were grounds for either a prosecution or an infringement notice in respect of effects.

Administrative compliance

- **High** The administrative requirements of the resource consents were met, or any failure to do this had trivial consequences and were addressed promptly and co-operatively.
- **Good** Perhaps some administrative requirements of the resource consents were not met at a particular time, however this was addressed without repeated interventions from the Council staff. Alternatively adequate reason was provided

for matters such as the no or late provision of information, interpretation of 'best practical option' for avoiding potential effects, etc.

- **Improvement required** Repeated interventions to meet the administrative requirements of the resource consents were made by Council staff. These matters took some time to resolve, or remained unresolved at the end of the period under review. The Council may have issued an abatement notice to attain compliance.
- **Poor** Material failings to meet the administrative requirements of the resource consents. Significant intervention by the Council was required. Typically there were grounds for an infringement notice.

For reference, in the 2013-2014 year, 60% of consent holders in Taranaki monitored through tailored compliance monitoring programmes achieved a high level of environmental performance and compliance with their consents, while another 29% demonstrated a good level of environmental performance and compliance with their consents.

1.2 Process description

The water treatment plants operated by STDC, OWSL, NWSSI and CCWSL generally operate in the following manner. Raw water is abstracted from a river or stream via an intake structure. It is passed through a settling pond, followed by coagulation and flocculation before being passed through sand filters or membranes. At some plants the water is passed through a clarifier prior to the sand filters. Chemicals such as lime or soda ash are used to adjust pH and water is disinfected with either hypochlorite solution or chlorine gas, before it is ready for distribution. The waste products from the backwashing of filters (and at some sites, the clarifier bleed) are discharged to water via a settling pond or tank. The water supply schemes sourced by groundwater are typically not treated, but may be chlorinated.

A summary of the process at each individual water supply plant is included in Table 1.

Table 1 South Taranaki water supplies resource consents and processes

Water Supply Scheme	Resource consent	Expiry	Activity	Process
Cold Creek Rural Water Supply	1134-3 Take	2030	To take water from Cold Stream to supply the Cold Creek Water Supply Scheme.	Raw water is abstracted from a weir on Cold Stream. The water is gravity fed to the treatment plant and is passed through a sand filter and then chlorinated (chlorine gas). The filter backwash discharges to Cold Creek via settling ponds. The filter is backwashed roughly once every nine hours. This plant was handed back from STDC to Cold Creek Water Supply Ltd in February 2015.
	6077-1 Discharge	2018	To discharge filter backwash water and supernatant from the Cold Creek WTP into the Cold Stream in the Taungatara catchment.	
	5454-1 Land Use	2018	To erect, place, use and maintain a water intake structure on the bed of Cold Creek in the Taungatara catchment for water abstraction purposes. .	
Eltham Water Supply	0213-3 Take	2018	To take and use water from the Waingongoro River for municipal water supply purposes	Raw water is abstracted from a pool (no weir) and piped to the treatment plant PACI is added and the water passed through a clarifier and sand filters. The water is pH buffered (sodium bicarbonate) and chlorinated. Backwash from the filters is discharged via 1 of 2 settling ponds to a drain which flows to an unnamed tributary of the Waingongoro River.
	0989-3 Discharge	2029	To discharge reservoir contents from the Eltham Water Supply Reservoir onto land adjacent to the Waingongoro River	
	1810-3 Discharge	2017	To discharge up to 2,000 m ³ /day [50 L/s] of overflow and reservoir drainage water from the Eltham water supply reservoir into the Mangawharawhara Stream.	
	1811-3 Discharge	2017	To discharge up to 220 m ³ /day [20 L/s] of filter backwash from the Eltham WTP via a settling pond into an unnamed tributary of the Waingongoro River.	
Hawera Water Supply	0146-2 Take	2020	Take up and use water from the Kapuni Stream for municipal water supply purposes.	New Kapuni WTP commissioned Dececeember 2009 Raw water is abstracted from the Kapuni Stream and pumped to the WTP. It passes through grit tanks and a flocculant is added before it goes into a flocculation tank. It then is pumped through strainers before going through the membrane filters. The water is then pH adjusted using caustic soda, chlorinated, and fluoride added before going to the site reservoirs. Membrane backwash water is discharged via 2 settling ponds to the Kapuni Stream. The discharge water is dechlorinated and pH adjusted before it goes to the ponds.
	0933-3 Discharge	2023	To discharge up to 227 m ³ /day of settling pond supernatant from a WTP into the Kapuni Stream.	
	5596-1 Land Use	2017	To construct, place, use and maintain a weir and intake structure, and to maintain two existing intake structures in the Kapuni Stream for Hawera water supply.	
	7002-1 Take	2023	Take and use up to 4,320 m ³ /day of groundwater at a maximum rate of 50 L/s as a combined total from up to three water bores in a bore field at the Kapuni reservoir site.	
	7446-1 Discharge	2023	To discharge membrane backwash water and cleaning wastewater from the Kapuni WTP into the Kapuni Stream.	
	7413-1 Intake structure	2023	To erect, use and maintain a water intake structure on the bed of the Kapuni Stream.	
	7447-1 Outfall structure	2023	To install, use and maintain an outfall structure on the bank of the Kapuni Stream for the Kapuni WTP.	
Inaha Rural Water Supply	1185-3 Take	2023	To take water from the Mangatoki Stream in the Waingongoro catchment for Inaha rural water supply purposes.	Raw water is abstracted from two intake structures (weirs) on the Mangatoki Stream and a single intake (no weir) on the Waingongoro River. Water is gravity

Water Supply Scheme	Resource consent	Expiry	Activity	Process
	1186-3 Take	2023	To take water from the Waingongoro River for Inaha rural water supply purposes..	fed and pumped to a settling pond and then to the treatment plant. PACI is added and the water is passed through 2 sand filters. The water is pH buffered (sodium bicarbonate) and chlorinated. Filter backwash is discharged to a small settling pond, then to an unnamed tributary of the Mangatoki Stream via a natural pond.
	5364-1 Take (surrendered)	2017	To take and use water from the Mangatoki Stream for Inaha rural water supply	
	3927-2 Discharge	2017	To discharge up to 228 m ³ /day of filter backwash to the Mangatoki Stream.	
	3928-2 Discharge	2017	To discharge up to 3,060 m ³ /day of uncontaminated overflow water into the Mangatoki Stream.	
	4102-2 Land Use	2023	To maintain an existing low-level weir and fish pass across the Mangatoki Stream.	
	5365-1 Land Use	2017	To erect and maintain an intake structure (weir) on the bed of Mangatoki Stream.	
Opunake Water Supply	0232-4 Take	2030	To take and use water from the Waiaua River for Opunake town water supply purposes	Water is abstracted from the true right bank of the Waiaua Stream (no weir) and enters a settling pond prior to being gravity fed to the treatment plant. PACI is added and the water passed through a sand filter and then chlorinated (chlorine gas). Accumulated solids from the settling pond are regularly removed. The plant has three sand filters that operate in parallel. Each of the filters backwashes (using chlorinated water) approximately once every 1-2 hours depending on river conditions. The filter backwash and reservoir overflow is discharged via a settling tank to the Waiaua Stream.
	5574-2 Discharge	2030	To discharge water treatment residuals, and pond drainage water from the Opunake Water Treatment Plant into the Waiaua River	
	9473-Structure	2030	To construct, place and use a water intake structure on the bed of the Waiaua River for water abstraction purposes	
Patea Water Supply	3388-3 Take	2028	To take and use groundwater from three bores (known as Bore 1, Bore 2 and Bore 4) for Patea Township water supply purposes	Groundwater is pumped from bores 1,2 and 4 and then sent to the treatment plant Egmont Rd.
Pope Rural Water Supply	See Waimate West 3911-2	2018	Up to 5 L/s is diverted to the Pope water supply from a larger take from the Otakeho Stream (Waimate West Scheme).	Up to 5 L/s of raw water is taken from the Otakeho-Mangawhero diversion pipeline and gravity fed to the Pope rural water supply. Water enters the treatment plant and is passed through a sand filter and then chlorinated (sodium hypochlorite). Treated water is stored in tanks adjacent to the treatment plant. The filter backwash is discharged to an unnamed tributary of the Mangawhero Stream via a small settling pond.
	4446-2 Discharge	2023	To discharge treated backwash water from the Pope Rural Water Supply Treatment Plant into an unnamed tributary of the Mangawhero Stream.	
Rahotu Water Supply	3696-3 Take	2031	To take and use water from the Pungaereere Stream for the Rahotu community water supply.	Raw water is pumped from a pool in the Pungareere Stream (no weir) to the adjacent treatment plant. Water is treated by clarification, microfiltration and sand filtration.
	6038-1 Discharge	2019	To discharge filter backwash water and settling tank waste from the Rahotu WTP into the Pungaereere Stream.	

Water Supply Scheme	Resource consent	Expiry	Activity	Process
Wai-inu Beach Water Supply	3770-3 Take	2028	To take and use groundwater for Wai-inu Beach water supply purposes	Groundwater is pumped from a bore, chlorinated and then pumped to a reservoir for distribution.
Waimate West Water Supply	0634-3 Take	2023	To take water from the Mangawhero-iti Stream for the Waimate West water supply.	Raw water is diverted from the Otakeho and Mangawhero Streams to the Mangawhero-iti Stream. Water is then abstracted from the Mangawhero-iti Stream (all takes are via weirs) and gravity fed to the treatment plant. Up to 5 L/s from the Otakeho take is diverted to the Pope rural supply. When sufficient water can be abstracted from the other two streams in the scheme, water from the Mangawhero Stream is avoided due to its turbidity. PACl and flocculent are added and the water passes through a clarifier and sand filters. The water is pH buffered (soda ash) and chlorinated (chlorine gas). On average the clarifier is bled every 6 hours and each of the four filters are backwashed once per day. Clarifier bleed and filter backwash are discharged via 1 of 2 settling ponds to an unnamed tributary of the Mangawhero-iti Stream.
	0635-3 Take	2023	To take water from the Mangawhero Stream for the purpose of adding to the flow of the Mangawhero-iti Stream and providing water for the Waimate West water supply.	
	3911-2 Take	2018	To take water from the Otakeho Stream for the Pope and Waimate West water supply schemes.	
	0129-3 Discharge	2023	To discharge treated washwater from the Waimate Water Supply Scheme into an unnamed tributary of the Mangawhero-iti Stream.	
	4826-2 Land Use	2017	To erect and maintain an intake structure (weir) on the bed of the Otakeho Stream.	
	5451-1 Land Use	2017	To erect and maintain an intake structure (weir) on the bed of the Mangawhero-iti Stream.	
	5452-1 Land Use	2017	To erect and maintain an intake structure (weir) on the bed of the Mangawhero Stream.	
Waverley Water Supply	3313-3 Take	2022	To take and use groundwater from the "Fookes Street" bore (GND0244) and the "Chester Street" bore (GND0059) for municipal water supply purposes.	Groundwater is pumped from two bores, which tap a confined aquifer in the Whenuakura formation, to a reservoir for distribution. The water passes through a sand trap prior to being pumped to a reservoir for distribution. There is no treatment.
Waverley Beach Water Supply	9563-1 (not exercised) Permitted Activity Rule 46 used	2028	To take and use water groundwater for Waverley Beach water supply purposes	Groundwater is pumped from a bore to a reservoir for distribution. It is not chlorinated.
Oaonui Rural Water Supply	0231-3 Take	2018	To take up to 3,500 m ³ /day, at a maximum rate of 50 L/s, from the Oaonui Stream for a rural community water supply scheme and the Maui Production Station.	Raw water is abstracted from the Oaonui Stream (weir) and is piped to a settling pond. For 30 min/day water is backflushed to the stream to remove sediment. Water from the pond is treated with chlorine prior to distribution. Chlorine dosing is automated according to the raw water abstraction rate and turbidity.
	Permitted Activity – Discharge		Discharge accumulated solids from the race and settling pond.	
	5453-1 Land Use	2018	To erect and maintain an intake structure (weir) on the bed of the Oaonui Stream.	
Nukumarū Rural Water Supply	6451-1 Take	2039	To take up to 605 litres/day (7 L/s) from up to two bores.	Groundwater is pumped from a bore to a reservoir for distribution.



Figure 2 Location of South Taranaki District Council, Nukumaru Water Scheme Society resource consents

1.3 Resource consents

Section 14 of the RMA stipulates that no person may take, use, dam or divert any water, unless the activity is expressly allowed for by a resource consent or a rule in a regional plan, or it falls within some particular categories set out in Section 14.

Section 15(1)(a) of the RMA stipulates that no person may discharge any contaminant into water, unless the activity is expressly allowed for by a resource consent or a rule in a regional plan, or by national regulations.

Section 13(1)(a) of the RMA stipulates that no person may use, erect, reconstruct, place, alter, extend, remove or demolish any structure or part of any structure in, on, under, or over the bed of any lake or river, unless the activity is expressly allowed for by a resource consent, or a rule in a Regional Plan and in any relevant proposed regional plan.

STDC, OWSL, NWSSI and CCWSL hold various resource consents including water abstraction permits, discharge permits and land use consents for the various water supply plants and structures they operate. These resource consents are listed in Table 1 and their locations are shown in Figure 1. The conditions of the consents are summarised below in Sections 1.3.1 to 1.3.14. Copies of all resource consents held in relation to water supply plants and structures in the South Taranaki District are included in Appendix I.

1.3.1 Cold Creek water supply

1.3.1.1 Water abstraction permit

STDC held water permit 1134-3 to cover the abstraction of water from Cold Stream to supply the Cold Creek Water Supply Scheme. This permit was issued by the Council on 10 July 2013 under Section 87 of the RMA. It is due to expire on 1 June 2030. This consent was transferred to CCWSL on 15 February 2014

Condition one limits the rate of taking.

Condition two requires the consent holder to record the rate and volume of abstraction to a prescribed level of accuracy.

Condition three specifies the format of the records.

Condition four requires the abstraction records and river flow data be transmitted in real time to the council.

Conditions five, six and seven relate to the certification, maintenance and accessibility of equipment.

Condition eight sets a residual flow rate.

Condition nine requires that the intake screen shall not trap fish.

Condition ten requires the best practical option be adopted.

Condition 11 requires annual leak detection and water use efficiency report.

Condition 12 requires three annual financial contributions

Condition 13 is a review condition.

1.3.1.2 Water discharge permit

STDC holds water discharge permit **6077-1** to cover the discharge of filter backwash water and supernatant from the Cold Creek water treatment plant into the Cold Stream in the Taungatara catchment. This permit was issued by the Council on 29 November 2002 under Section 87 of the RMA. It is due to expire on 1 June 2018.

Condition one establishes the location of the discharge point.

Condition two limits the rate of discharge.

Condition three specifies effects which the discharge is prohibited to cause in the receiving waters.

Condition four limits certain contaminants in the discharge.

Condition five is a review provision.

1.3.1.3 Land use permits

STDC holds land use permit **5454-1** to erect, place, use and maintain a water intake structure on Cold Creek for the Cold Creek rural water supply scheme. This permit was issued by the Council on 1 March 1999 under Section 87(a) of the RMA. It is due to expire on 1 June 2018.

Conditions one and six deal with construction and maintenance works.

Condition two requires the structure to be constructed in accordance with the documentation in support of the application.

Conditions three and four require the consent holder to minimise discharge of silt, disturbance of riverbed and adverse effects on water. Areas disturbed are to be reinstated.

Conditions five and seven deal with provision of fish passage.

Condition eight requires that the structure be removed when no longer required and the area reinstated.

Condition nine is a review provision.

1.3.2 Eltham water supply

1.3.2.1 Water abstraction permit

STDC holds water permit **0213-3** to take and use water from the Waingongoro River for municipal water supply purposes. This permit was issued by the Council on 15 December 1999 under Section 87 of the RMA. It is due to expire on 1 June 2018.

Condition one imposes limits on the volume and rate of abstraction.

Condition two requires measuring of daily rates of abstraction and provision of abstraction data to the Council.

Condition three requires exercise of the consent to be in accordance with the information supplied in support of the application.

Condition four requires quantification and reporting of reticulation losses.

Condition five requires investigation and reporting on the blocking of the intake.

Conditions six and eight are review provisions.

Condition seven sets out a requirement for a contribution to the Taranaki Tree Trust.

1.3.2.2 Water discharge permit

STDC holds water discharge permit **0989-3** to discharge reservoir contents from the Eltham Water Supply Reservoir onto land adjacent to the Waingongoro River. This permit was issued by the Council on 5 November 2012 under Section 87 of the RMA. It is due to expire on 1 June 2029.

Condition one requires that the best practical option be adopted.

Condition two requires that Council be notified prior to discharge.

Conditions three and four specify volume and time of discharge.

Condition five prohibits direct discharge to the Waingongoro River.

Conditions six and seven deal with the minimisation of sediment entering the stream.

Condition eight set out effects the discharge must not cause.

Condition nine is a review condition.

STDC holds water discharge permit **1810-3** to cover the discharge of overflow and reservoir drainage from the Eltham water treatment plant reservoir to the Mangawharawhara Stream. This permit was issued by the Council on 28 July 1999 under Section 87 of the RMA. It is due to expire on 1 June 2017.

Condition one requires approval of the Council prior to the emptying and cleaning of the reservoir.

Condition two requires the consent holder to minimise the periods when the consent is exercised.

Condition three requires the consent holder to minimise the discharge of accumulated sediments in the reservoir to the receiving water when emptying and cleaning the reservoir.

Condition four specifies effects which the discharge is prohibited to cause in the receiving waters, while condition five places limits on certain contaminants in the discharge.

Condition six is a review provision.

STDC holds water discharge permit **1811-3** to cover the discharge of filter backwash from the Eltham water treatment plant to an unnamed tributary of the Waingongoro River. This permit was issued by the Council on 28 July 1999 under Section 87 of the RMA. It is due to expire on 1 June 2017.

Condition one deals with maintenance and operation of the settlement pond system.

Condition two specifies effects which the discharge is prohibited to cause in the receiving waters.

Condition three places limits on certain contaminants in the discharge.

Condition four is a review provision.

1.3.3 Hawera water supply

1.3.3.1 Water abstraction permits

STDC holds water permit **0146-2** to take and use water from the Kapuni Stream for municipal water supply purposes. This permit was issued by the Council on 7 June 2000 under Section 87 of the RMA. It is due to expire on 1 June 2020.

Condition one imposes limits on the volume and rate of abstraction.

Condition two requires measuring of daily rates of abstraction and provision of this data to the Council.

Condition three requires exercise of the consent to be in accordance with the information supplied in support of the applications, and includes the provision of reporting on efficiency measures every two years.

Condition four specifies the circumstances when additional water can be taken and reporting requirements following such an event.

Condition five sets out a requirement for a contribution to the Taranaki Tree Trust.

Condition six requires the preparation and maintenance of a management plan, in conjunction with other users, for the Kapuni Stream.

Condition seven requires the consent holder to undertake a leak detection and repair programme.

Condition eight requires that the point of abstraction remain the same until the new intake is commissioned.

Condition nine is a review provision.

STDC holds water permit **7002-1** to take and use up to 4,320 m³/day of groundwater at a maximum rate of 50 L/s as a combined total from up to three water bores in a bore field at the Kapuni reservoir site for municipal, rural, industrial, and recreational supply purposes. This permit was issued by the Council on 2 November 2006 under Section 87 of the RMA. It is due to expire on 1 June 2023.

Condition one requires the exercise of consent to be in accordance with the documentation submitted in support of the application.

Condition two requires the consent holder to notify the Council seven days prior to the exercise of the consent.

Condition three states that the consent holder must supply the Council with a report detailing the results of pump testing prior to the exercise of the consent.

Conditions four and five deal with the rate and volume of abstraction, while condition six deals with recording of the abstractions.

Conditions seven and eight relate to monitoring of the bores.

Conditions nine and ten deal with lapse and review of the consent.

1.3.3.2 Water discharge permit

STDC holds water discharge permit **0933-3** to discharge up to 227 cubic m³ /day of settling pond supernatant from a water treatment plant into the Kapuni Stream. This permit was issued by the on 26 January 2006 under Section 87 of the RMA. Changes to consent conditions were made in February 2007. It is due to expire on 1 June 2023.

Condition one requires the adoption of the best practicable option.

Condition two requires the consent to be exercised in accordance with the application documentation.

Condition three requires notification of Council prior to exercising the consent.

Condition four requires the consent holder to address the issue of a permanent solution for water treatment residuals by constructing a new water treatment plant in 2010.

Condition five requires the proper and efficient maintenance and operation of the settlement system.

Condition six lists certain effects which the discharge shall not have on the receiving waters.

Condition seven places limits on certain parameters in the discharge.

Conditions eight and nine deal with lapse and review of the consent.

STDC holds water discharge permit **7446-1** to discharge membrane backwash water and cleaning wastewater from the Kapuni Water Treatment Plant into the Kapuni Stream. This permit was issued by the Council on 13 March 2009 under Section 87 of the RMA. The consent is due to expire on 1 June 2023.

Condition one requires that the consent holder adopt the best practicable option to minimise adverse environmental effects.

Conditions two, three and four deal with levels of contaminants in the discharge, and effects on receiving waters.

Conditions five and six deal with lapse and review of the consent.

1.3.3.3 Land use permit

STDC holds land use permit **5596-1** to construct, place, use and maintain a weir and intake structure, and to maintain two existing intake structures in the Kapuni Stream for the Hawera water supply. This permit was issued by the Council on 19 May 2000 under Section 87(a) of the RMA. It is due to expire on 1 June 2017.

Condition one requires notification of the Council prior to construction or maintenance works.

Condition two requires the construction of the structures to be in accordance with the documentation submitted in support of the application.

Condition three prohibits construction works during the period 1 May to 31 October.

Conditions four and five require the consent holder to minimise streambed disturbance, discharge of silt and adverse effects on water quality.

Condition six prohibits the refuelling of equipment or machinery on the streambed.

Conditions seven and eight deal with the provision of fish passage.

Condition nine deals with prevention of erosion adjacent to or downstream of the rock riprap.

Condition ten prohibits the removal of streambed material during construction other than the material that makes up the weir/rock ramp.

Condition 11 prohibits the removal of streambed material from above the weir other than between 1 November and 30 April.

Condition 12 requires material removed from the streambed to be placed on the banks or dry sections of streambed downstream of the weir so it can re-enter the stream and minimise effects.

Condition 13 deals with the removal of the structure when no longer required.

Condition 14 is a review provision.

STDC holds land use permit **7413-1** to erect, use and maintain a water intake structure on the bed of the Kapuni Stream, including temporary damming and diversion during construction. This permit was issued by the Council on 5 February 2009 under Section 87(a) of the RMA. The consent is due to expire on 1 June 2023.

Condition one requires that the consent is carried out in accordance with the documentation submitted with the application.

Conditions two and three deal with timing and notification of maintenance.

Conditions four and five require the consent holder to minimise disturbance to the stream.

Condition six requires that the structure is removed and the area reinstated, if and when it is no longer required.

Condition seven requires monitoring and maintenance of the fish pass.

Condition eight deals with any archaeological remains discovered during construction.

Conditions nine and ten deal with lapse and review of the consent.

STDC holds land use permit **7447-1** to install, use and maintain an outfall structure on the bank of the Kapuni Stream for the Kapuni Water Treatment Plant. This permit was issued by the Council on 20 February 2009 under Section 87(a) of the RMA. The consent is due to expire on 1 June 2023.

Condition one requires that the consent is carried out in accordance with the documentation submitted with the application.

Conditions two and three deal with the timing and notification of maintenance.

Conditions four and five require the consent holder to minimise disturbance to the stream.

Condition six requires that the structure is removed and the area reinstated, if and when it is no longer required.

Condition seven deals with any archaeological remains discovered during construction.

Conditions eight and nine deal with lapse and review of the consent.

1.3.4 Inaha water supply

1.3.4.1 Water abstraction permits

STDC holds water permit **1185-3** to take water from the Mangatoki Stream in the Waingongoro catchment for Inaha rural water supply purposes. This permit was issued by the Council on 16 June 1993 under Section 87 of the RMA. Changes were made to the consent in May 2014. It is due to expire on 1 June 2023.

Condition one requires the adoption of the best practicable option.

Conditions two and three deal with the rate and method of abstraction.

Condition three places a limit on the rate and volume of abstraction.

Conditions four, five and six require the installation, maintenance and certification of a device to measure abstraction.

Condition seven deals with maintenance of the structure and its removal when no longer required.

Conditions eight, nine and ten are related to data retrieval and records of abstraction.

Conditions 11 and 12 requires the screening of intake structures to avoid the entrainment of fish and maintenance to provide fish passage.

Condition 13 requires the promotion of water use efficiency and the undertaking of a leak detection and repair programme. This programme is to be reported on annually.

Condition 14 is a review provision.

STDC holds water permit **1186-3** to take water from the Waingongoro River for Inaha rural water supply purposes. This permit was issued by the Council on 29 August 2006 under Section 87 of the RMA. It is due to expire on 1 June 2023.

Condition one requires the adoption of the best practicable option.

Condition two requires the consent to be exercised in accordance with the application documentation.

Condition three places a limit on the volume and rate of abstraction.

Condition four requires the recording of abstraction rates and provision of data to the Council.

Condition five deals with the maintenance of the intake and its removal when no longer required.

Condition six requires screening of intake structures to avoid entrainment of fish.

Condition seven provides for adequate fish passage.

Condition eight requires the promotion of water use efficiency and the undertaking of a leak detection and repair programme which is to be reported on annually.

Conditions nine and ten deal with lapse and review of consent.

STDC held water permit **5364-1** to take and use water from the Mangatoki Stream for Inaha rural water supply scheme purposes. This permit was issued by the Council on 23 September 1998 under Section 87 of the RMA and was due to expire on 1 June 2017. It was surrendered during period under review, on 29 May 2014

Conditions one and two dealt with the abstraction volume and rate and recording of these.

Condition three required the consent to be exercised in accordance with the documentation in support of the application.

Condition four required mitigation of effects through riparian management.

Condition five allowed for the suspension or reduction of abstraction during extreme low flow events.

Condition six was a review provision.

1.3.4.2 Water discharge permits

STDC holds water discharge permit **3927-1** to cover the discharge of filter backwash to an unnamed tributary of the Mangatoki Stream. This permit was issued by the Council on 24 March 1993 under Section 87 of the RMA. It is due to expire on 1 June 2017.

Condition one deals with the maintenance and operation of the settlement pond system.

Condition two specifies effects which the discharge is prohibited to cause in the receiving waters.

Condition three places limits on certain contaminants in the discharge.

Condition four is a review provision.

STDC holds water discharge permit **3928-2** to cover the discharge of uncontaminated overflow water from a settling pond to the Mangatoki Stream. This permit was issued by the Council on 4 June 1999 under Section 87 of the RMA. It is due to expire on 1 June 2017.

Condition one deals with the maintenance and operation of the settlement pond system.

Condition two specifies effects which the discharge is prohibited to cause in the receiving waters.

Condition three is a review provision.

1.3.4.3 Land use permits

STDC holds land use permit **4102-2** to maintain an existing low-level weir and fish pass across the Mangatoki Stream in the Waingongoro catchment. This permit was issued by the Council on 15 June 2005 under Section 87(a) of the RMA. It is due to expire on 1 June 2023.

Condition one requires the adoption of best practicable option.

Condition two requires the consent to be exercised in accordance with the application documentation.

Condition three requires notification of Council prior to exercise of consent.

Conditions four to eight deal with maintenance of the structure.

Condition nine requires the structure to not impede fish passage.

Condition ten requires the structure to be removed and the area reinstated when no longer required.

Conditions 11 and 12 deal with lapse and review of consent.

STDC holds land use permit **5365-1** to erect, place, and maintain a low level intake weir in the Mangatoki Stream for Inaha rural water supply scheme purposes. This permit was issued by the Council on 23 September 1998 under Section 87(a) of the RMA. It is due to expire on 1 June 2017.

Condition one requires notification of the Council prior to major construction or maintenance works.

Condition two requires prevention of discharge of contaminants into the stream during construction or maintenance works.

Condition three prohibits obstruction of fish passage.

Condition four requires the structure to be constructed in accordance with the documentation in support of the application.

Condition five requires the consent holder to ensure the safety of the structure.

Condition six requires the structure to be removed when no longer required and the area reinstated.

Condition seven is a review provision.

1.3.5 Opunake water supply

1.3.5.1 Water abstraction permit

STDC hold water permit **0232-4** to take and use water from the Waiaua River for Opunake town water supply purposes. This permit was issued by the Council on 20 August 2013 under Section 87 of the RMA. It is due to expire on 1 June 2030.

Condition one sets daily volumes and abstraction rates.

Condition two sets out the circumstance under which the secondary intake may be used.

Condition three sets daily volumes and abstraction rates when using the secondary intake.

Condition four deals with notification requires when using the secondary intake.

Conditions five, six, seven, and eight deal with the installation of water metering and recording equipment, and maintenance and accessibility of the equipment.

Conditions nine and ten relate to the format and transmission of records.

Condition 11 requires the adoption of the best practical option.

Condition 12 requires annual leak detection and water use efficiency report.

Conditions 13 and 14 are lapse and review provisions.

1.3.5.2 Water discharge permit

STDC hold water discharge permit **5574-2** to discharge water treatment residuals and pond drainage water from the Opunake Water Treatment Plant into the Waiaua River. This permit was issued by the Council on 30 July 2013 under Section 87 of the RMA. It is due to expire on 1 June 2030.

Condition one requires the consent holder to adopt the best practicable option to prevent or minimise adverse environmental effects.

Condition two states the total daily discharge.

Condition three specifies effects which the discharge is prohibited to cause in the receiving waters.

Condition four places limits on certain contaminants in the discharge.

Conditions five and six are lapse and review provisions.

1.3.5.3 Land use consents

STDC holds land use permit **9473-1** to construct, place and use a water intake structure on the bed of the Waiaua River for water abstraction purposes. This permit was issued by the Council on 21 February 2013 under Section 87(a) of the RMA. It is due to expire on 1 June 2030.

Condition one specifies intake dimensions and screen slot size.

Condition two requires that Council be notified prior to works.

Condition three requires that river bed disturbance be kept to a minimum.

Condition four requires that sediment discharge into the river be minimised.

Condition five specifies maximum screen slot velocity.

Condition six requires that fish passage not be obstructed.

Condition seven requires a one -off payment to contribute to riparian planting to mitigate effects.

Condition eight deals with procedures if archaeological remains are discovered during works.

Condition nine requires the structure be removed when no longer required.

Condition ten is a lapse condition.

Condition 11 is a review condition.

1.3.6 Patea water supply

1.3.6.1 Water abstraction permits

STDC holds water permit **3388-3** to take and use groundwater from three bores (known as Bore 1, Bore 2 and Bore 4) for Patea Township water supply purposes. This permit was issued by the Council on 30 May 2012 under Section 87 of the RMA. It will expire on 1 June 2028.

Conditions 1, 2 and 3 deal with the maximum daily takes for the three bores.

Conditions 4, 5, 6 and 7 deal with requirements to fit and maintain flow meters and data loggers at each bore.

Condition eight requires that the best practical option be adopted.

Conditions 9, 10 and 11 deal with monitoring and mitigating effects on a nearby private bore.

Condition 12 requires that no salt water intrusion shall occur as result of the take.

Condition 13 deals with change and review of consent.

(Note: This consent has since been changed in October 2014 to include a new bore).

1.3.7 Pope water supply

1.3.7.1 Water abstraction permit

Raw water is abstracted for the Waimate water supply scheme from the Otakeho Stream licensed by resource consent 3911 (Section 1.3.3.1). Up to 5 litres per second is diverted from the pipeline to the Pope rural water supply treatment plant.

1.3.7.2 Water discharge permit

STDC holds water discharge permit **4446-2** to cover the discharge of treated filter backwash from the Pope Rural Water Supply Treatment Plant into an unnamed tributary of the Mangawhero Stream. This permit was issued by the Council on 9 June 2006 under Section 87 of the RMA. It is due to expire on 1 June 2023.

Condition one requires the adoption of the best practicable option.

Condition two requires the consent to be exercised in accordance with the application documentation.

Condition three limits the discharge rate.

Condition four places limits on certain parameters in the discharge.
Condition five requires the proper and efficient maintenance of the settling pond.

Condition six lists effects that the discharge should not have on the receiving waters.

Conditions seven and eight deal with lapse provision and review of consent.

1.3.8 Rahotu water supply

1.3.8.1 Water abstraction permit

STDC holds water permit **3696-3** to take and use water from the Pungaereere Stream for the Rahotu community water supply. This permit was issued by the Council on 15 August 2013 under Section 87 of the RMA. It is due to expire on 1 June 2031.

Condition one limits the volume and rate of abstraction.

Conditions two to seven deal with recording equipment and the provision of abstraction records.

Condition eight requires the consent holder to adopt the best practicable option to prevent or minimise adverse effects.

Condition nine requires the consent holder to submit an annual report on leak detection and minimisation and water use efficiency.

Conditions ten and 11 are lapse and review provisions.

1.3.8.2 Water discharge permit

STDC holds water discharge permit **6038-1** to cover the discharge of filter backwash water and settling tank waste from the Rahoitu Water Treatment Plant into the Pungaereere Stream. This permit was issued by the Council on 2 September 2002 under Section 87 of the RMA. It is due to expire on 1 June 2019.

Condition one specifies effects which the discharge is prohibited to cause in the receiving waters.

Condition two places limits on certain contaminants in the discharge.

Condition three is a review provision.

1.3.9 Wai-inu Beach water supply

1.3.9.1 Water abstraction permit

STDC holds water permit **3770-3** to take and use groundwater for Wai-inu Beach water supply purposes. This permit was issued by the Council on 7 May 2012 under Section 87 of the RMA. The consent expires on 1 June 2028.

Condition one sets limits for daily volumes and abstraction rates.

Conditions two to five deal the installation and maintenance of water metering equipment.

Condition six deals with the provision of records.

Condition seven requires the consent holder to adopt best practice.

Conditions eight and nine are lapse and review conditions.

1.3.10 Waimate West water supply

1.3.10.1 Water abstraction permit

STDC holds water permit **0634-3** to take water from the Mangawhero-iti Stream for the Waimate West water supply. This permit was issued by the Council on 7 June 2011 under Section 87 of the RMA. It is due to expire on 1 June 2023.

Conditions one and two limit the rate of abstraction.

Conditions three to six deal with the maintenance, installation and operation of data-logging equipment.

Condition seven requires the consent holder to provide records of water taken. While Condition ten sets a date by which these should be provided in 'real time'.

Conditions eight and nine deal with flow in the Mangawhero-iti Stream downstream of the intake. Condition 12 requires sufficient stream flow measurements to be undertaken in order to comply with Condition nine.

Condition 11 requires the consent holder to install a staff gauge.

Condition 13 requires the consent holder to adopt the best practicable option to prevent or minimise adverse environmental effects.

Condition 14 requires the consent holder to supply an annual report in September each year on various aspects of the scheme.

Condition 15 requires five annual financial contributions.

Condition 16 is a review provision.

STDC holds water permit **0635-3** to take water from the Mangawhero Stream for the purpose of adding to the flow of the Mangawhero-iti Stream and providing water for the Waimate West water supply. This permit was issued by the Council on 7 June 2011 under Section 87 of the RMA. It is due to expire on 1 June 2023.

Condition one limits the rate of abstraction, while Condition two sets restrictions on the take.

Conditions three to six deal with the maintenance, installation and operation of data-logging equipment.

Condition seven requires the consent holder to provide records of water taken. While Condition eight sets a date by which these should be provided in 'real time'.

Condition nine requires the consent holder to adopt the best practicable option to prevent or minimise adverse environmental effects.

Condition ten is a review provision.

STDC holds water permit **3911-2** to take water from the Otakeho Stream for the Pope and Waimate West water supply schemes. This permit was issued by the Council on 22 November 2000 under Section 87 of the RMA. It is due to expire on 1 June 2018. Changes to the conditions of the consent were made on 7 June 2011.

Condition one limits the rate of abstraction.

Conditions two to five deal with the maintenance, installation and operation of data-logging equipment.

Condition six requires the consent holder to provide records of water taken. While Condition eight sets a date by which these should be provided in 'real time'.

Condition seven requires the consent holder to adopt the best practicable option to prevent or minimise adverse environmental effects.

Condition nine deals with recording of flows of less than 500 L/s.

Condition ten is a review provision.

1.3.10.2 Water discharge permit

STDC holds water discharge permit **0129-3** to discharge treated wash water from the Waimate Water Supply Scheme into an unnamed tributary of Kelly's Creek. This permit was issued by the Council on 12 June 2006 under Section 87 of the RMA, with changes made on 15 May 2013. It is due to expire on 1 June 2023.

Condition one requires the adoption of the best practicable option.

Condition two requires the consent to be exercised in accordance with the application documentation.

Condition three limits the discharge rate.

Condition four requires the installation and maintenance of an erosion protection structure.

Condition five places limits on certain parameters in the discharge.

Condition six requires the proper and efficient maintenance of the settling ponds.

Condition seven lists effects that the discharge should not have on the receiving waters.

Conditions eight and nine are lapse and review provisions.

1.3.10.3 Land use consents

STDC holds land use permit **4826-2** to place, use and maintain a water intake structure and associated erosion protection structures, including upgrading the intake structure and constructing a new fish pass, on the bed of the Otakeho Stream. This permit was issued by the Council on 1 March 1999 under Section 87(a) of the RMA. It is due to expire on 1 June 2017. Changes to consent conditions were made on 10 December 2010 to allow for the weir to be upgraded and a new fish pass to be built.

Condition one requires notification of the Council prior to construction or maintenance works.

Condition two requires the structure to be constructed in accordance with the documentation in support of the application.

Conditions three and four require the consent holder to minimise discharge of silt, disturbance of riverbed and adverse effects on water. Areas disturbed are to be reinstated.

Condition five limits the timing of major construction or maintenance works to between 1 November and 30 April.

Condition six requires provision of fish passage.

Condition seven states that a Council biologist shall be present during construction of the fish pass.

Condition eight requires that the structure be removed when no longer required and the area reinstated.

Condition nine is a review provision.

STDC holds land use permit **5451-1** to erect, place, use and maintain a water intake structure on the bed of the Mangawhero-iti Stream. This permit was issued by the Council on 1 March 1999 under Section 87(a) of the RMA. It is due to expire on 1 June 2017.

Condition one requires notification of the Council prior to construction or maintenance works.

Condition two requires the structure to be constructed in accordance with the documentation submitted in support of the application.

Conditions 3 and 4 require the consent holder to minimise discharge of silt, disturbance of riverbed and adverse effects on water. Areas disturbed are to be reinstated.

Condition five limits the timing of major construction or maintenance works to between 1 November and 30 April.

Conditions six and seven deal with fish passage.

Condition eight requires that the structure is removed when no longer required.

Condition nine is a review provision.

STDC holds land use permit **5452-1** to erect, place, use and maintain a water intake structure on the bed of the Mangawhero Stream. This permit was issued by the Council on 1 March 1999 under Section 87(a) of the RMA. It is due to expire on 1 June 2017.

Condition one requires notification of the Council prior to construction or maintenance works.

Condition two requires the structure to be constructed in accordance with the documentation supplied in support of the application.

Conditions three and four require the consent holder to minimise discharge of silt, disturbance of riverbed and adverse effects on water. Areas disturbed are to be reinstated.

Condition five limits the timing of major construction or maintenance works to between 1 November and 30 April.

Conditions six and seven deal with fish passage.

Condition eight requires that the structure be removed when no longer required and the area reinstated.

Condition nine is a review provision.

1.3.11 Waverley water supply

1.3.11.1 Water abstraction permits

STDC holds water permit **3313-3** to take and use groundwater from the "Fookes Street" bore (GND0244), the "Chester Street" bore (GND0059) and the "Swinbourne Street" bore (GND2242) for municipal water supply purposes at Waverley. This permit was issued by the Council on 23 September 2010 under Section 87 of the RMA, with changes made on 23 January 2013. It is due to expire on 1 June 2022.

Condition one sets limits on the combined daily volume and combined abstraction rate for all three bores, while condition two sets limits on the daily volume of water and abstraction rate of each bore.

Conditions three to eight deals with the installation and maintenance of metering and logging equipment and the provision of data.

Condition nine requires the consent holder adopt best practice.

Condition ten states that the exercise of this consent shall not cause saltwater intrusion.

Condition 11 requires that the wells be accessible for measurement of static and pumping water levels.

Condition 12 deals with review of the consent.

1.3.12 Waverley Beach water supply

1.3.12.1 Water abstraction permits

STDC holds water permit **9563-1** to take and use water groundwater for Waverley Beach water supply purposes. This permit was issued by the Council on 1 May 2013 under Section 87 of the RMA. It is due to expire on 1 June 2028.

Condition one sets limits on the daily volume and abstraction rate.

Condition two states that taking shall not cause intrusion of saltwater.

Condition three requires that bores to be labelled.

Conditions four to ten deal with the installation and maintenance of metering and logging equipment and the provision of data.

Condition 11 requires the consent holder adopt best practice.

Conditions 12 and 13 are lapse review provisions.

1.3.13 Oaonui water supply

1.3.13.1 Water abstraction permit

Oaonui Water Supply Limited holds water permit **0231-3** to take and use water from the Oaonui Stream for a rural community water supply scheme and the Maui Production Station. This permit was issued by the Council on 22 November 2000 under Section 87 of the RMA. It is due to expire on 1 June 2018.

Condition one limits the abstraction volume and rate.

Condition two requires recording of daily abstraction rates and provision of abstraction data to the Council.

Condition three requires promotion of water conservation and undertaking of a leak detection and repair programme.

Condition four sets out a requirement for a contribution to the Taranaki Tree Trust.

Conditions five and six deal with change and review of consent.

1.3.13.2 Land use permit

Oaonui Water Supply Limited holds land use permit **5453-1** to erect, place, use and maintain a water intake structure on the bed of the Oaonui Stream for water abstraction purposes. This permit was issued by the Council on 1 March 1999 under Section 87(a) of the RMA. It is due to expire on 1 June 2018.

Condition one requires notification prior to construction and maintenance works.

Condition two requires that the structure be constructed in accordance with the documentation supporting the application.

Condition three requires the adoption of best practicable option to minimise adverse effects.

Condition four requires the area disturbed during construction and maintenance to be minimised and disturbed areas reinstated.

Condition five requires major maintenance involving in-stream works to be undertaken between 1 November and 30 April.

Conditions 6 and 7 deal with the provision of fish passage.

Condition eight requires the structure to be removed when no longer required and the area reinstated.

Condition nine is a review provision.

1.3.13.3 Water discharge permit

The raw water is not passed through a clarifier or filter, consequently there is no clarifier bleed or filter backwash discharge. Water flows from the weir to a settling pond along a race. The settling pond is continually flushed by two small discharges from the surface and bottom of the pond back to the Oaonui Stream. The race is regularly flushed to the Oaonui Stream. Due to the small scale nature of both these flows they can be considered as a discharge of water to water and are a permitted activity as allowed by Rule 21 of the Regional Fresh Water Plan. Consequently a resource consent is not required.

1.3.14 Nukumarū water supply

1.3.14.1 Water abstraction permits

Nukumarū Water Scheme Society Inc. holds water permit **6451-1** to take and use groundwater from up to two bores for the purpose of supplying the Nukumarū community rural water scheme. This permit was issued by the Council on 20 October 2004 under Section 87 of the RMA. It is due to expire on 1 June 2039.

Condition one requires the consent to be exercised in accordance with the documentation submitted in support of the application.

Condition two places a limit on the abstraction volume and rate.

Conditions three and four require a water meter to be installed, and abstraction data provided to Council.

Condition five deals with payment of monitoring costs.

Conditions six and seven are lapse and review of provisions.

1.4 Monitoring programme

1.4.1 Introduction

Section 35 of the RMA sets out obligations upon the Council to gather information, monitor, and conduct research on the exercise of resource consents, and the effects arising, within the Taranaki region and report upon these.

The Council may therefore make and record measurements of physical and chemical parameters, take samples for analysis, carry out surveys and inspections, conduct investigations, and seek information from consent holders.

The 2013-2014 monitoring programme for the water supply schemes in the South Taranaki District consisted of six primary components.

1.4.2 Programme liaison and management

There is generally a significant investment of time and resources by the Council in:

- ongoing liaison with resource consent holders over consent conditions and their interpretation and application;

- in discussion over monitoring requirements;
- preparation for any reviews;
- renewals;
- new consents;
- advice on the Council's environmental management strategies and content of regional plans and;
- consultation on associated matters.

1.4.3 Site inspections

Each water supply scheme that has a weir and/or required National Water Metering Regulations (NWMR) assessment was inspected, with site visits focussing on: compliance with water abstraction limits, the effects of filter backwash discharges on receiving waters, fish passage at abstraction weirs .

1.4.4 Chemical sampling

The Council undertook sampling of discharges from the Kapuni, Rahotu and Eltham WTP's. Receiving water samples were collected in relation to discharges from the Kapuni and Rahotu WTP's.

1.4.5 Receiving environment monitoring

Biomonitoring surveys were undertaken in relation to the Kapuni, Waimate West and Cold Creek plants to determine effects upon the stream communities due to the discharge of filter backwash.

One fish survey was carried out in the Kapuni Stream to determine whether the intake weir at the Hawera WTP was obstructing fish passage.

1.4.6 Hydrological Surveys

Hydrological surveys were undertaken in order to check flows and maintain ratings curves.

1.4.7 Review of abstraction data

STDC, CCWSL, NWSSI and OWSL provided abstraction data to the Council throughout the monitoring year. This was reviewed by Council staff to ensure abstraction volumes and rates complied with consent conditions.

2. Results

2.1 Inspections

Annual inspection of WTP's to assess compliance with consent conditions (focussing on structures) were carried out on 6 March 2014 (unless otherwise stated).

2.1.1 Cold Creek water supply

The Cold Creek site was visited on 26 June 2014. Staff met onsite with the consent holder in order to install a data logger on the flowmeter.

There was discussion about the actions the consent holder would need to undertake in order to comply with consent conditions, specifically conditions two (recording volume of water taken in 15 minute intervals), five (flowmeter verification) and seven (measuring and recording devices accessible to Council staff).

The weir and intake structure were inspected and found to be satisfactory.

2.1.2 Eltham water supply

The Waingongoro River was at a low level, and clean and clear at the intake. No issues were noted in regards to the intake. The pre-treatment pond at the intake was empty was not being used. The large back wash pond at the plant was full but not discharging and its contents was found to be clean and clear. A sample was taken from the pond. The plant now had a new large clarifier pre-treating the water prior to filtering.

2.1.3 Inaha water supply

The Waingongoro River was clean and clear at the intake, and no issues were noted with the intake itself. A new meter and telemetry had been installed above the grit trap to make the site compliant with NWMR . The Mangatoki Stream was at a moderate level; it was clean and clear at the intakes and both weirs and fish passes were satisfactory. Both takes from the Mangatoki were metred through the same flow meter and an application to combine consents had been lodged to address this. Excavations had been undertaken at the metering point to allow for NES verification.

2.1.4 Opunake water supply

The Waiaua stream was clean and clear and at low flow. There was a trickle discharge from the raw water pond. No issues were noted from backwash discharges. A new intake had been damaged from a large rock in the bank armouring that shifted during a fresh. The intake was still working and the screen appeared to intact. A replacement works were scheduled to be undertaken in the near future. No discharges were occurring at the time of the inspection. All discharges from this site go to land. The new plant was inspected and photographed for informational purposes.

2.1.5 Rahotu water supply

The new plant was up and running, however the new membrane filters were struggling to stop odour and taste issues and the old clarifier was going to be re-commissioned to address this. The Pungaereere Stream was slightly cloudy and had a slight foam on it. Samples were collected from the stream and the backwash discharge.



Photo 1 New membrane filters at Rahotu WTP

2.1.6 Waimate West water supply

At the Mangawhero River the meter shed had been upgraded with a new data logger, meter and telemetry in order for the site to be compliant with the water metering regulations. The weir and fish pass were in good condition and working well. The river was exhibiting its usual natural turbidity and no abstraction was being made at the time.

The weir and fish pass in the Otakeho Stream were working well and no issues were noted. Meter verification for this site has been booked.

The weir and fish pass on the Mangawhero-iti Stream were working well and no issues were noted. Meter verification for this site has been booked.

The backwash pond was discharging at the time a no visual effects on the stream were noted.



Photograph 1 Upgrade data shed at Mangawhero take

2.1.7 Hawera water supply

The Kapuni Stream was at low flow and clean and clear. There was some debris (mostly tree branches) accumulated on the prow of the intake structure, but these were not having any immediate effect. Overall, the intake was in good condition and functioning well. The south backwash pond was currently in use, but no discharges were occurring as the level had not reached the outlet. A sample was collected from the pond.

2.1.8 Patea water supply

A site visit was made on 21 August 2013 to conduct an annual inspection. The bore installation was inspected and no issues were noted.

2.2 Results of discharge monitoring

2.2.1 Hawera WTP (Kapuni)

Discharge and receiving water samples were taken at the Kapuni WTP (Figure 3) on 5 March (discharge only) and 30 May 2014 and the results are presented in Table 2 below.



Figure 3 Aerial photo showing locations of the old and new WTPs, and relevant sampling sites

Table 2 Kapuni WTP sample results 30 May 2014

Parameter		5-Mar-14	30-May-14			27-Jun-2014	Consent limits for discharge and (KPN000301)
		Pond discharge (STW002080)	Upstream (KPN000300)	Pond discharge (STW002080)	Downstream (KPN000301)	Pond discharge (STW002080)	
Free available chlorine	g/m ³	<0.1	-	0.5	-	<0.01	0.1
Conductivity	mS/m	14.3	13.5	12.5	13.8	-	-
Sodium	g/m ³	16.9	16.0	13.4	16.6	-	-
pH	pH	7.8	7.6	7.6	7.7	-	6.5 - 8.5
Suspended solids	g/m ³	<2	-	<2	-	-	20
Temperature	Deg C	15.1	10.9	12.2	10.8	-	-
Turbidity	NTU	-	2.6	-	2.7	-	(3.9)

Suspended solids, pH and turbidity results comply with the consent limits, and samples collected upstream and downstream were not significantly different.

At 0.5 g/m³ the level of free available chlorine (FAC) in the discharge sample collected on 30 May 2014 exceeded the consent limit of 0.1 g/m³. Due to access and health and safety issues the actual discharge could not be accessed directly and an indicative sample was taken from the pond. Sample comments also noted that the discharge rate was less than 1 L/s and this would have provided for adequate dilution rate to prevent effects. The site was resampled on 27 June 2014 and it was found that the pond water near the outlet had a FAC on <0.01 g/m³

STDC regularly monitors the pond and this data was reviewed. It was found that no other exceedances had occurred. Ongoing spot checks by Council are recommended to ensure the ponds are achieving sufficient residence time to achieve ongoing compliance.

While the consent does not limit sodium it is of particular interest due to the use of chemicals such as sodium hypochlorite, sodium hydroxide and sodium bisulphate in the WTP process. Ballance Agri-Nutrients and Vector both have discharges to the Kapuni Stream, upstream of the WTP discharge which, have limits placed on them for sodium. The WTP discharge will continue to be regularly monitored for sodium to establish whether it is making a significant contribution to sodium loadings in the Kapuni Stream.

2.2.2 Rahotu WTP

The filter backwash from the Rahotu WTP is overland to the Pungaereere Stream. Samples of the discharge and receiving waters were taken on 6 March 2014 and the results are shown in Table 3.

Table 3 Results of sampling at the Rahotu WTP 6 March 2014

Site	Unit	PNG000195 (u/s of discharge)	STW001101 (discharge)	PNG000197 (d/s of discharge)	Consent Limit (in discharge)
Filtered COD	g/m ³	6	<5	<5	-
Conductivity	mS/m	20.5	23.6	20.5	-
DRP	g/m ³ P	0.059	<0.003	0.061	-
NH ₃	g/m ³	0.00577	0.00702	0.00398	-
NH ₄	g/m ³ N	0.047	0.556	0.040	-
NNN	g/m ³ N	0.29	0.16	0.30	-
pH		8.5	7.5	8.4	6.5 – 8.5
Suspended solids	g/m ³	-	26	-	-
Temperature	Deg C	18.6	17.7	18.6	-
Turbidity	NTU	0.98	-	1.0	-

The results were within consent limits in regards to pH. The comparison between the upstream and downstream results indicate that the discharge is not having an adverse effect on water quality. Free available chlorine was not assessed on this occasion due to time constraints between sampling and testing. However the results from the previous two samples have shown the plant to be in compliance. STDC have constructed a new plant at the site and the backwash from this plant is scheduled to be tested in the 2016-2017 period.

2.2.3 Eltham WTP

A sample was collected from the settling pond which was not discharging at the time on 6 March 2014 and the results are presented below in Table 4. Suspended solids and free available chlorine were both in compliance with consent conditions.

Table 4 Results of sampling at the Eltham WTP 6 March 2014

Site	Free available chlorine g/m ³	Total chlorine g/m ³	pH	Suspended solids g/m ³	Conductivity mS/m
Consent Limit (in discharge)	0.1	-	-	20	-
STW002072 (discharge)	<0.1	<0.1	7.6	4	9.9

2.3 Results of receiving environment monitoring

2.3.1 Hawera WTP macroinvertebrate survey (Kapuni)

The Council's standard 'kick-sampling' technique was used on 24 February 2014 at two sites to collect streambed macroinvertebrates from the Kapuni Stream to determine if there had been any adverse effects on the macroinvertebrate community of the stream from Kapuni water treatment plant backwash discharges. Samples were sorted and identified to provide number of taxa (richness) and MCI and SQMCI_s scores for each site.

The MCI is a measure of the overall sensitivity of the macroinvertebrate community to the effects of organic pollution in stony streams. It is based on the presence/absence of taxa with varying degrees of sensitivity to environmental conditions. The SQMCI_s takes into account taxa abundance as well as sensitivity to pollution, and may reveal more subtle changes in communities, particularly if non-organic impacts are occurring. Significant differences in either the MCI or the SQMCI_s between sites indicate the degree of adverse effects (if any) of the discharges being monitored.

The survey was the fourth to follow full commissioning of the Kapuni Water Treatment Plant. The new discharge point is now located just upstream of the Skeet Road bridge, and the sampling sites were consequently changed, to enable monitoring of this new location. Site 1 has an extensive historical dataset, as a result of monitoring undertaken in relation to the Vector Kapuni and Ballance Agri-Nutrients Kapuni Ltd sites, located upstream. This dataset can also be used as a reference for site 2 (KPN000301), until a suitable data record has been established here. It should be noted however, that the monitoring undertaken in relation to the Vector Kapuni and Ballance Agri-Nutrients

Kapuni Ltd sites is done so using slightly different methodology, which has the potential to produce lower taxa richness and higher MCI scores.

This late summer macroinvertebrate survey indicated that there were only relatively subtle differences between site 1, upstream of the discharge point, and site 2, downstream of the discharge point. There is no evidence to suggest that the discharge of filter backwash and settling tank sediment had resulted in an impact on the macroinvertebrate communities of the Kapuni Stream. This is supported by the MCI score recorded downstream of the discharge being higher than the median score for the upstream site, that recorded during the previous two surveys, though not statistically so.

The macroinvertebrate communities of the Kapuni Stream contained significant proportions of 'sensitive' taxa at both sites and the communities were generally dominated by 'sensitive' taxa. Taxonomic richness (number of taxa) was high at the control site 1 and decreased only slightly at site 2 downstream of the discharge, although there were some changes in the presence/absence of a few taxa found as rarities (less than 5 individuals). Both sites recorded above average MCI scores. An insignificant change in the MCI value between sites was a result of some subtle differences in taxa presence/absence. The SQMCI_s values were similar between sites, reflective of the similarity in dominant taxa.

The full biomonitoring report is attached in Appendix II.

2.3.2 Waimate West WTP macroinvertebrate survey (Mangawhero-iti)

Macroinvertebrate sampling was undertaken in spring (15 November 2013) and summer (5 February 2014), at four sites in the Mangawhero-iti Stream; a control site upstream of the intake weir (1), a primary impact site approximately 40 metres downstream of the intake weir (2), a secondary impact site 3 kilometres downstream of that intake and a tertiary impact site approximately 5.6 kilometres downstream of the intake and 340 metres upstream of the confluence with the Mangawhero Stream. Sampling was performed at all four sites using the 'kick' sampling technique, a standard sampling technique used by the Council. This was undertaken to assess whether the abstraction of water from the Mangawhero-iti Stream for the WWSS had had any adverse effects on the macroinvertebrate communities of this stream. Samples were processed to provide number of taxa (richness), MCI and SQMCI_s scores for each site.

The MCI is a measure of the overall sensitivity of the macroinvertebrate community to the effects of organic pollution in stony streams. It is based on the presence/absence of taxa with varying degrees of sensitivity to environmental conditions. The SQMCI_s takes into account taxa abundance as well as sensitivity to pollution, and may reveal more subtle changes in communities, particularly if non-organic impacts are occurring. Significant differences in the MCI or the SQMCI_s between sites indicate the degree of adverse effects (if any) of the activity monitored.

Surveys undertaken in late spring and in summer did not indicate that the water abstraction for the WWSS from the Mangawhero-iti Stream had significantly affected the freshwater macroinvertebrate communities immediately downstream of the abstraction point. Relatively high MCI and SQMCI_s scores were recorded at the

upstream control site (1) in both spring and summer. These scores were relatively similar although better than those recorded at site 2, located approximately 40 metres downstream of the water take. Typically there was a marked decline in MCI score between sites 2 and 3 in both the spring and summer surveys, although during spring the SQMCI_s score at site 3 remained relatively high due to increased numerical abundances within some 'sensitive' taxa. In the spring survey it was noted that these typical trends continued coincidental with the extremely rich community recorded at site 3 (45 taxa); the highest richness recorded at any site on the Taranaki ringplain or anywhere else in the region to date (TRC, 1999 (updated, 2013)).

The results of the surveys showed a significant decline in the macroinvertebrate communities in the reaches between sites 1 and 4 (spring and summer), and sites 2 and 3, and sites 3 and 4 (spring), where the MCI rates of decline were significantly higher than predicted. This was consistent with a general trend of increasing water temperature and decreasing physicochemical water quality with decreasing altitude in ringplain streams in the region coincident with point and non-point source discharges within such reaches. Abstraction of water from the Mangawhero-iti Stream may exacerbate the decline in macroinvertebrate 'health' by reducing available dilution of such discharges particularly as cumulative impacts occur in a downstream direction.

The full biomonitoring report is attached in Appendix II.

2.3.3 Cold Creek macroinvertebrate survey

On 15 January 2014, the Council's standard 'kick-sampling' technique was used at three established sites to collect streambed macroinvertebrates from the Cold Stream. Samples were sorted and identified to provide number of taxa (richness) and MCI and SQMCI_s scores for each site.

The MCI is a measure of the overall sensitivity of the macroinvertebrate community to the effects of organic pollution in stony streams. It is based on the presence/absence of taxa with varying degrees of sensitivity to environmental conditions. The SQMCI_s takes into account taxa abundance as well as sensitivity to pollution, and may reveal more subtle changes in communities, particularly if non-organic impacts are occurring.

Significant differences in either the MCI or SQMCI_s between sites may indicate the degree of adverse effects (if any) of the discharges being monitored.

This summer macroinvertebrate survey following a period of low flow stream conditions indicated that there were no effects of water abstraction on the macroinvertebrate communities' compositions downstream of the intake and no effects downstream beyond the designated mixing zone for the backwash discharge where no major changes in individual taxon abundances were recorded (resulting in only a very small decrease in SQMCI_s) and generally similar community assemblages were found through the stream reach surveyed. There were no measurable effects coincident with fording of the stream through the downstream reach.

In general, the macroinvertebrate communities of the Cold Stream contained high proportions of 'sensitive' taxa at all sites and the communities were generally dominated more by 'sensitive' taxa. Taxonomic richnesses (numbers of taxa) were

similar to those recorded by the four previous surveys conducted during the past sixteen years, although slightly lower than historical medians at two of the three sites.

MCI scores indicated that the stream communities were of 'good' to 'very good' health and typical of conditions recorded in similar Taranaki rivers, with minimal differences in the numerical abundances of the characteristic taxa accounting for the similarity in the SQMCI_s values over the fenced reach of the stream adjacent to and downstream of the water intake. No marked differences in numerical taxon abundances resulted in no significant reduction in the SQMCI_s value downstream of the WTP backwash discharge over a short reach (where fording of the stream had impacted on the biological communities in past surveys). This reach has benefited from recent riparian fencing and planting initiatives.

The full biomonitoring report is attached in Appendix II.

2.3.4 Hawera WTP fish survey (Kapuni)

A four site fish survey was undertaken in the Kapuni Stream on 16 January 2014, in order to determine whether the water intake structure on the bed of the Kapuni Stream effectively provided for fish passage. The fish communities were surveyed using the electric fishing technique, with all fish identified where possible, counted, and lengths estimated. It should be noted that fish migration in the Kapuni Stream may be impeded by other structures, including the railway weir, located approximately 900 m downstream of the STDC weir.

There are three primary aspects to monitoring fish communities in order to determine whether passage is provided for at a structure:

- Is there evidence of fish accrual below the structure?
- Is there a significant difference in species richness when comparing upstream and downstream communities?
- Is the size structure of the upstream communities indicative of an actively recruiting population?

Five fish species were recorded during the survey, being longfin and shortfin eel, redfin bully, koaro and brown trout. Redfin bully were recorded in relatively low abundance, possibly reflecting the impact of the railway weir.

All five species were recorded upstream of the intake weir, although the two sites closest to the national park only contained two migratory species (longfin eels and koaro). In addition, although the highest fish abundance was recorded immediately downstream of the weir, this is considered to be a reflection of habitat variation, rather than fish accrual. This is because the majority of fish recorded at this site were eels, which would easily negotiate the weir. Juvenile koaro and small eels were recorded upstream of the weir, including close to the National Park. This indicates that these species are actively recruiting. Unfortunately, due to the low numbers of redfin bully recorded during this survey, few conclusions can be made about the passage of this species. However, recent improvements made to fish passage at the railway weir may result in improved redfin bully abundance near the intake weir during future surveys.

Overall, it is considered that there is no evidence indicating that the STDC water intake structure is impeding fish passage in the Kapuni Stream.

The full fish survey report is attached in Appendix II.

2.4 Hydrological monitoring

Hydrological gaugings were undertaken by Council staff in the Mangawhero-iti and Cold Creek streams during the monitoring period, as described in Table 5 below.

Table 5 Hydrological gaugings undertaken during the monitoring period

Site	Date	Time	Flow (L/s)
Mangawhero-iti (above weir)	12-Sep-13	11:34	256
	1-Oct-13	13:25	635
	22-Oct-13	11:31	340
	19-Dec-13	09:55	1126
	4-Mar-14	11:54	265
	19 May-14	11:00	230
Cold Creek	10-Dec-13	13:59	257
	18-Feb-14	09:47	234
	24-Feb-14	12:20	207

2.5 Abstraction data

As a condition of their various resource consents to abstract water, STDC, CCWSL, OWSL and NWSSI are required to record measurements of abstraction volumes for each site and this data is to be provided to the Council on request. This data was forwarded as requested to the Council during the 2013-2014 period and is discussed below. Most consents require that daily abstraction volume data be supplied, however newer consents require 15 minute abstraction rate data to be supplied. Compliance is assessed on the type of data that is required to be provided by consent conditions.

2.5.1 Cold Creek water supply

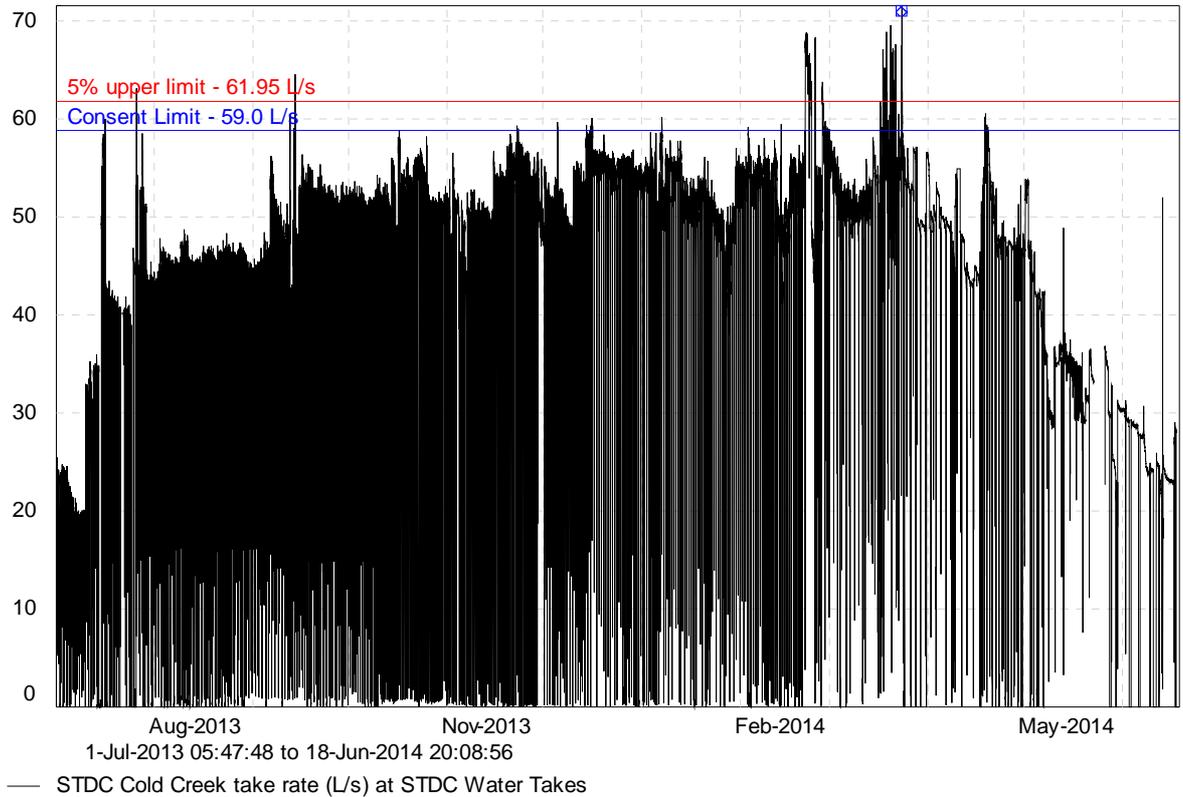


Figure 4 Graph of the daily abstraction for the Cold Creek water supply (L/s)

Consent 1134 sets a maximum abstraction rate of 59 L/s which was exceeded during the monitoring period (Figure 4). There was a short period of missing in March 2014 where powers source issues were causing erroneous data to be sent to Council, the consent holder addressed this and supplied operational data to show that abstractions were below the 59 L/s limit during this interruption. Non compliances shown on the graphs are discussed in the Incidents section 2.6.

2.5.2 Eltham water supply

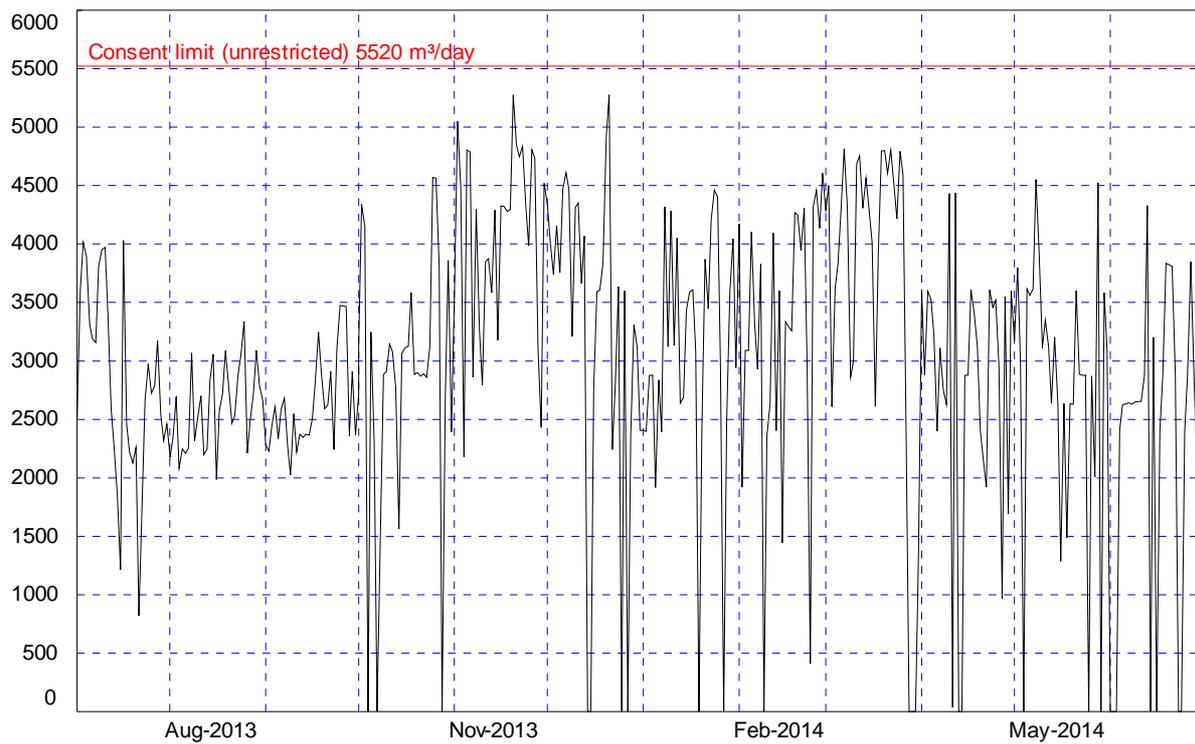


Figure 5 Graph of the daily abstraction for the Eltham water supply (m^3/day)

The maximum daily abstraction from the Waingongoro River was 5,277 m^3 , which complied with the restricted consent limit of 5,520 m^3/day (Figure 5).

2.5.3 Hawera water supply

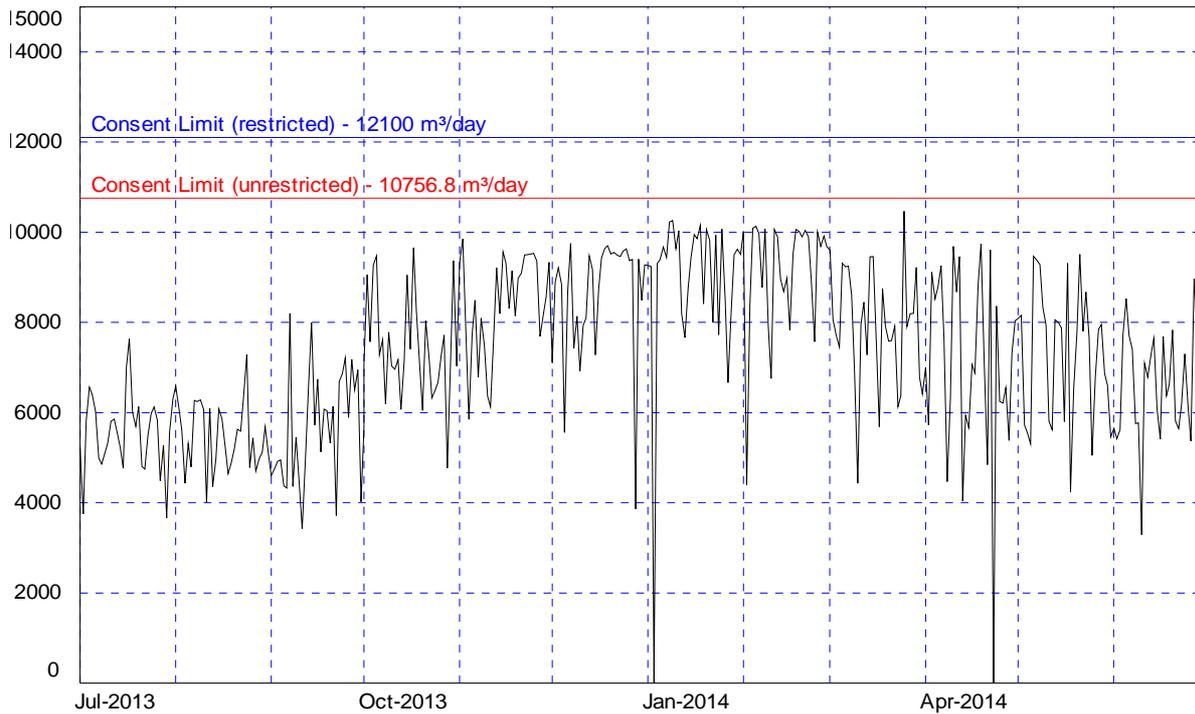


Figure 6 Graph of the daily abstraction for the Hawera water supply (m^3/day) from the Kapuni Stream

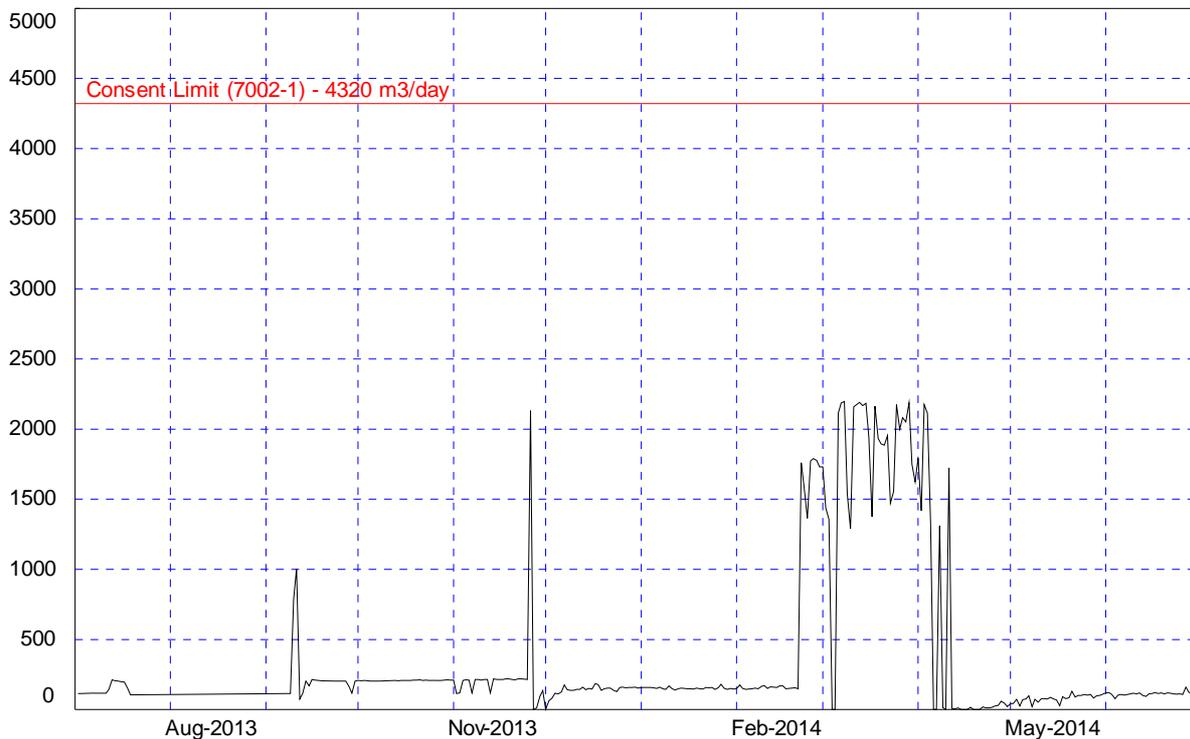


Figure 7 Graph of the daily abstraction from the Kapuni bore (m^3/day)

The maximum daily abstraction from the Kapuni Stream was $10,461 \text{ m}^3$, which complied with the consent limit of $10,756 \text{ m}^3/\text{day}$ (Figure 6).

Abstractions from the bore at the Kapuni WTP were well within the consent limit of 4,320 m³/day (Figure 7).

2.5.4 Inaha water supply

The Inaha water supply system abstracts water from the Waingongoro River and the Mangatoki Stream. There is one gravity-fed abstraction on both streams, along with a pumped abstraction on the Mangatoki Stream for use when the gravity fed amount is insufficient. Water surplus to requirements flows back into the Mangatoki Stream (regardless of which stream it is initially collected from).

There was one slightly high reading of 2,598 m³/day in April 2014 from the Waingongoro River (consent 1186-3 limit 2,592 m³/day), however this falls within the +/- 5% accuracy of the water meter and as such is not considered to be a breach (Figure 8).

Abstractions from the Mangatoki Stream are reported as one figure and therefore compliance with the individual consents could not be assessed. The maximum daily abstraction for the combined Mangatoki Stream takes was within the combined consent limit of 2,504 m³/day (Figure 9). As of May 2014 the two consents (5364-1 and 1185-3) have been combined into one consent (1185-3).

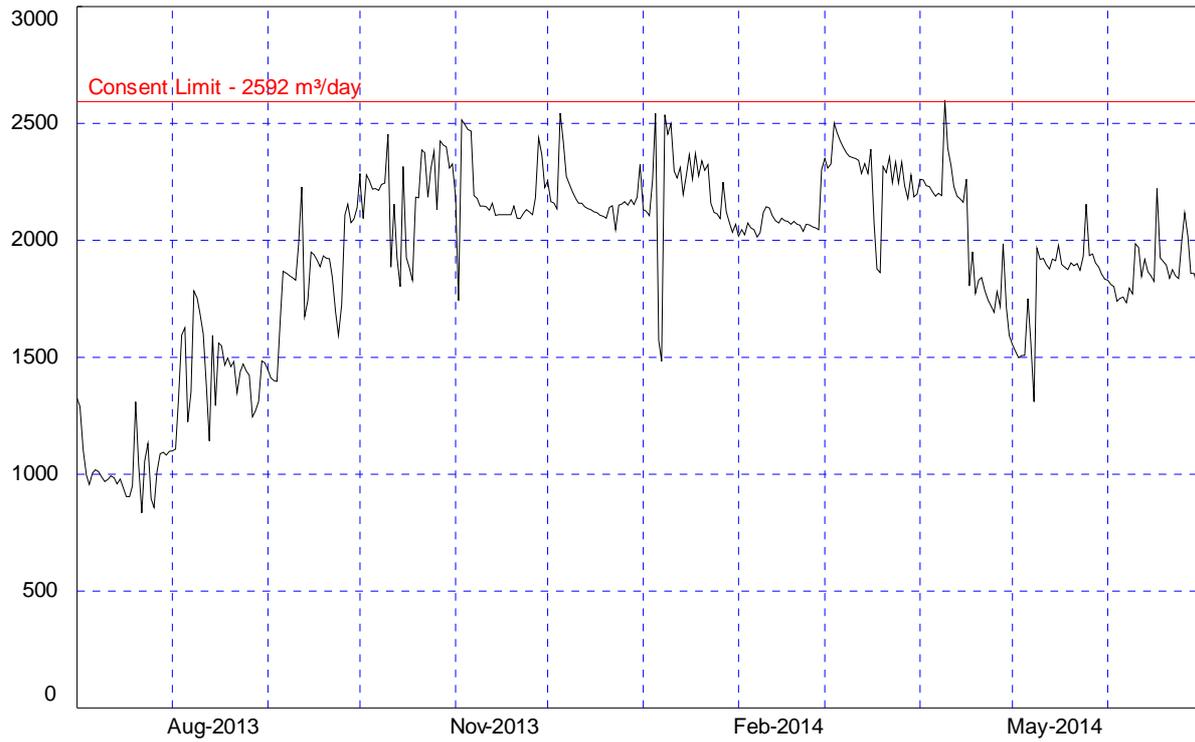


Figure 8 Graph of the daily abstraction from the Waingongoro River for the Inaha water supply (m^3/day)

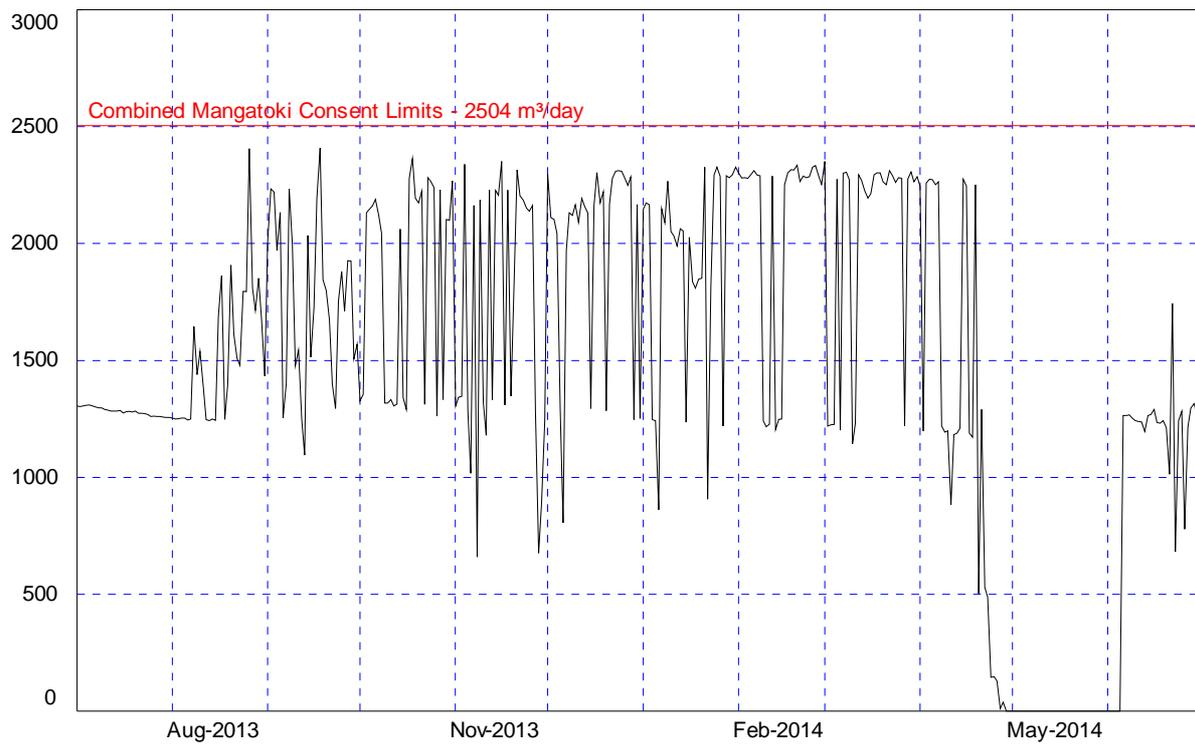


Figure 9 Graph of the daily combined abstraction from the Mangatoki Stream for the Inaha water supply

2.5.5 Opunake water supply

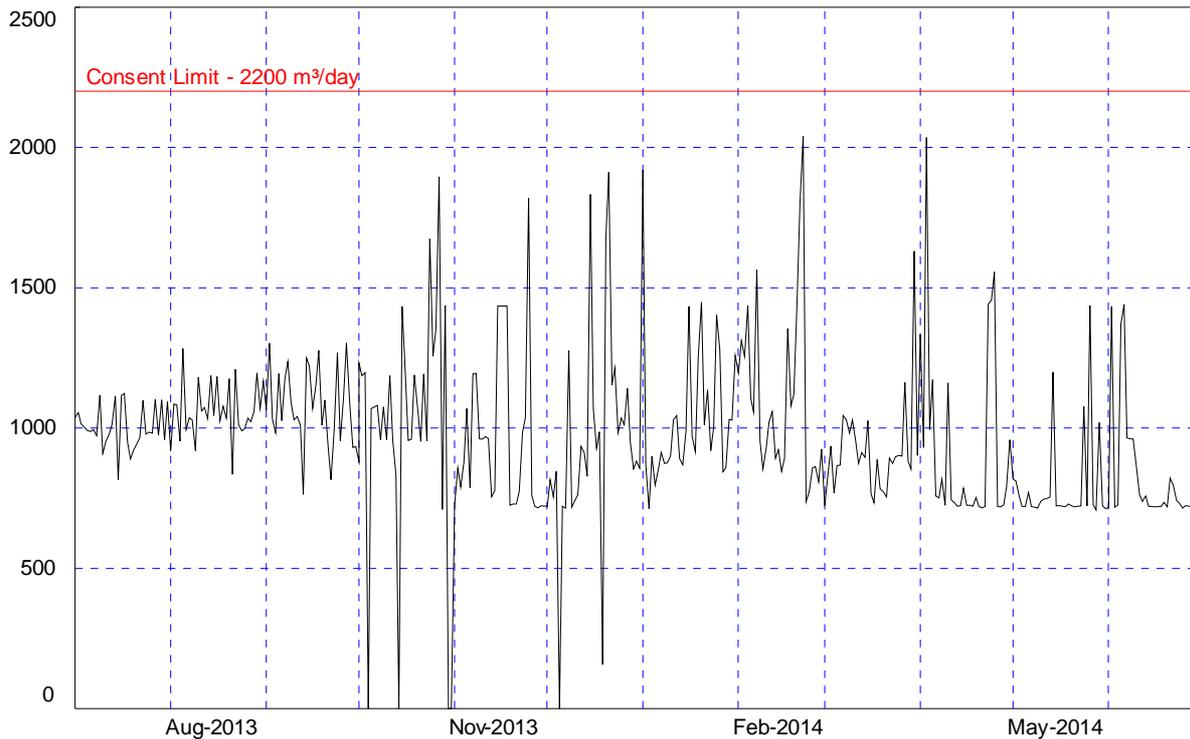


Figure 10 Graph of the daily abstraction for the Opunake water supply

The daily abstraction was within the consented limit of 2,200 m³/day throughout the monitoring period (Figure 10). The rate of take slightly exceeded 25.5 L/s on one occasion, but as this was within the 5% accuracy of the meter it is not considered as a breach of consent.

2.5.6 Patea water supply

All three bores that are used at the Patea WTP are covered by consent 3388. The consent holder is required to comply with a combined daily abstraction volume of 1,125 m³/day. The combined limit was complied with, with a maximum combined daily volume of 1,097 m³ (Figure 11).

The analysis of abstraction rates for the individual bores and the level of compliance are given in Table 6 below. The abstraction from Bores 1 and 2 were well below the consent limits. Bore 4 complied with the consented take of 10 L/s over 99% of the time.

Table 6 Compliance with abstraction rates at the Patea bores

Bore No.	Consent Limit	% Compliance with 15 minute averages	Highest rate of take found in 15 minute data
1	4.7 L/s	100%	3.13 L/s
2	3.9 L/s	100%	2.96 L/s
4	10 L/s	>99%	21.11 L/s

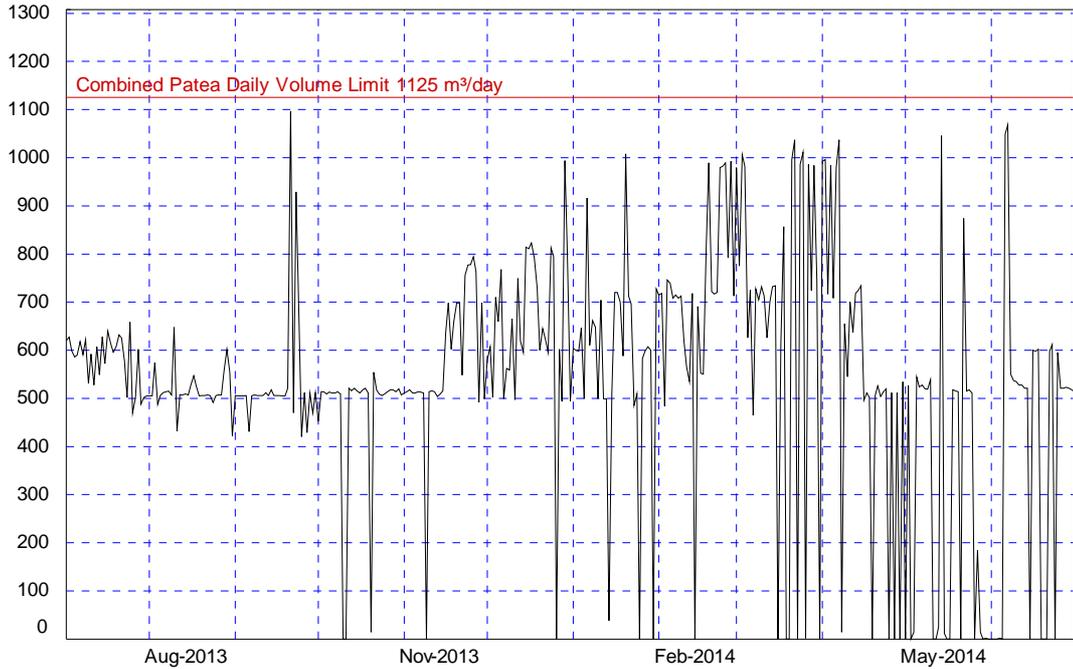


Figure 11 Graph showing combined daily abstractions from the Patea groundwater bores

2.5.7 Rahoitu water supply

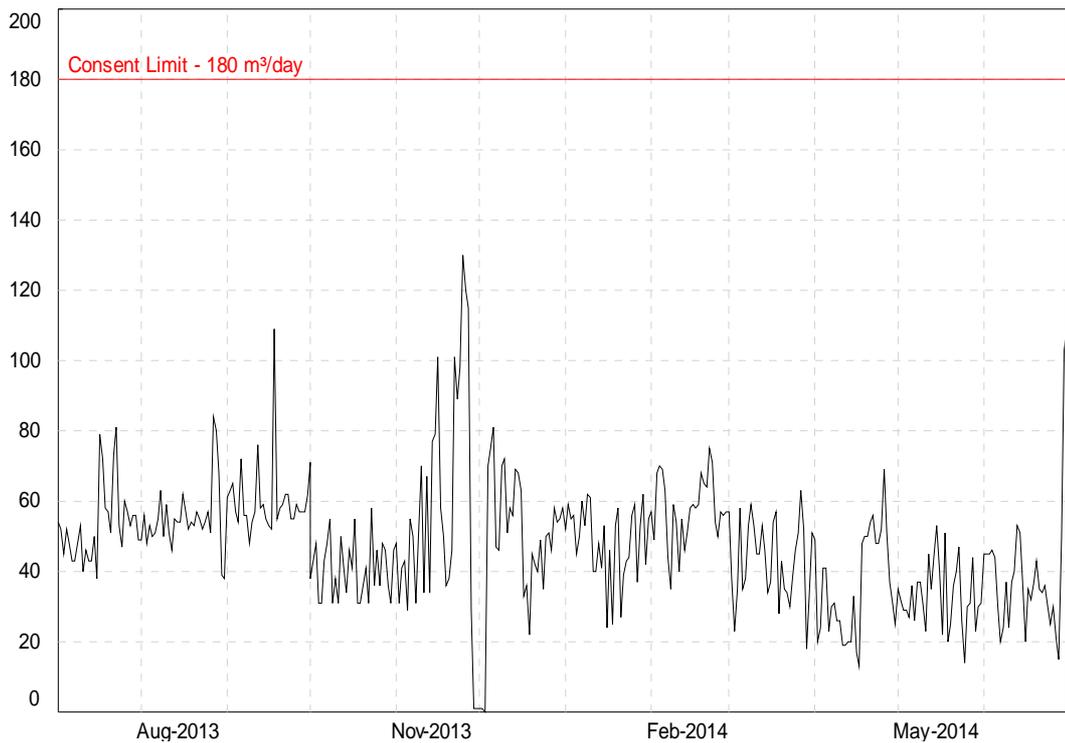


Figure 12 Graph of the abstraction for the Rahoitu water supply (m³/day)

Daily volumes complied with the 180 m³ limit (Figure 12). Analysis of the abstraction data showed that the abstraction rate of 3.0 L/s was complied >99% of the time. Most non-compliant data was the result of erroneous data sent during plant commissioning.

2.5.8 Wai-inu Beach water supply

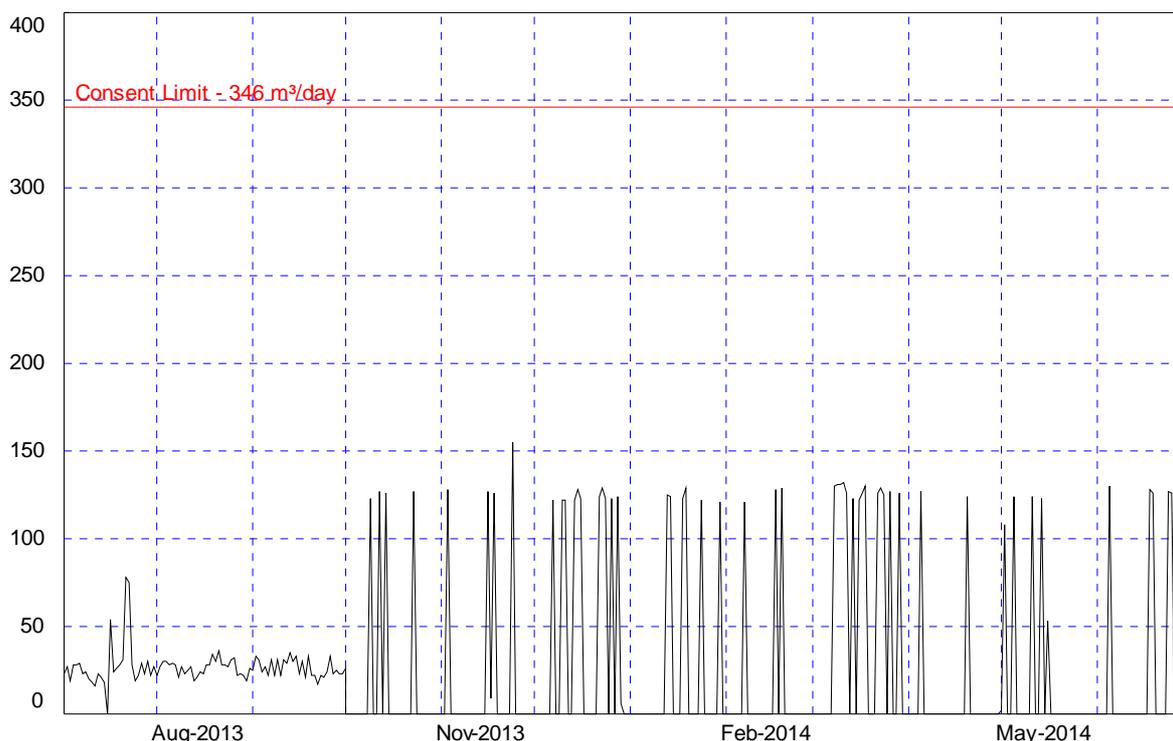


Figure 13 Graph of daily abstractions for the Wai-inu Beach water supply (m^3/day)

The maximum daily abstraction from the bore was 155 m^3 , which was well within the daily consent limit of $346 \text{ m}^3/\text{day}$ (Figure 13).

2.5.9 Waimate West water supply

There are three individual takes for the Waimate West scheme:

- The Mangawhero-iti take directly supplies the Waimate West plant
- The Otakeho take supplies both the Waimate West plant and the Pope WTP
- The Mangawhero take is a contingency used to top-up the Mangawhero-iti Stream during periods of low flow.

The consents for the abstractions from the Mangawhero-iti and Otakeho Streams (consents 0634 and 3911) require that 15 minute abstraction data be telemetered to the Council every two hours. Currently this only occurs with the Mangawhero-iti when the telemetered data starting coming in on 5 September 2012.

Table 7 shows the compliance of the abstractions with consents **0634**, **0635** and **3911**.

Table 7 Compliance with consents 0634, 0635 and 3911

Water take	Consent Limit	% Compliance with 15 minute averages	Highest rate of take found in 15 minute data
Mangawhero-iti	121 L/s	>99%	176 L/s
Otakeho	85 L/s	100%	84 L/s
Mangawhero	70 L/s	>99%	83 L/s


**Figure 14** Mangawhero-iti rate of abstraction (L/s)

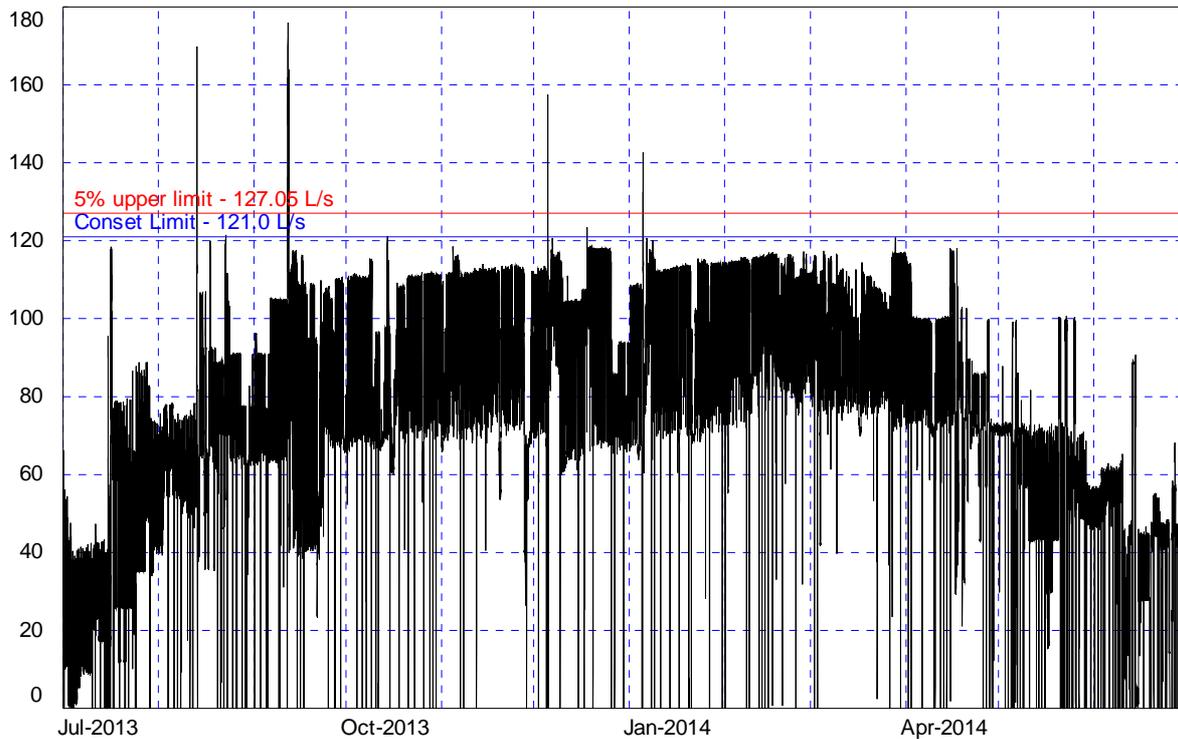Figure 14 shows the rate of take from the Mangawhero-iti exceeded the 121 L/s on several occasions in September, however this was due to air being drawn into the flow meter and the actual water intake was between 97 – 117 L/s. This is discussed further in section 2.6 below.

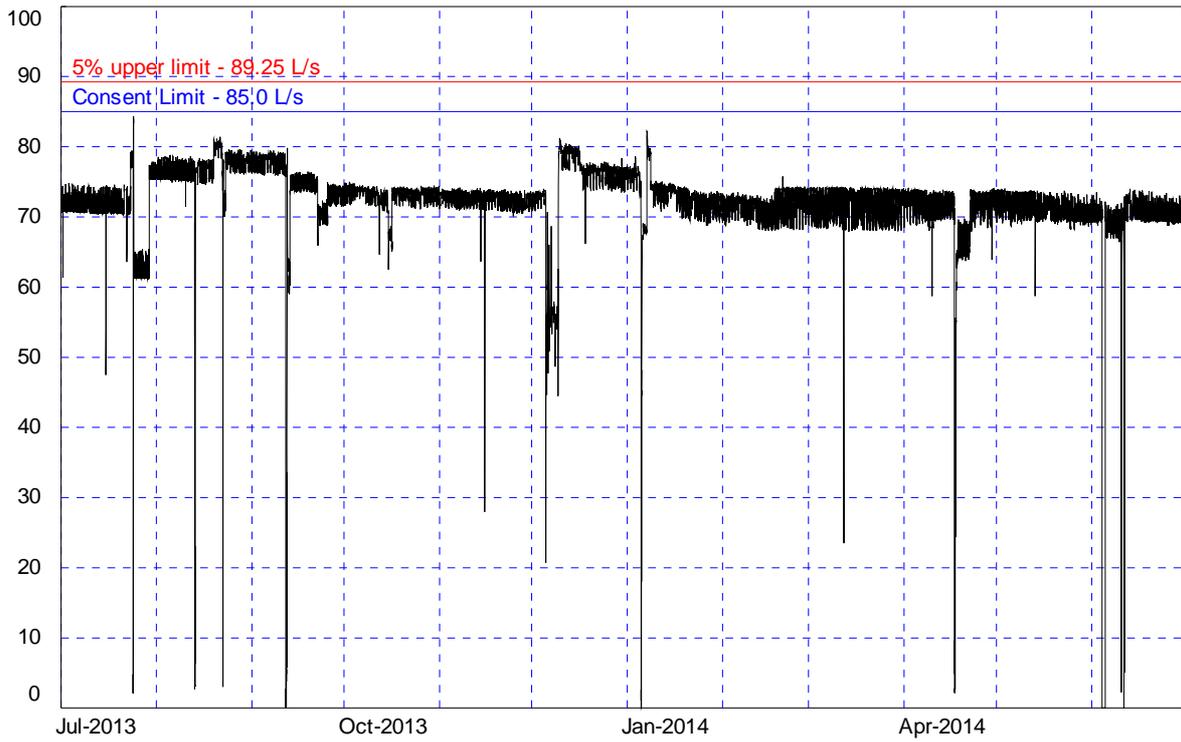


Figure 15 Otakeho rate of abstraction (L/s)

The rate of abstraction from the Otakeho Stream was below the consent limit of 85 L/s at all times during the monitoring period (Figure 15).

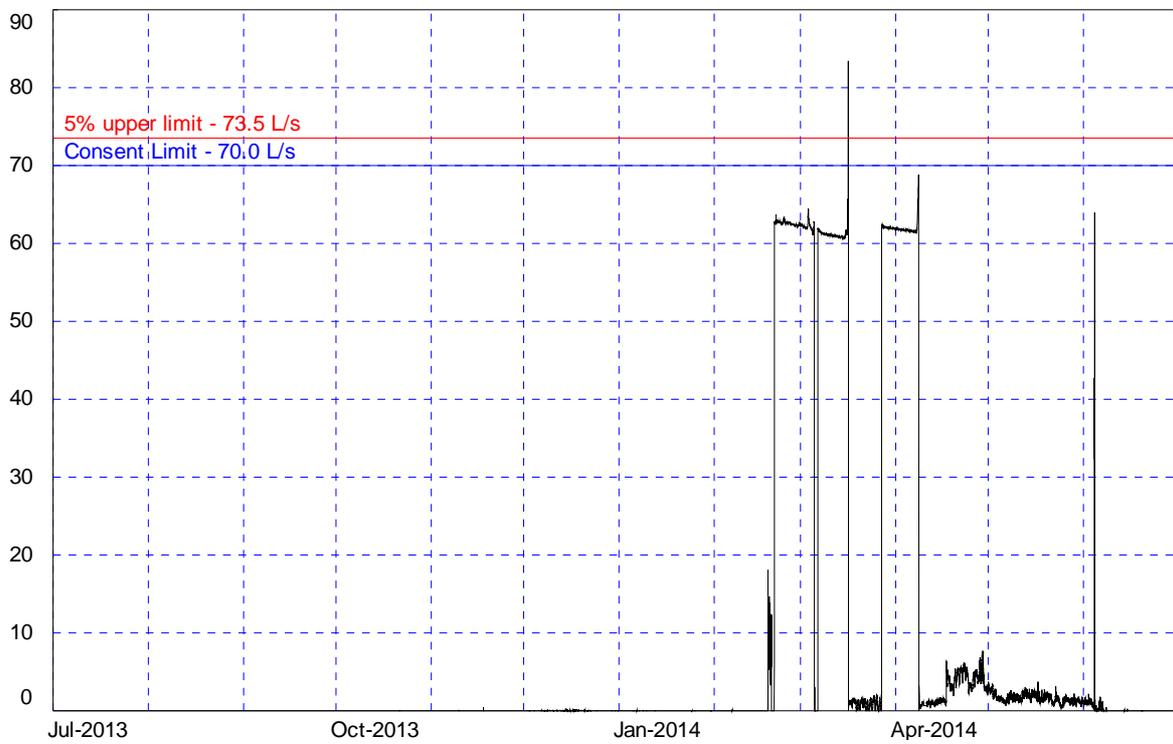


Figure 16 Mangawhero rate of abstraction (L/s)

The rate of abstraction from the Mangawhero Stream was mostly below the 70 L/s required by consent conditions, with just one exceedance during the monitoring period (83 L/s) (Figure 16).

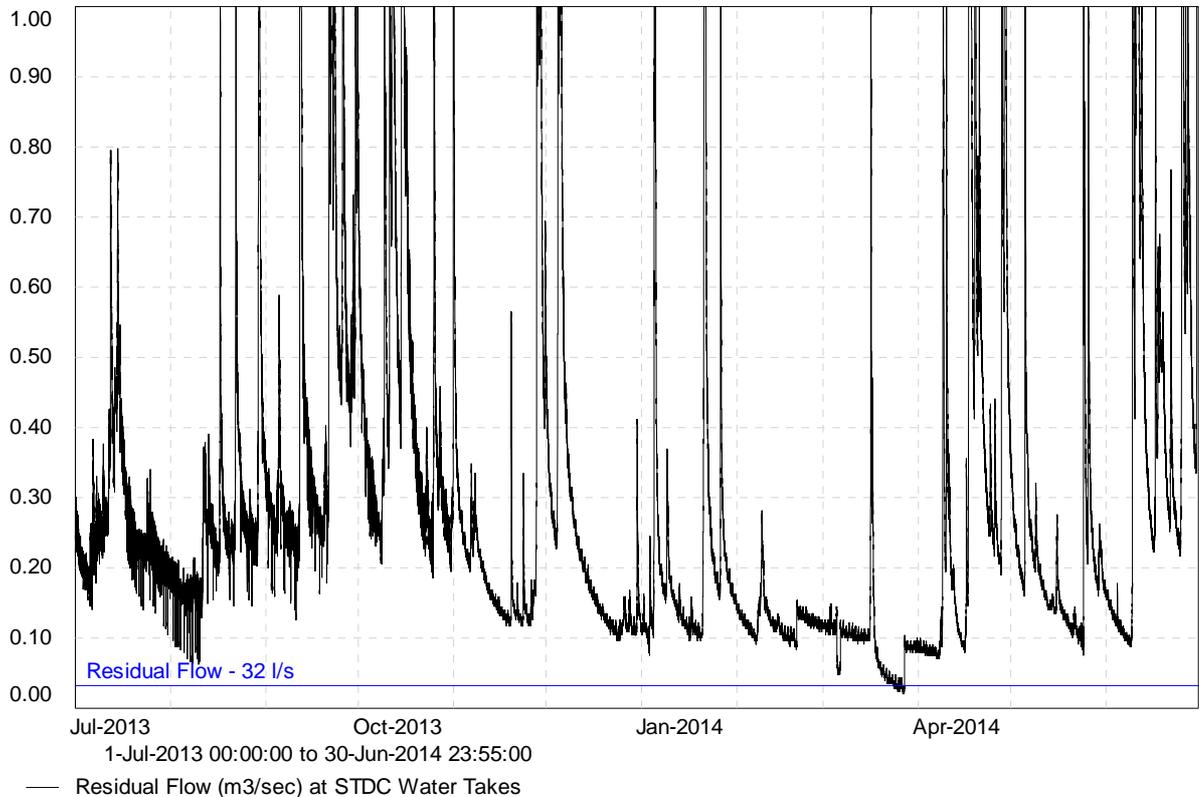


Figure 17 Residual flow in the Mangawhero-iti Stream


Consent 0634 also requires that a residual flow of 32 L/s be maintained in the Mangawhero-iti Stream below the intake. Figure 17 shows that there was a short period of non-compliance due to drought conditions, which was rectified by exercising consent 0635 (taking from the Mangawhero). The compliance rate for the residual flow was >99% over the duration of the monitoring year.

2.5.10 Waverley water supply

Consent 3313 has instantaneous abstraction for each of the three bores and the consent holder is required to provide 15 minute data. This data is analysed in Table 8 below. Consent 3313 also sets a limit of daily abstraction volumes for each bore and this data is illustrated in Figures 18, 19 and 20.

Table 8 Compliance with abstraction rates at the Waverley bores

Bore	Consent Limit (L/s)	% Compliance with 15 minute averages	Consent limit (m ³ /day)	%compliance with daily total
Chester St	7.0	100	400	100
Fookes St	7.2	100	500	100
Swinbourne St	10.3	100	890	100

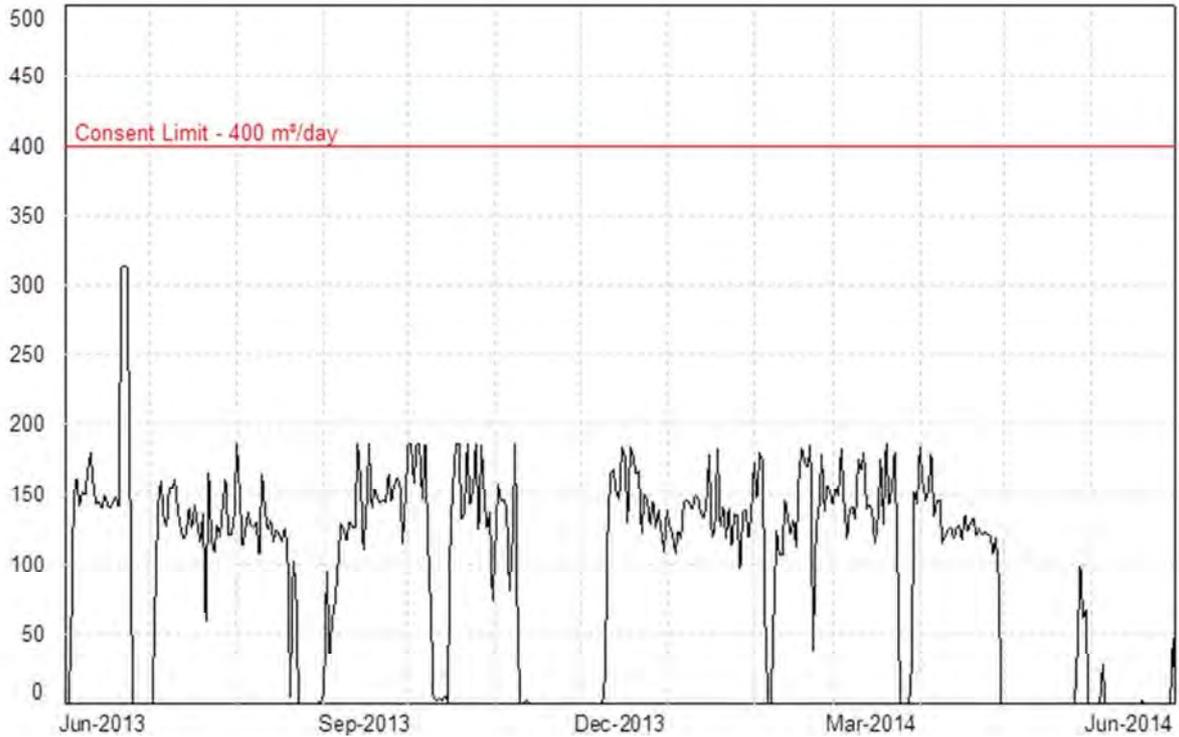**Figure 18** Graph of daily abstractions from the Chester Street bore

Abstractions from the Chester Street bore complied with the consent limit of 400 m³/day (Figure 18).

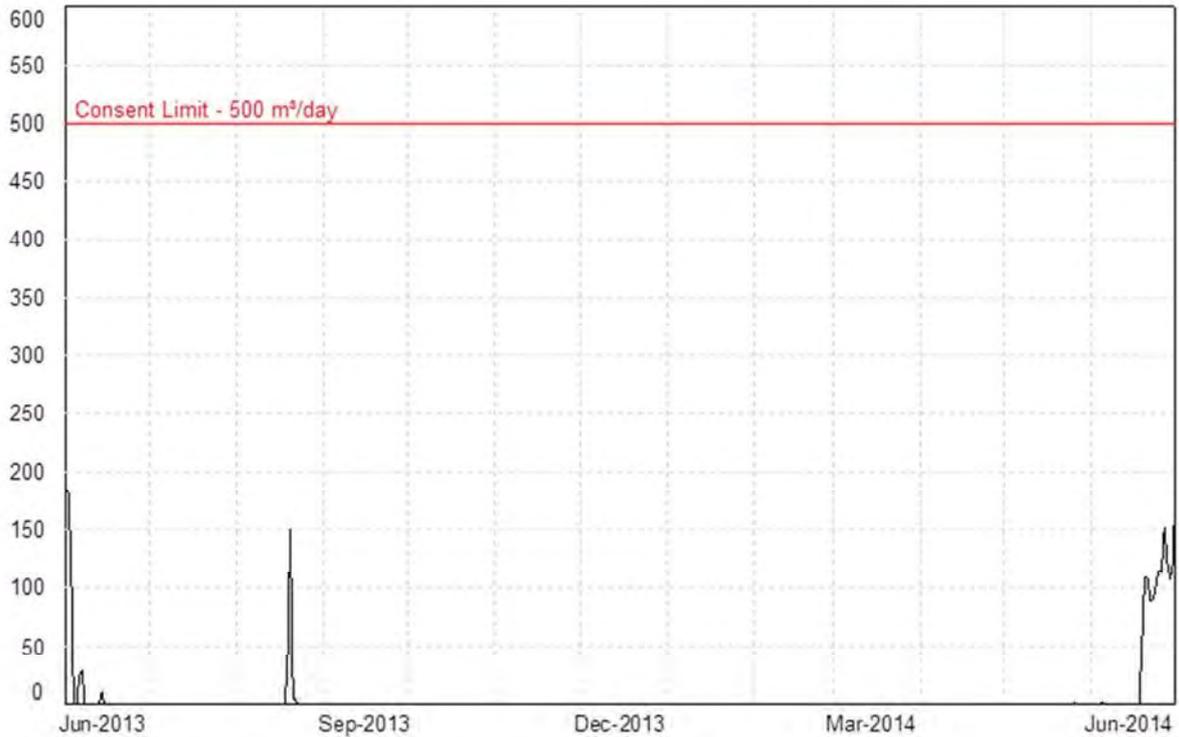


Figure 19 Graph of the daily abstraction from the Fookes Street bore (m^3/day)

Abstractions from the Fookes Street bore were well within the consent limit of 500 m^3/day (Figure 19).

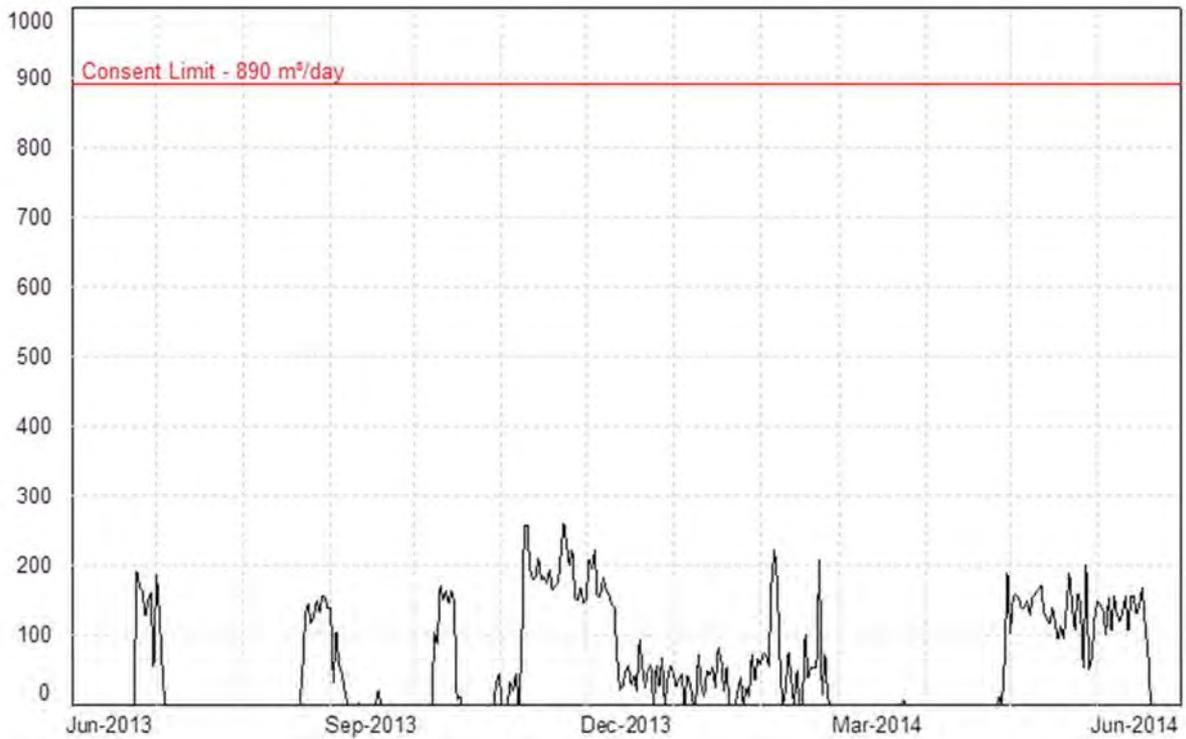


Figure 20 Graph of the daily abstraction from the Swinbourne Street bore (m^3/day)

Abstractions from the Swinbourne Street complied with the consent limit of 890 m^3/day (Figure 20).

2.5.11 Waverley Beach water supply

Permitted activity rule 46 allows a daily abstraction from Bore 1 of up to 50 m³ at 1.5 L/s. Figure 21 shows that the abstraction rate was well below the allowable limit. Consent 9563-1 bore allows abstractions of up to 80 m³ / day at 1.5 L/s and this was not exercised due to taste and odour issues.

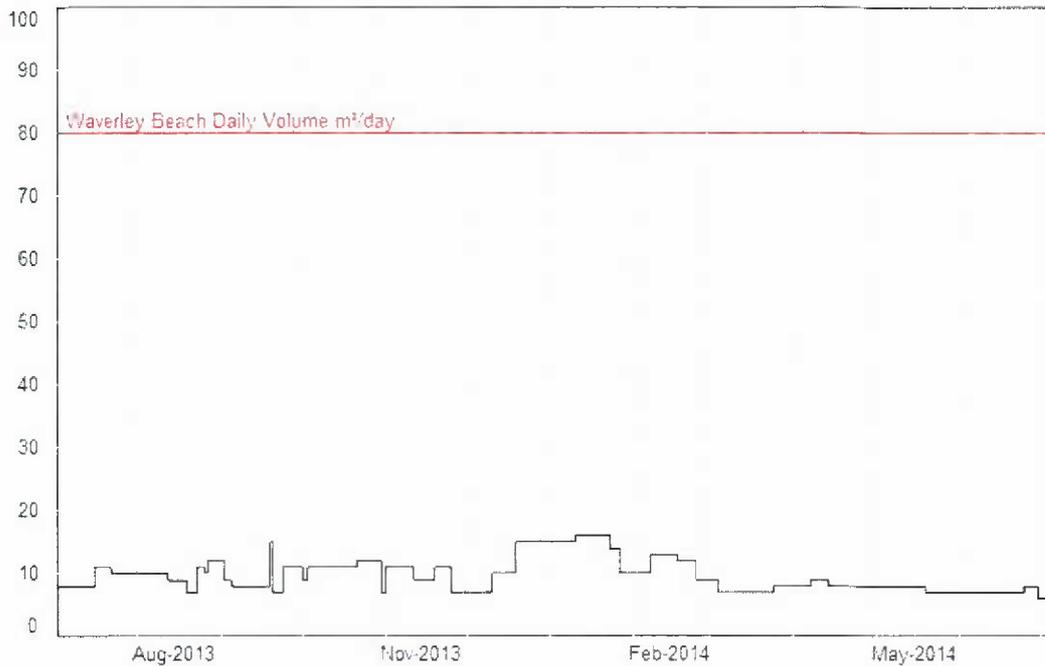


Figure 21 Graph of the average daily abstraction from the Waverley Beach bore

2.5.12 Oaonui water supply

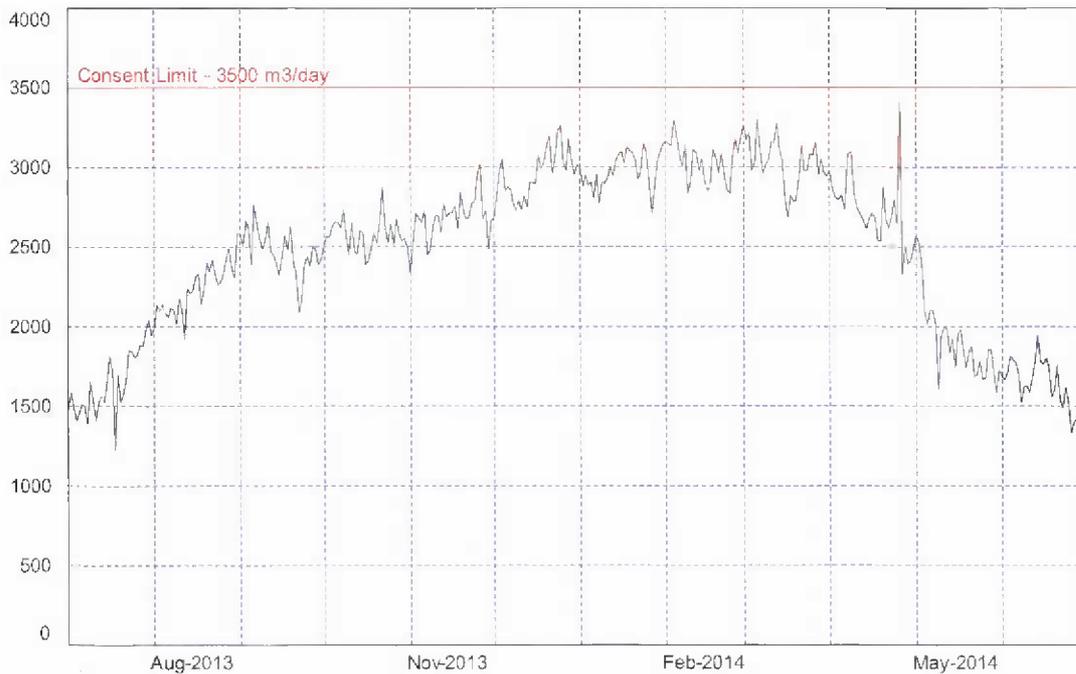


Figure 22 Graph of the daily abstraction from the Oaonui Stream for the Oaonui water supply (m³/day)

The consent limit of 3,500 m³/day was complied with throughout the monitoring period (Figure 22). Abstraction data for the Nukumaru scheme was recorded manually every one to two weeks. The consent limit of 605 m³/day was complied with (Figure 23).

2.5.13 Nukumaru water supply

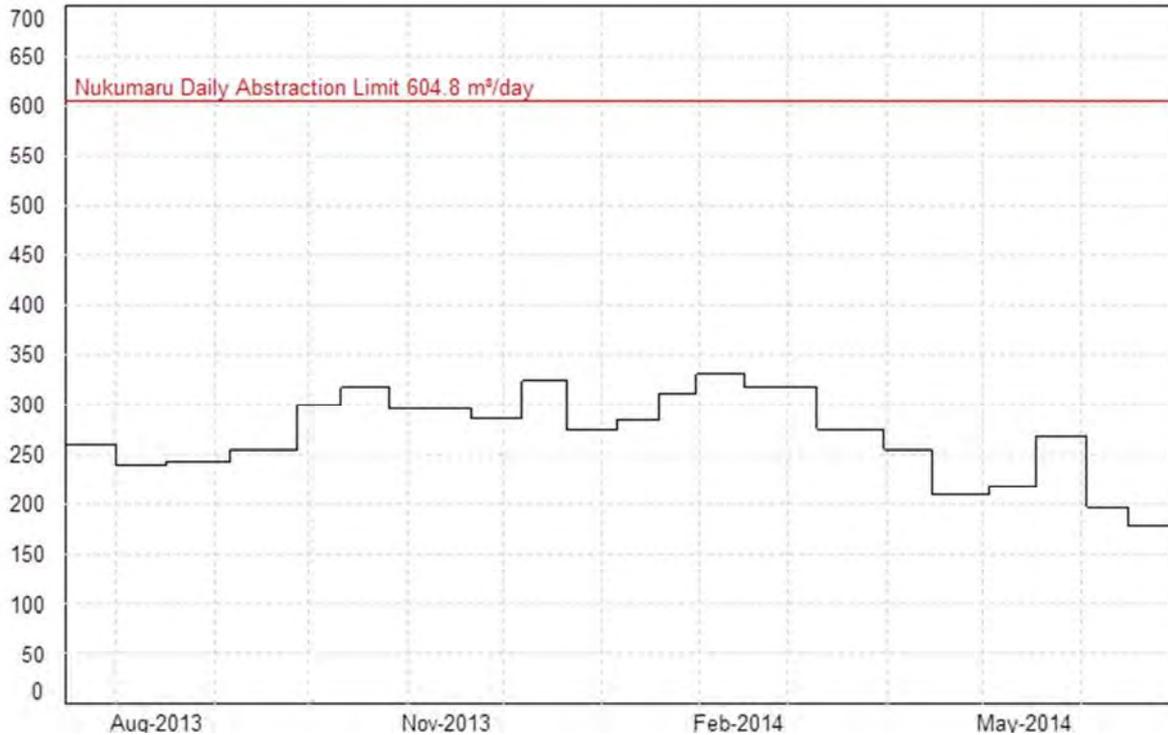


Figure 23 Graph of the average daily abstraction for the Nukumaru water supply

2.6 Investigations, interventions, and incidents

The monitoring programme for the year was based on what was considered to be an appropriate level of monitoring, review of data, and liaison with the consent holder. During the year matters may arise which require additional activity by the Council, for example provision of advice and information, or investigation of potential or actual courses of non-compliance or failure to maintain good practices. A pro-active approach that in the first instance avoids issues occurring is favoured.

The Council operates and maintains a register of all complaints or reported and discovered excursions from acceptable limits and practices, including non-compliance with consents, which may damage the environment. The Unauthorised Incident Register (UIR) includes events where the company concerned has itself notified the Council. The register contains details of any investigation and corrective action taken.

Complaints may be alleged to be associated with a particular site. If there is potentially an issue of legal liability, the Council must be able to prove by investigation that the identified company is indeed the source of the incident (or that the allegation cannot be proven).

In the 2013-2014 period, the Council was required to undertake significant additional investigations and interventions, or record incidents, in association with South Taranaki water supplies' conditions in resource consents or provisions in Regional Plans.

Patea water supply

6 June 2014

Two minor exceedances on the fifteen minute data from bore 4 on the 4th and 6th June 2015 were noted during a routine review. The consent holder was contacted and explained that a test abstraction to supply from bore 5 had caused fluctuations in the bore 4 abstraction via hydraulic effects and that after the test was concluded all settings and alarms were reset to ensure there was no repeat.

20 December 2014

During a routine review of data it was found that there had repeated short term exceedances during the period from September 2014 to December 2014. A fourteen day letter requesting an explanation was issued and the explanation received was accepted. It was outlined that exceedances were mostly a result of pump starts causing surges of water velocity in the riser and then in the meter. Further controls were being investigated by the consent holder.

Rahotu WTP

14 January 2014

During analysis of abstraction data it was found that the water take rate of 3 L/s, as per consent 3696-3, had been exceeded on several occasions in early December 2013. STDC were advised of this and undertook to remedy the situation. Further analysis of the data in early January 2014 found that the contraventions had continued approximately every second day. STDC was sent a letter requesting an explanation.

Upon further investigation STDC discovered that the instrument data tags had changed during plant commissioning and that the reservoir outflow (rather than water abstraction) was being transmitted to the Council database. The data tag was corrected and the problem was resolved. The rate of take had not exceeded 2.2 L/s, which is the capacity of the raw water pumps (approximately 0.8 L/s less than allowed by the consent).

Waimate West WTP

17 September 2014

During analysis of telemetered data in relation to consent 0634-3, it was found that water abstraction rates may have been contravened at the Waimate west water treatment plant during September 2013. STDC were contacted and advised of the possible breach. STDC confirmed that the abstraction rate had been recorded as exceeded, however this was due to air being drawn through the Mangawhero-iti intake magnetic flow meter causing variable readings of up to 178 L/s being logged for the period. The WTP was actually operated at 97 to 117 L/s during the period and as such did not breach consent conditions. The explanation was accepted and no further action was undertaken.

29 September 2014

Self-notification was received concerning abstraction exceedances from the Mangawhero-iti Stream at the Waimate West Water Treatment plant. Investigation found that a failed logic card had resulted in breaches of water abstraction rate consent conditions on two occasions on 25 September 2013. A review of data showed that there was further breaches on 27 and 30 September 2014. A letter of explanation was received, explaining that during the commissioning of the new plant, control over abstractions rates was lost due to equipment failures and air entrainment. This explanation was accepted.

Cold Creek WTP**17 September 2013 (STDC)**

Self-notification was received from the consent holder concerning a breach of water abstraction volumes at the Cold Creek Community Water Supply. The breaches occurred on 12 and 14 September 2013. Consent 1134-3 allows a take rate of 212 m³/hour. On 12 September it was exceeded by up to 35 m³/hour for up to 73 minutes, while on 14 September it was exceeded by up to 5 m³/hour during a plant wash cycle. Explanations were received describing how flood conditions had caused air to accumulate in the intake line causing unstable flows. Works have been undertaken to prevent reoccurrence although air entrapment is something that will happen periodically with high flows. This will cause water to overshoot the weir, missing the intake screen.

20 December 2013 (STDC)

During analysis of telemetered data it was found that water take rates had been exceeded several times for the previous month, at the Cold Creek water treatment plant. Analysis found that the water rate of 59 L/s was being contravened several times each day for the previous month. STDC were advised of the breaches and they undertook to remedy the situation. Further analysis afterwards found that the contraventions were continuing in the New Year. A letter requesting explanation was sent. A response was received and it was accepted. The response outlined that air in the line and faulty electrical connections were most likely the cause and that works were being undertaken to rectify this.

21 February 2014 (CCWS)

Self-notification was received from Cold Creek Water Supply that they would be exceeding the consented abstraction rate for the purposes of filling the reservoir to undertake emergency repairs to the plant. Monitoring of telemetry showed that the extra abstraction rate was within the stated volume and that the residual flow conditions were not breached. Self notification was also received shortly after stating that the repairs had not been as successful as hoped and that the plant was now transmitting incorrect data. The consent holder applied for a variation to the resource consent 1134-3 to allow taking extra water as required by the emergency works provisions of the RMA.

15 June 2014 (CCWS)

Self notification was received that the process logic controller had failed at the Cold Creek Water Treatment Plant and that river level data and abstraction rate data was not being logged every 15 minutes as required by consent conditions. A follow up inspection was made and other non-compliances were noted. An abatement notice was issued and the works were undertaken by the consent holder to address non-compliances.

3. Discussion

3.1 Discussion of site performance

3.1.1 STDC WTP's

Older resource consents require that records of daily volumes of water abstracted are to be provided. Some of the newer consents require 15 minute abstraction rates to be telemetered. STDC has been very proactive in having all abstraction data for all consents telemetered to Council's database regardless of whether consent conditions require it or not. As the data is supplied in a raw form this can result in apparent non compliances as a result of various operational factors such as air being entrained in the flow meter due to pump starts, low water levels or blocked intakes. This has been a particular issue as new plants were being commissioned. Most incidents of over abstraction investigated during this period were of this nature and were over very short durations.

Intake structures were inspected and found to be in good condition and no issues with fish passage were noted.

Reports required by consents 0146-2, 0232-4, 0634-3, 1134-2, 1185-3, 1186-3 and 3696-3 on efficient water use, leak detection and repair were submitted to the Council.

Overall the performance of STDC's sites was good.

3.1.2 Cold Creek WTP

During the 2012-2013 period the Cold Creek WTP was handed back from STDC to the private operator, Cold Creek Water Supply Ltd (CCWS). There were some operational issues at the site that required the taking of extra water by CCWS and further issues in regard to the failure of electronics and power supply. CCWS was proactive in addressing all issues and generally the plant was well run. CCWS also telemeters all of its data to Council and most other instances of apparent exceedance were found to be operational artefacts such as a damaged power supply. One abatement notice was issued in regard to correcting such issues.

Most operational issues at the site have now been addressed and the plant now performs well.

3.1.3 Oaonui Water Supply

There were no exceedances in the daily volumes during the period and no issues were noted.

3.1.4 Nukumaru Water Supply

There were no exceedances in the daily volumes during the period however records were not provided in the time required by consent conditions.

Table 9 below summarises compliance in regards to abstraction rates and volumes and the provision of data.

Table 9 Summary of compliance in regards to abstraction rates, volumes and data

Plant	Source	Records Supplied on time?	Compliance with daily volumes	Compliance with abstraction rates
Cold Creek	Cold Creek	Yes	>98%	>99%
Eltham	Waingongoro	Yes	100%	100%
Hawera	Kapuni	Yes	100%	100%
	Kapuni bore	Yes	100%	100%
Inaha	Mangatoki	Yes	100%	n/a
	Waingongoro	Yes	100%	n/a
Opunake	Waiaua	Yes	100%	100%
Patea	Bore 1	Yes	100%	100%
	Bore 2	Yes		100%
	Bore 4	Yes		>99%
Rahotu	Pungaereere	Yes	100%	100%
Wai-inu	Wai-inu bore	Yes	100%	n/a
Waimate West	Mangawhero-iti	Yes	N/A	>99%
	Otakeho	Yes	N/A	100%
	Mangawhero	Yes	100%	>99%
Oaonui	Oaonui	Yes	100%	n/a
Nukumarū	Nukumarū bore	No	100%	n/a
Waverley	Chester St bore	Yes	100%	100%
	Fookes St bore	Yes	100%	100%
	Swinbourne St bore	Yes	100%	100%
	Combined take	Yes	100%	100%
Waverley Beach	Bore 2	Yes	100%	n/a

Key:

N/A= not applicable as consent does not specify a daily volume

n/a= not assessed as consents only require daily volumes be reported

3.2 Environmental effects of exercise of consents

Filter backwash discharge sampling was conducted at the Kapuni, Rahotu and Eltham WTPs. The results indicated that the discharges were not likely to be causing any adverse environmental effects. There was one high result for free available chlorine in the pond discharging into the Kapuni Stream at the Hawera WTP, however due to the very low rate of discharge and high rate of dilution, no effects were noted. A review of STDC's records and a follow up sample showed that this was the only non-compliant sample of the year.

None of the macroinvertebrate or fish surveys indicated any adverse effects occurring due to abstraction activities or related structures. Whilst there were several incidents in

regards to abstraction rates, the residual flows in the streams were not found to be compromised as result of abstraction breaches.

Overall the South Taranaki water supply consent holders demonstrated a high level of environmental performance.

3.3 Evaluation of performance

A tabular summary of the consent holder's compliance record for the year under review is set out in Tables 10-50.

3.3.1 Cold Creek water supply

Table 10 Summary of performance for Consent 1134-3 to take water from Cold Stream to supply the Cold Creek Water Supply Scheme

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Rate of abstraction shall not exceed 59 L/s	Review of abstraction data	No
2. Measure and record abstraction volume and flow of stream	Data received-abatement notice issued to have equipment compliant	No
3. Suitable format for water records	Records received	Yes
4. Measurements transmitted in 'real time' to Council	Data received	Yes
5. Documentation to show water measuring and recording equipment installed and operational	Record received	Yes
6. Notification to Council of equipment failure	Notification received	Yes
7. Measuring and recording equipment to be accessible	Inspection	Yes
8. Restrictions on abstraction when flow below 209 L/s	Data received	Yes
9. Intake screened	Inspection	Yes
10. Best practicable option to minimise environmental effects	Inspections and liaison with consent holder	Yes
11. Report annually on efficient water use, leak detection and repair	Received	Yes
12. Annual payment of \$13,333 due by 1 September 2013, 2014 and 2015	Received	Yes
13. Review provision	Next option for review in June 2018	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		Good

Table 11 Summary of performance for Consent 5454-1 to erect, place, use and maintain a water intake structure on the bed of Cold Creek for water abstraction purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Notification of Council prior to construction and maintenance works	No maintenance in monitoring period	N/A
2. Structure to be constructed in accordance application	Construction completed	N/A
3. Adoption of best practicable option to minimise adverse effects	No maintenance in monitoring period	N/A
4. Minimise area disturbed and reinstate areas disturbed	No maintenance in monitoring period	N/A
5. Major construction and maintenance to occur between 1 Nov and 30 Apr	No maintenance in monitoring period	N/A
6. No obstruction of fish passage	Inspection	Yes
7. Monitoring and reporting of adequacy of fish passage	Fish surveys scheduled for every 3 years	Yes
8. Structure to be removed when no longer required and area reinstated.	Structure in use	N/A
9. Review provision	No further option for review before expiry	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 12 Summary of performance for Consent 6077-1 to discharge filter backwash water and supernatant from the Cold Creek water treatment plant into the Cold Stream

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Location of discharge point	Inspection	Yes
2. Limit on discharge rate	Inspection	Yes
3. Discharge not to cause certain effects in the receiving waters	Inspection	Yes
4. Limits on chlorine, suspended solids and pH in discharge	Not assessed this year	N/A
5. Review provision	No further provision for review	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

3.3.2 Eltham water supply

Table 13 Summary of performance for Consent 0213-3 to take and use water from the Waingongoro River for municipal water supply purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Limit on abstraction volume and rate	Review of abstraction data provided	Yes
2. Recording of abstraction data and provision of records to Council	Data received	Yes
3. Consent to be exercised in accordance with application	Inspection and liaison with consent holder	Yes
4. Quantification of reticulation system losses and reporting	Report received 1 March 2001	Yes
5. Investigation and report on blocking of intake	Report received 18 January 2002	Yes
6. Review of SC1 in 2002 to assess water conservation measures	Liaison with consent holders	N/A
7. Mitigation by riparian planting	Completed	Yes
8. Review provision	No further provision for review	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 14 Summary of performance for Consent 0989-3 to discharge reservoir from the Eltham Water Supply Reservoir onto land adjacent to the Waingongoro River

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Best practicable option to prevent or minimise adverse effects	No discharge during period under review	N/A
2. Notification of discharge 2 days prior	No discharge during period under review	N/A
3. Volume of discharge not to exceed 5000 m ³ once per year	No discharge during period under review	N/A
4. Discharge only when flows in Waingongoro > 1050 L/s	No discharge during period under review	N/A
5. Discharge across land, no direct discharge	No discharge during period under review	N/A
6. Consent holder to reduce volume of sediment and silt in the discharge	No discharge during period under review	N/A
7. Suspended solids in discharge not to exceed 100g/m ³	No discharge during period under review	N/A
8. Discharge not to have effects on receiving water	No discharge during period under review	N/A

9. Review provision	Next option for review in June 2017	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		N/A
Overall assessment of administrative performance in respect of this consent		N/A

Table 15 Summary of performance for Consent 1810-3 to discharge overflow and reservoir drainage water from the Eltham water supply reservoir

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Approval required prior to emptying reservoir	No discharge during period under review	N/A
2. Periods when consent exercised minimised	No discharge during period under review	N/A
3. Minimise discharge of sediments when emptying reservoir	No discharge during period under review	N/A
4. Discharge not to cause certain effects in the receiving waters	No discharge during period under review	N/A
5. Limits on chlorine and suspended solids in the discharge	No discharge during period under review	N/A
6. Review provision	No further options for review prior to expiry	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		N/A
Overall assessment of administrative performance in respect of this consent		N/A

Table 16 Summary of performance for Consent 1811-3 to discharge filter backwash from the Eltham water treatment plant

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Proper and efficient maintenance of the settlement pond system	Inspection	Yes
2. Discharge not to cause certain effects in the receiving waters below the established mixing zone	Inspection	Yes
3. Limits on chlorine and suspended solids in the discharge	Samples collected	Yes
4. Review provision	No further options for review prior to expiry	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

3.3.3 Hawera water supply

Table 17 Summary of performance for Consent 0146-2 to take and use water from the Kapuni Stream for municipal water supply purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Limit on abstraction volume and rate	Review of abstraction data provided	Yes
2. Recording of abstraction data and provision of records to Council	Data received	Yes
3. Consent to be exercised in accordance with application documentation. Report on efficiency measures every two years	Report received	Yes
4. Reporting of events when abstraction is greater than 124.5 L/s	Data review	Yes
5. Mitigation by riparian planting	Total amount has been paid to the Taranaki Tree Trust	Yes
6. Preparation and maintenance of management plan for Kapuni Stream in conjunction with other users (within three months of granting)	Liaison with consent holder – Plan prepared in 2003 and updated in 2006	Yes
7. Annual leak detection and repair report	Report received	Yes
8. Point of abstraction	Inspection	Yes
9. Review provision	No further options for review prior to expiry	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 18 Summary of performance for Consent 0933-3 to discharge up to 227 cubic m³ /day of settling pond supernatant from a water treatment plant into the Kapuni Stream

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Adoption of best practicable option	Inspections and liaison with consent holder	Yes
2. Exercise of consent in accordance with application documentation	Inspections and liaison with consent holder	Yes
3. Notification prior to exercise		N/A
4. Permanent solution for treatment of wastes at time of upgrade in 2008	Backwash settling pond operating	Yes
5. Proper and efficient maintenance and operation of settlement system.	Inspections and liaison with consent holder	Yes
6. Discharge not to have adverse effects on receiving waters	Inspection, sampling, macroinvertebrate and fish surveys	Yes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
7. Limits on certain parameters in the discharge	Sampling	No One sample exceeded limits
8. Lapse provision	Not applicable – consent exercised	N/A
9. Review provision	Next scheduled in 2017, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		Good
Overall assessment of administrative performance in respect of this consent		High

Table 19 Summary of performance for Consent 5596-1 to construct, place, use and maintain two existing intake structures in the Kapuni Stream for the Hawera water supply

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Notification of Council prior to construction and maintenance works	No longer in use	N/A
2. Structure to be constructed in accordance with application	No longer in use	N/A
3. Construction not to occur between 1 May and 31 October	No longer in use	N/A
4. Adoption of best practicable option to minimise adverse effects on water quality	No longer in use	N/A
5. Minimise disturbance during construction and maintenance and reinstate disturbed areas	No longer in use	N/A
6. No refuelling on the streambed	No longer in use	N/A
7. No obstruction of fish passage	No longer in use	N/A
8. Maintenance of flow down fish pass to ensure fish passage	No longer in use	N/A
9. Structure not to cause erosion adjacent to or downstream of rock riprap ramp	No longer in use	N/A
10. Only material which makes up existing structure should be extracted from streambed during construction	No longer in use	N/A
11. Removal of streambed material for maintenance purposes only to occur between 1 November and 30 April	No longer in use	N/A
12. Removed material to be placed on banks of stream downstream of weir	No longer in use	N/A
13. Structure to be removed when no longer required and area reinstated.	Structure removed	Yes

14. Review provision	No further options for review prior to expiry	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 20 Summary of performance for Consent 7002-1 to take and use groundwater for municipal, rural, industrial, and recreational supply purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Exercise of consent to be in accordance with application	Inspections of site and records	Yes
2. Notify the Council in writing at least 7 days prior to exercise of consent	Notification received	Yes
3. Provide Council with results of pump testing prior to exercise of consent	Received	Yes
4. Abstraction not to exceed 4,320m ³ per day	Review of abstraction data provided	Yes
5. Abstraction not to cause a more than 10% drop in static water level by interference	Monitored by STDC	Yes
6. Maintain records of the abstraction from each bore	Records kept and received by Council	Yes
7. Install device to record abstraction	Inspection and data received by Council	Yes
8. Consent holder to meet monitoring costs	Liaison with consent holder	Yes
9. Lapse provision	Not applicable – consent exercised	N/A
10. Review provision	Next scheduled in 2017, if required	Yes
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 21 Summary of performance for Consent 7413-1 to erect, use and maintain a water intake structure on the bed of the Kapuni Stream

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Exercise of consent to be in accordance with application	Inspection	Yes
2. Disturbance of riverbed between 1 November and 30 April only	N/A	N/A
3. Notification prior to works and maintenance	No maintenance during monitoring period	N/A
4. Area and volume of disturbance minimised	No maintenance during monitoring period	N/A
5. Minimise sediment entering stream	No maintenance during monitoring period	N/A

Condition requirement	Means of monitoring during period under review	Compliance achieved?
6. Structure removed and area reinstated when no longer required	Structure in use	N/A
7. Consent holder to monitor and maintain fish pass	Fish survey	Yes
8. Procedure if archaeological remains discovered during construction	None found	N/A
9. Lapse provision	Not applicable – consent exercised	N/A
10. Review provision	Next scheduled in June 2017, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 22 Summary of performance for Consent 7446-1 to discharge membrane backwash water and cleaning wastewater into the Kapuni Stream

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Best practicable option to minimise adverse effects	Inspection and liaison with consent holder	Yes
2. No adverse effects on receiving waters	Inspection, sampling, biomonitoring	Yes
3. Allowable increase in turbidity below mixing zone	Sampling	Yes
4. Levels of contaminants in discharge	Sampling	No. One sample exceeded limits
5. Lapse provision	Not applicable	N/A
6. Review provision	Next scheduled in June 2017, if required	Yes
Overall assessment of consent compliance and environmental performance in respect of this consent		Good
Overall assessment of administrative performance in respect of this consent		High

Table 23 Summary of performance for Consent 7447-1 to install, use and maintain an outfall structure on the bank of the Kapuni Stream

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Exercise of consent to be in accordance application	Inspections	Yes
2. Disturbance of riverbed between 1 November and 30 April only	N/A	N/A
3. Notification prior to works and maintenance	N/A	N/A

Condition requirement	Means of monitoring during period under review	Compliance achieved?
4. Area and volume of disturbance minimised	N/A	N/A
5. Minimise sediment entering stream	N/A	N/A
6. Structure removed and area reinstated when no longer required	Structure in use	N/A
7. Procedure if archaeological remains discovered during construction	N/A	N/A
8. Lapse provision	Consent exercised	N/A
9. Review provision	Next scheduled in June 2017, if required	Yes
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

3.3.4 Inaha water supply

Table 24 Summary of performance for Consent 1185-3 to take water from the Mangatoki Stream in the Waingongoro catchment for Inaha rural water supply purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Adoption of best practicable option	Inspection and liaison with consent holder	Yes
2. Combined take not to exceed 29 L/s, or 2,504 m ³ /day	Review of abstraction records	Yes
3. Gravity take preferential	Inspection and liaison with consent holder	Yes
4. Install and maintain water meter and data logger	Inspection and liaison with consent holder	Yes
5. Certification of water meter	Site inspection and NWMR compliant	Yes
6. Notification of equipment failure	No notification received	N/A
7. Intake structure maintained, and removed if no longer required	Inspection	Yes
8. Water meter and data logger accessible to Council staff	Inspection	Yes
9. Suitable format of water records	Review of abstraction records	Yes
10. Water records to be transmitted in 'real time' to Council	Review of abstraction records	Yes
11. Intake structure to be screened	Inspection	Yes
12. Intake structure not to block fish passage	Inspection	Yes

13. Leak detection and repair programme with annual report	Report received	Yes
14. Review provision	Next scheduled in June 2018, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 25 Summary of performance for Consent 1186-3 to take water from the Waingongoro River for Inaha rural water supply purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Adoption of best practicable option	Inspection and liaison with consent holder	Yes
2. Exercise in accordance with application	Inspection and liaison with consent holder	Yes
3. Maximum abstraction 2,592 m ³ /day at 30 L/s	Review of abstraction data	Yes
4. Measure and record abstraction rate and provide to Council	Data received	Yes
5. Maintain intake structure and remove when no longer required	Inspection and liaison with consent holder	Yes
6. Intake screened to avoid fish entrainment	Inspection	Yes
7. Intake structure shall not obstruct fish passage	Inspection	Yes
8. Report annually on efficient water use, leak detection and repair	Report received	Yes
9. Lapse provision	Not applicable – consent exercised	N/A
10. Review provision	Next scheduled in June 2018, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 26 Summary of performance for Consent 3927-2 to discharge backwash wastes from the Inaha water supply treatment plant into an unnamed tributary of the Mangatoki Stream

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Proper and efficient maintenance of the settlement pond system	Inspection	Yes
2. Discharge not to cause certain effects in the receiving	Inspection	Yes
3. Limits on chlorine and suspended solids in the discharge	Sampling not undertaken during current monitoring period	N/A
4. Review provision	No further options for review prior to expiry	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 27 Summary of performance for Consent 3928-2 to discharge uncontaminated overflow water from the Inaha rural water supply treatment plant

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Proper and efficient maintenance of the settlement pond system	Inspection	Yes
2. Discharge not to cause certain effects in the receiving waters	Inspection	Yes
3. Review provision	No further options for review prior to expiry	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 28 Summary of performance for Consent 4102-2 to construct a low-level weir and fish pass across the Mangatoki Stream to improve water intake efficiencies

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Adoption of best practicable option	No maintenance during period under review	N/A
2. Exercise of consent in accordance with application documentation	No maintenance during period under review	N/A
3. Notification of Council prior to exercise of consent	No maintenance during period under review	N/A
4. Notification of Council prior to major maintenance works	No maintenance during period under review	N/A
5. Adoption of best practicable option during maintenance works	No maintenance during period under review	N/A
6. River bed to disturbance to be minimised during maintenance	No maintenance during period under review	N/A
7. No maintenance works between 1 May to 31 Oct	No maintenance during period under review	N/A

Condition requirement	Means of monitoring during period under review	Compliance achieved?
8. Structure to be properly maintained	Inspection	Yes
9. Structure not to impede fish passage	Inspection	Yes
10. Structure to be removed and area reinstated when no longer required	Structure in use	N/A
11. Lapse Provision	Not applicable - consent exercised	N/A
12. Review provision	Next scheduled in June 2017, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 29 Summary of performance for Consent 5364-1 to take and use water from the Mangatoki Stream for Inaha rural supply scheme purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Limit on abstraction volume and rate	Review of abstraction data	Partly(separate data required)
2. Recording of abstraction data and provision of records to Council	Data received	Partly(separate data required)
3. Consent to be exercised in accordance with application	Inspection and liaison with consent holder	Yes
4. Mitigation by riparian planting	Liaison with consent holder	Yes
5. Right of Council to suspend or reduce abstraction during extreme low flows	Right not exercised	N/A
6. Review provision	Consent surrendered in May 2014	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		Good

Table 30 Summary of performance for Consent 5365-1 to erect, place and maintain a low level intake weir in the Mangatoki Stream for Inaha rural water supply scheme purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Notification of Council prior to construction and maintenance works	No maintenance during period under review	N/A
2. Adoption of best practicable option to minimise adverse effects	No maintenance during period under review	N/A
3. No obstruction of fish passage	Inspection	Yes
4. Construction and maintenance to be in accordance with application	No maintenance during period under review	N/A
5. Maintain and operate safe structure	Inspection	Yes
6. Structure to be removed when no longer required and area reinstated	Structure in use	N/A

7. Review provision	No further options for review prior to expiry	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

3.3.5 Opunake water supply

Table 31 Summary of performance for Consent 0232-4 to take and use water from the Waiaua River for Opunake town water supply purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Rate of take not to exceed 2,200m ³ /day or 25.5 L/s	Review of abstraction data	Yes
2. Take mainly through 'new' intake	Inspection and liaison with consent holder	Yes
3. Rate of take through old intake up to 3,650 m ³ /day or 42.2 L/s	No take through old intake	N/A
4. Notify Council if take occurs through old intake	No take through old intake	N/A
5. Installation and maintenance of water meter and data logger	Inspection	Yes
6. Water meter certification	Meter approved	Yes
7. Notify Council of equipment failure	No equipment failure	N/A
8. Water meter and data logger accessible to Council staff	Inspection	Yes
9. Suitable format of records	Review of abstraction data	Yes
10. Data to be transmitted to Council in real time from 1 December 2013	Data received	Yes
11. Best practicable option to prevent or minimise adverse effects	Inspection and liaison with consent holder	Yes
12. Annual report on leak detection and water use efficiency	Report received	Yes
13. Lapse provision	Consent exercised	N/A
14. Review provision	Next scheduled in June 2018, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 32 Summary of performance for Consent 5574-2 to discharge water treatment residuals and pond drainage water from the Opunake Water Treatment Plant into the Waiaua River

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Best practicable option to prevent or minimise adverse effects	Yes	Yes
2. Discharge not to exceed 120 m ³ /day	Yes	Yes
3. Effects not to give rise in receiving	Inspection	Yes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
waters		
4. Limits on contaminants in discharge	Sampling not undertaken in period under review	N/A
5. Lapse provision	Consent exercised	N/A
6. Review provision	Next scheduled in June 2018, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 33 Summary of performance for Consent 9473-1 to construct, place and use a water intake structure on the bed of the Waiaua River for water abstraction purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Intake specifications	Inspection during construction	Yes
2. Notification prior to works	Notification received	Yes
3. Minimise river bed disturbance	Inspection during construction	Yes
4. Minimise sediment discharge to river	Inspection during construction	Yes
5. Ensure screen does not entrap fauna	Not yet assessed	N/A
6. No obstruction of fish passage	Inspection	Yes
7. Financial payment	Payment received	Yes
8. Procedures for archaeological finds	Nothing found	N/A
9. Remove structure when no longer required	Structure being used	N/A
10. Lapse condition	Consent exercised	N/A
11. Reviews June 2018 and June 2024	No review option this period	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

3.3.6 Patea water supply

Table 34 Summary of performance for Consent 3388-3 To take and use groundwater from three bores (known as Bore 1, Bore 2 and Bore 4) for Patea Township water supply purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Total daily extraction not to exceed 1125 m ³	Data received	Yes
2. Each bore not to exceed certain abstraction rates	Data received	Minor non-compliance
3. Bore 3 not to exceed 300 m ³ /day	Data received	Yes
4. Install flow meters	Data received	N/A

Condition requirement	Means of monitoring during period under review	Compliance achieved?
5. Install data logger	Data received	Yes
6. Inform Council of any equipment malfunction	Programme supervision	N/A
7. Provide access to equipment	Inspection	Yes
8. Adopt best practical option	Inspection	Yes
9. Measure level in Brannigan's bore	Groundwater level recorder installed	Yes
10. Consultations with Brannigan's bore owner if levels meet certain criteria	Liaison with consent holder – not necessary	N/A
11. Restrict use or provide water to Brannigan's bore owner if levels meet certain criteria	Liaison with consent holder – not necessary	Yes
12. Not to cause saltwater intrusion	Not assessed	N/A
13. Review provision	Next due in June 2016, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

3.3.7 Pope water supply

Table 35 Summary of performance for Consent 4446-2 to discharge treated backwash water from the Pope Rural Water Supply Treatment Plant

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Adoption of best practicable option	Inspection and liaison with consent holder	Yes
2. Exercise in accordance with application	Inspection and liaison with consent holder	Yes
3. Maximum discharge of 6 m ³ /day at 5 L/s	Not assessed	N/A
4. Limits not to be exceeded in the discharge	Sampling – not sampled during period under review	N/A
5. Efficient operation	Inspection and liaison with consent holder	Yes
6. No effects on receiving water	Inspection	Yes
7. Lapse provision	Not applicable – consent exercised	N/A
8. Review provision	Next scheduled in June 2017, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

3.3.8 Rahotu water supply

Table 36 Summary of performance for Consent 3696-3 to take and use water from the Pungaereere Stream for the Rahotu community water supply scheme

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Limit on abstraction volume and rate	Review abstraction data provided to Council	Yes
2. Installation and maintenance of water meter and data logger	Inspection	Yes
3. Water meter certification	Verified in June 2014, next due in 2019	Yes
4. Notify Council of equipment failure	No equipment failure during period under review	Yes
5. Water meter and data logger accessible to Council staff	Inspection	Yes
6. Suitable format of records	Review of abstraction data	Yes
7. Data to be transmitted to Council in real time from 1 February 2014	Data received	Yes
8. Best practicable option to prevent or minimise adverse effects	Inspection and liaison with consent holder	Yes
9. Annual report on leak detection and water use efficiency	Report received	Yes
10. Lapse provision	Consent exercised	Yes
11. Review provision	No further options for review prior to expiry	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		Good

Table 37 Summary of performance for Consent 6038-1 to discharge filter backwash water and settling tank waste from the Rahotu water treatment plant into the Pungaereere Stream

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Discharge not to cause certain effects in the receiving waters below the established mixing zone	Samples collected	Yes
2. Limits on chlorine and pH in discharge	Samples collected	Yes
3. Review provision	No further provision for review before expiry	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

3.3.9 Wai-inu Beach water supply

Table 38 Summary of performance for Consent 3770-3 to take and use groundwater for Wai-inu Beach water supply purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Limit on abstraction volume and rate	Review of abstraction data provided to Council	Yes
2. Installation and maintenance of water meter and data logger	Inspection	Yes
3. Water meter certification	Received	Yes
4. Notify Council of equipment failure	No equipment failure during monitoring period	Yes
5. Water meter and data logger accessible to Council staff	Inspection	Yes
6. Water records to be provided by 31 July each year	Records received	Yes
7. Best practicable option to prevent or minimise adverse effects	Inspection and liaison with consent holder	Yes
8. Lapse provision	Not applicable – consent exercised	N/A
9. Review provision	Next scheduled in June 2017, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

3.3.10 Waimate West water supply

Table 39 Summary of performance for Consent 0129-3 to discharge treated wash water from the Waimate Water Supply Scheme into an unnamed tributary of Kelly's Creek

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Adoption of best practicable option	Inspection and liaison with consent holder	Yes
2. Exercise in accordance with application	Inspection and liaison with consent holder	Yes
3. Maximum discharge rate 750 m ³ /day	Not assessed	N/A
4. Installation and maintenance of erosion protection structure	Inspection	Yes
5. Limits on discharge not to be exceeded	Sampling not undertaken during monitoring period	N/A
6. Efficient operation of settling ponds	Inspection and liaison with consent holder	Yes
7. No effects on receiving water	Inspection	Yes
8. Lapse provision	Not applicable- consent exercised	N/A

Condition requirement	Means of monitoring during period under review	Compliance achieved?
9. Review provision	Next scheduled in June 2017, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 40 Summary of performance for Consent 0634-3 to take water from the Mangawhero-iti Stream for the Waimate West water supply

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Max rate of abstraction 121 L/s	Review of abstraction data provided	Technical non compliance
2. Limit on abstraction unless water is taken from Otakeho Stream at 85 L/s unless unable to achieve 85 L/s	Review of abstraction data provided	Yes
3. Installation of water meter and data logger and records of volumes abstracted	Inspections and abstraction data	Yes
4. Notification of installation of water meter and data logger	Received	Yes
5. Notification of equipment failure	No problems during monitoring period	Yes
6. Water meter and data logger accessible to Council	Inspections	Yes
7. Records of water taken in suitable format	Review of abstraction data provided	Yes
8. Flow in Mangawhero-iti Stream downstream of intake to be maintained above 32 L/s	Data provided	Compliance >99% of monitoring period
9. Flow of Mangawhero-iti Stream recorded when less than 500 L/s	Data provided	Yes
10. Measurements to be transmitted to Council in 'real time'	Reception of telemetry	Yes
11. Staff gauge to be installed	Installed by Council	Yes
12. Sufficient stream flow measurements undertaken to maintain a 'rating curve'	Gauging undertaken by Council	Yes
13. Best practicable option to prevent or minimise adverse environmental effects	Inspections, data review	Yes
14. Annual report due 1 September	Report received	Yes
15. Five annual payments of \$30,600 due 2011 to 2015	Payment received	Yes
16. Review of consent conditions	Next scheduled during 2018, if required	N/A

Condition requirement	Means of monitoring during period under review	Compliance achieved?
Overall assessment of consent compliance and environmental performance in respect of this consent		Good
Overall assessment of administrative performance in respect of this consent		Good

Table 41 Summary of performance for Consent 0635-3 to take water from the Mangawhero Stream to add to the flow of the Mangawhero-iti Stream for water supply purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Max rate of take 70 L/s	Review of abstraction data provided	Yes
2. Review of abstraction data provided	Review of abstraction data provided	Yes
3. Installation of water meter and data logger and records of volumes abstracted	Inspections and abstraction data	Yes
4. Notification of installation of water meter and data logger	Received	Yes
5. Notification of equipment failure	N/A	N/A
6. Water meter and data logger accessible to Council	Inspections	Yes
7. Records of water taken in suitable format	Review of abstraction data provided	Yes
8. Measurements to be transmitted to Council in 'real time'	Data received	Yes
9. Best practicable option to prevent or minimise adverse environmental effects	Inspections, data review	Yes
10. Review provision	Next scheduled in June 2018, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		Good
Overall assessment of administrative performance in respect of this consent		Good

Table 42 Summary of performance for Consent 3911-2 to take water from the Otakeho Stream for the Pope and Waimate West water supply schemes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Limit on abstraction rate	Review of abstraction data provided	Yes
2. Installation of water meter and data logger and records of volumes abstracted	Inspections and abstraction data	Yes
3. Notification of installation of water meter and data logger	Received	Yes
4. Notification of equipment failure	N/A	Yes
5. Water meter and data logger accessible to Council	Inspections	Yes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
6. Records of water taken in suitable format	Review of abstraction data provided	Yes
7. Best practicable option to prevent or minimise adverse environmental effects	Inspections, data review	Yes
8. Measurements to be transmitted to Council in 'real time'	Data received	Yes
9. Flows of less than 500 L/s recorded	Due June 2017	N/A
10. Review provision	Next scheduled in June 2018, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 43 Summary of performance for Consent 4826-2 to place, use and maintain a water intake structure and associated structures on the bed of the Otakeho Stream

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Notification of Council prior to construction and maintenance works	No maintenance during period under review	N/A
2. Structure to be constructed in accordance with application	Construction completed	N/A
3. Adoption of best practicable option to minimise adverse effects on water quality	No maintenance during period under review	N/A
4. Minimise disturbance during construction and maintenance	No maintenance during period under review	N/A
5. Maintenance works to only occur between 1 April and 30 November	No maintenance during period under review	N/A
6. No obstruction of fish passage	Triennial fish surveys	Yes
7. Council Biologist to be present during construction of the fish pass	Biologist present	Yes
8. Structure to be removed when no longer required and area reinstated. Council to be notified prior to removal	Structure in use	N/A
9. Review provision	No further options for review prior to expiry	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 44 Summary of performance for Consent 5451-1 to erect, place, use and maintain a water intake structure on the bed of the Mangawhero-iti Stream for water abstraction purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Notification of Council prior to construction and maintenance works	No maintenance during period under review	N/A
2. Structure to be constructed in accordance with application documents	Construction completed	N/A
3. Adoption of best practicable option to minimise adverse effects on water quality	No maintenance during period under review	N/A
4. Minimise disturbance during construction and maintenance and reinstate disturbed areas	No maintenance during period under review	N/A
5. Maintenance works to only occur between 1 April and 30 November	No maintenance during period under review	N/A
6. No obstruction of fish passage	Inspection and triennial fish survey	Yes
7. Monitoring programme to determine fish passage	Triennial fish surveys	Yes
8. Structure to be removed when no longer required and area reinstated	Structure in use	N/A
9. Review provision	No further options for review prior to expiry	Yes
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 45 Summary of performance for Consent 5452-1 to erect, place, use and maintain a water intake structure on the bed of the Mangawhero Stream for water abstraction

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Notification of Council prior to construction and maintenance works	No maintenance during period under review	N/A
2. Structure to be constructed in accordance with application	Construction completed	N/A
3. Adoption of best practicable option to minimise adverse effects on water quality	No maintenance during period under review	N/A
4. Minimise disturbance during construction and maintenance and reinstate disturbed areas	No maintenance during period under review	N/A
5. Maintenance works to only occur between 1 April and 30 November or with written approval from Council	No maintenance during period under review	N/A

6. No obstruction of fish passage	Triennial fish surveys	Yes
7. Monitoring programme to determine fish passage	Triennial fish surveys	Yes
8. Structure to be removed when no longer required and area reinstated	Structure in use	N/A
9. Review provision	No further options for review prior to expiry	Yes
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

3.3.11 Waverley water supply

Table 46 Summary of performance for Consent 3313-3 to take and use groundwater from the Fookes, Chester and Swinbourne Street bores for Waverley municipal supply purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Combined take not to exceed 14.2 L/s or 900 m ³ /day	Review of abstraction data	Yes
2. Daily maximum volume and abstraction limits for each bore	Review of abstraction data	Yes (daily volumes)
		99%+ compliance for rates of abstraction
3. Bores to have permanent labelling	Inspections	Yes
4. Water meter and data logger installed and maintained on Chester and Fookes St bores	Inspections	Yes
5. Install and maintain equipment on Swinbourne St bore.	Inspection	Yes
6. Install and maintain equipment on Swinbourne St bore.	Inspection	Yes
7. Recording of abstraction data	Data received	Yes
8. Notice of installation of water measuring equipment	Notification received	Yes
9. Notification of non-operational measuring equipment	No problems during monitoring period	Yes
10. Best practicable option to prevent or minimise adverse effects	Inspections, review or data	Yes
11. No intrusion of salt water	Not assessed	N/A
12. Access to well provided for water measurement purposes	Inspections	Yes

13. Review of consent	Next scheduled in June 2016, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

3.3.12 Waverley Beach water supply

Table 47 Summary of performance for Consent 9563-1 to take and use water groundwater for Waverley Beach water supply purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Limit on abstraction rate	Consent not exercised	N/A
2. No intrusion of salt water	Consent not exercised	N/A
3. Bores to have permanent labels	Consent not exercised	N/A
4. Installation and maintenance of water meter and data logger	Consent not exercised	N/A
5. Water meter certification	Consent not exercised	N/A
6. Installation of water level monitoring devices	Consent not exercised	N/A
7. Water level certification	Consent not exercised	N/A
8. Water meter and data logger accessible to Council staff	Consent not exercised	N/A
9. Notify Council of equipment failure	Consent not exercised	N/A
10. Water records to be provided by 31 July each year	Consent not exercised	N/A
11. Best practicable option to prevent or minimise adverse effects	Consent not exercised	N/A
12. Lapse provision	Consent not exercised	N/A
13. Review provision	Next scheduled in June 2016, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

3.3.13 Oaonui water supply

Table 48 Summary of performance for Consent 0231-3 to take and use water from the Oaonui Stream for a rural community water supply scheme and the Maui Production Station

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Limit on abstraction volume and rate	Review of abstraction data provided	Yes
2. Recording of abstraction data and provision of records to Council	Data received	Yes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
3. Promotion of water conservation and reporting	No longer required	N/A
4. Mitigation by riparian planting	Payments up to date with Taranaki Tree Trust	Yes
5. Provision for change or cancellation	No request for change or cancellation	N/A
6. Review provision	No further option for review prior to expiry	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

Table 49 Summary of performance for Consent 5453-1 to erect, place, use and maintain a water intake structure on the bed of the Oaonui Stream for water abstraction purposes

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Notification of Council prior to construction and maintenance works	No maintenance in period under review	N/A
2. Construction and maintenance to be in accordance application	No maintenance in period under review	N/A
3. Adoption of best practicable option to minimise adverse effects on water quality	No maintenance in period under review	N/A
4. Minimise riverbed disturbance and reinstate areas disturbed	No maintenance in period under review	N/A
5. Major maintenance to occur between 1 November and 30 April	No maintenance in period under review	N/A
6. No obstruction of fish passage	Inspection	Not assessed this period
7. Monitoring and reporting of adequacy of fish passage	Fish surveys scheduled for once every three years	N/A
8. Structure to be removed when no longer required and area reinstated.	Structure in use	N/A
9. Review provision	No further option for review prior to expiry	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		High

3.3.14 Nukumarū water supply

Table 50 Summary of performance for Consent 6451-1 to take and use groundwater from up to two bores for the purpose of supplying the Nukumarū community rural water scheme

Condition requirement	Means of monitoring during period under review	Compliance achieved?
1. Exercise of consent to be in accordance with documentation supporting application	Inspection and liaison with consent holder	Yes
2. Limit on abstraction rate and volume	Review of abstraction data provided	Yes
3. Installation of water meter	Inspection	Yes
4. Recording of abstraction data and provision of data to Council by 31 July each year	Data provided	No- data was late
5. Cost of monitoring to be borne by Consent holder	Consent holder charged for monitoring	Yes
6. Lapse condition	Not applicable - consent exercised	N/A
7. Review provision	Next optional review June 2017, if required	N/A
Overall assessment of consent compliance and environmental performance in respect of this consent		High
Overall assessment of administrative performance in respect of this consent		Good

During the monitoring period, STDC demonstrated an overall high level of environmental performance and a good level of administrative performance.

During the monitoring period, OWSL demonstrated an overall high level of environmental performance and high level of administrative performance.

During the monitoring period, NWSSI demonstrated an overall high level of environmental and a good level of administrative performance.

During the monitoring period, CCWSL demonstrated an overall good level of environmental performance and a good level of environmental performance.

3.4 Recommendations from the 2012-2013 Annual Report

In the 2012-2013 Annual Report, it was recommended:

THAT monitoring of the South Taranaki water supply schemes during 2013-2014 remain unchanged from that of 2012-2013.

This recommendation was implemented.

3.5 Alterations to monitoring programmes for 2014-2015

In designing and implementing the monitoring programmes for water abstractions/discharges in the region, the Council has taken into account the extent of information made available by previous authorities, its relevance under the RMA the obligations of the Act in terms of monitoring abstractions/discharges and effects, and subsequently reporting to the regional community. The Council also takes into account the scope of assessments required at the time of renewal of permits, and the need to maintain a sound understanding of industrial processes within Taranaki abstracting water and discharging to the environment.

It is proposed that for 2014-2015 the monitoring programme remain similar to that of 2013-2014. A recommendation to this effect is attached to this report.

3.6 Exercise of optional review of consent

None of the consents had an option for review during the monitoring period.

4. Recommendations

That for 2014-2015, the monitoring programme remain similar to that of 2013-2014.

Glossary of common terms and abbreviations

The following abbreviations and terms may be used within this report:

Biomonitoring	Assessing the health of the environment using aquatic organisms.
COD	Chemical oxygen demand. A measure of the oxygen required to oxidise all matter in a sample by chemical reaction.
Condy	Conductivity, an indication of the level of dissolved salts in a sample, usually measured at 20°C and expressed in mS/m.
DRP	Dissolved reactive phosphorus.
Fresh	Elevated flow in a stream, such as after heavy rainfall.
g/m ³	Grams per cubic metre, and equivalent to milligrams per litre (mg/L). In water, this is also equivalent to parts per million (ppm), but the same does not apply to gaseous mixtures.
Incident	An event that is alleged or is found to have occurred that may have actual or potential environmental consequences or may involve non-compliance with a consent or rule in a regional plan. Registration of an incident by the Council does not automatically mean such an outcome had actually occurred.
Intervention	Action/s taken by Council to instruct or direct actions be taken to avoid or reduce the likelihood of an incident occurring.
Investigation	Action taken by Council to establish what were the circumstances/events surrounding an incident including any allegations of an incident.
L/s	Litres per second.
MCI	Macroinvertebrate community index; a numerical indication of the state of biological life in a stream that takes into account the sensitivity of the taxa present to organic pollution in stony habitats.
mS/m	Millisiemens per metre.
Mixing zone	The zone below a discharge point where the discharge is not fully mixed with the receiving environment. For a stream, conventionally taken as a length equivalent to 7 times the width of the stream at the discharge point.
NH ₄	Ammonium, normally expressed in terms of the mass of nitrogen (N).
NH ₃	Unionised ammonia, normally expressed in terms of the mass of nitrogen (N).
NWMR	National Water Metering Regulations
NNN	Nitrate-Nitrite Nitrogen
NTU	Nephelometric Turbidity Unit, a measure of the turbidity of water.
pH	A numerical system for measuring acidity in solutions, with 7 as neutral. Numbers lower than 7 are increasingly acidic and higher than 7 are increasingly alkaline. The scale is logarithmic i.e. a change of 1 represents a ten-fold change in strength. For example, a pH of 4 is ten times more acidic than a pH of 5.
Physicochemical	Measurement of both physical properties (e.g. temperature, clarity, density) and chemical determinants (e.g. metals and nutrients) to characterise the state of an environment.

Resource consent	Refer Section 87 of the RMA. Resource consents include land use consents (refer Sections 9 and 13 of the RMA), coastal permits (Sections 12, 14 and 15), water permits (Section 14) and discharge permits (Section 15).
RMA	<i>Resource Management Act 1991</i> and including all subsequent amendments.
SS	Suspended solids.
SQMCI	Semi quantitative macroinvertebrate community index.
Temp	Temperature, measured in °C (degrees Celsius).
Turb	Turbidity, expressed in NTU.
UI	Unauthorised Incident.
UIR	Unauthorised Incident Register – contains a list of events recorded by the Council on the basis that they may have the potential or actual environmental consequences that may represent a breach of a consent or provision in a Regional Plan.

For further information on analytical methods, contact the Council's laboratory.

Bibliography and references

- Taranaki Regional Council, 2013, South Taranaki Water Supplies Monitoring Programme Annual Report 2012-2013, Technical Report 2013-65
- Taranaki Regional Council, 2012, South Taranaki Water Supplies Monitoring Programme Annual Report 2011-2012, Technical Report 2012-78
- Taranaki Regional Council, 2011, South Taranaki Water Supplies Monitoring Programme Annual Report 2010-2011, Technical Report 2011-42
- Taranaki Regional Council, 2010, South Taranaki Water Supplies Monitoring Programme Annual Report 2009-2010, Technical Report 2010-53
- Taranaki Regional Council, 2010, South Taranaki Water Supplies Monitoring Programme Annual Report 2008-2009, Technical Report 2009-84
- Taranaki Regional Council, 2008, South Taranaki District Water Supply Plants Monitoring Programme Biennial Report 2006-2008, Technical Report 2008-85
- Taranaki Regional Council, 2006, South Taranaki District Water Supply Plants and Structures Monitoring Programme Annual Report 2005-2006, Technical Report 2006-22
- Taranaki Regional Council, 2005, South Taranaki District Water Supply Plants and Structures Monitoring Programme Annual Report 2004-2005, Technical Report 2005-54
- Taranaki Regional Council, 2004, South Taranaki District Council Water Supply Plants and Structures Monitoring Programme Annual Report 2003-2004, Technical Report 2004-09
- Taranaki Regional Council, 2003, South Taranaki District Council Water Supply Plants and Structures Monitoring Programme Annual Report 2002-2003, Technical Report 2003-69
- Taranaki Regional Council, 2002, South Taranaki District Council Water Supply Plants and Structures Monitoring Programme Annual Report 2001-2002, Technical Report 2002-64
- Taranaki Regional Council, 2001, South Taranaki District Council Water Supply Plants and Structures Monitoring Programme Annual Report 2000-2001, Technical Report 2001-65
- Taranaki Regional Council, 2000, South Taranaki District Council Water Supply Plants and Structures Monitoring Programme Annual Report 1999-2000, Technical Report 2000-80
- Taranaki Regional Council, 1999, South Taranaki District Council Water Supply Plants and Structures Monitoring Programme Annual Report 1998-99, Technical Report 99-51
- Taranaki Regional Council, 1998, South Taranaki District Council Water Supply Plants and Structures Monitoring Programme Annual Report 1997-98, Technical Report 98-94
- Taranaki Regional Council, 1997, Hawera Water Treatment Plant Annual Report 1996-97. Technical Report 97-43.

Taranaki Regional Council, 1996, Hawera Water Treatment Plant Annual Report 1995-96.
Technical Report 96-40.

Taranaki Regional Council, 1995, Hawera Water Treatment Plant Annual Report 1994-95.
Technical Report 95-24.

Taranaki Regional Council, 1994, Hawera Water Treatment Plant Annual Report 1993-94.
Technical Report 94-47.

Taranaki Regional Council, 1993, Hawera Water Treatment Plant Annual Report 1992-93.
Technical Report 93-19.

Taranaki Regional Council, 1992, Hawera Water Treatment Plant Annual Report 1991-92.
Technical Report 92-24.

Taranaki Regional Council, 1991, Hawera Water Treatment Plant Annual Report 1990-91.
Technical Report 91-24.

Taranaki Regional Council, 1990, Hawera Water Treatment Plant Annual Report 1989-90.
Technical Report 90-38.

Appendix I

**Resource consents held by
STDC, OWSL NWSSI, and CCWSL**

Cold Creek water supply

Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date: 19 June 2013

Commencement Date: 10 July 2013

Conditions of Consent

Consent Granted: To take water from Cold Stream to supply the Cold Creek Water Supply Scheme

Expiry Date: 1 June 2030

Review Date(s): June 2018, June 2024

Site Location: Cold Creek Intake, 620 Kiri Road, Opunake

Legal Description: Pt Sec 5 Blk V Kaupokonui SD (Site of take)

Grid Reference (NZTM) 1686866E-5639966N

Catchment: Taungatara

Tributary: Cold Stream

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General condition

- a. The consent holder shall pay to the Taranaki Regional Council all the administration, monitoring and supervision costs of this consent, fixed in accordance to section 36 of the Resource Management Act 1991.

Special conditions

1. The rate of taking shall not exceed 59 L/s.
2. The consent holder shall:
 - (a) measure and record, using a tamper-proof device, the volume of water taken at intervals not exceeding 15 minutes to an accuracy of $\pm 5\%$; and
 - (b) determine the flow in Cold Stream immediately downstream of the intake at intervals not exceeding 15 minutes to an accuracy of $\pm 10\%$.

Note: Water meters and dataloggers must be installed, and regularly maintained, in accordance with manufacturer's specifications in order to ensure that they meet the required accuracy. Even with proper maintenance water meters and dataloggers have a limited lifespan.

3. The records of water taken shall:
 - (a) be in a format that, in the opinion of the Chief Executive, Taranaki Regional Council, is suitable for auditing; and
 - (b) specifically record the water taken as 'zero' when no water is taken.
4. The measurements made in accordance with condition 2, in a format to be advised by the Chief Executive, Taranaki Regional Council, shall be transmitted to the Taranaki Regional Council's computer system to maintain a 'real time' record of the water taken and the flow immediately downstream of the intake.
5. The consent holder shall provide the Chief Executive, Taranaki Regional Council with a document from a suitably qualified person certifying that water measuring and recording equipment required by the conditions of this consent ('the equipment'):
 - (a) has been installed in accordance with the manufacturer's specifications and/or current industry standards;
 - (b) is being operated and maintained in accordance with the manufacturer's specifications and/or current industry standards; and/or
 - (c) has been tested and shown to be operating to an accuracy of $\pm 5\%$.

The documentation shall be provided:

- (i) within 30 days of the installation of a water meter or datalogger;
- (ii) at other times when reasonable notice is given and the Chief Executive, Taranaki Regional Council has reasonable evidence that the equipment may not be functioning as required by this consent; and
- (iii) no less frequently than once every five years.

Consent 1134-3

6. If any measuring or recording equipment breaks down, or for any reason is not operational, the consent holder shall advise the Chief Executive, Taranaki Regional Council immediately. Any repairs or maintenance to this equipment must be undertaken by a suitably qualified person.
7. All measuring and recording equipment required by the conditions of this consent ('the equipment') shall be accessible to Taranaki Regional Council officers at all reasonable times for inspection and/or data retrieval. In addition, the equipment shall be designed and installed so that Taranaki Regional Council officers can readily verify that it is accurately recording the required information.
8. When the flow in Cold Stream immediately downstream of the intake point is less than 209 litres/second, the taking of water shall be restricted to the minimum amount necessary to maintain the health and welfare of people and animals (i.e. garden water and other non-essential uses are prohibited).
9. The consent holder shall ensure that the intake is screened to avoid fish entering the intake or being trapped against the screen.
10. At all times the consent holder shall adopt the best practicable option to prevent or minimise any actual or likely adverse effect on the environment associated with the abstraction of water, including, but not limited to, the efficient and conservative use of water.
11. The consent holder shall, on an annual basis, provide a report detailing:
 - the work done to detect and minimise leaks;
 - water use efficiency and conservation measures undertaken; and
 - water use benchmarking data for the region and how the area supplied by this consent supplied compare.

The report(s) shall be provided to the Chief Executive, Taranaki Regional Council before 31 August each year and cover the previous 1 July to 30 June period.

12. The consent holder shall make three annual payments of \$13,333 (GST exclusive) to the Taranaki Regional Council as a financial contribution in order to remedy or mitigate adverse effects the environment. The first payment shall be made within 60 days of the consent commencing and further payments no later than 1 September in each of the following two years.

Consent 1134-3

13. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the months of June 2018 and/or June 2024, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 19 June 2013

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Discharge Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: Cold Creek Community Water Supply Limited
2 Havelock Street
OPUNAKE 4616

Decision Date: 29 November 2002

Commencement Date: 29 November 2002

Conditions of Consent

Consent Granted: To discharge filter backwash water and supernatant from the Cold Creek water treatment plant into the Cold Stream in the Taungatara catchment

Expiry Date: 1 June 2018

Review Date(s): June 2006, June 2012

Site Location: State Highway 45, Rahotu

Legal Description: Lot 1 DP 16088 Blk V Kaupokonui SD

Grid Reference (NZTM) 1686823E-5639646N

Catchment: Taungatara

Tributary: Cold Creek

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General conditions

- a) On receipt of a requirement from the Chief Executive, Taranaki Regional Council (hereinafter the Chief Executive), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) Unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) The consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

1. The discharge point shall be located at NZTM 1686823E- 5639646N.
2. The discharge rate shall not exceed 10 litres per second.
3. That after allowing for reasonable mixing, within a mixing zone extending 25 metres below the discharge point, the discharge shall not give rise to any of the following effects in the Cold Stream:
 - (a) the production of any conspicuous oil or grease films, scums or foams, or floatable or suspended materials;
 - (b) any conspicuous change in the colour or visual clarity;
 - (c) any emission of objectionable odour;
 - (d) the rendering of fresh water unsuitable for consumption by farm animals;
 - (e) any significant adverse effects on aquatic life, habitats, or ecology.
4. That the discharge quality shall not exceed the following limits at all times:

Suspended solids	20 gm ⁻³
pH	6.5-8.5
Free available chlorine	0.1 gm ⁻³

Consent 6077-1

5. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2006 and/or June 2012, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Transferred at Stratford on 20 February 2014

For and on behalf of
Taranaki Regional Council

A D McLay
Director-Resource Management

Land Use Consent
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: Cold Creek Community Water Supply Limited
2 Havelock Street
OPUNAKE 4616

Decision Date: 1 March 1999

Commencement Date: 1 March 1999

Conditions of Consent

Consent Granted: To erect, place, use and maintain a water intake structure on the bed of Cold Creek in the Taungatara catchment for water abstraction purposes

Expiry Date: 1 June 2018

Review Date(s): June 2001, June 2006, June 2012

Site Location: Cold Creek, Kiri Road, Opunake

Legal Description: SO 377 Pt Sec 5 Blk V Kaupokonui SD

Grid Reference (NZTM) 1686940E-5640150N

Catchment: Taungatara

Tributary: Cold Creek

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General conditions

- a) That on receipt of a requirement from the Chief Executive, Taranaki Regional Council (hereinafter the Chief Executive), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) That unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) That the consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

1. That the consent holder shall notify the Taranaki Regional Council, at least 48 hours prior to the commencement and upon completion of the initial construction, and again prior to, and upon completion of, any subsequent maintenance works which would involve disturbance of, or the deposition to the riverbed or discharges to water.
2. That the stricture(s) authorised by this consent shall be constructed generally in accordance with the documentation submitted in support of the application and shall be maintained to ensure the conditions of this consent are met.
3. That during any construction or maintenance the consent holder shall adopt the best practicable option to avoid or minimise the discharge of silt or other contaminants into the water or onto the riverbed and to avoid or minimise the disturbance of the riverbed and any adverse effects on water quality.
4. That during any construction or maintenance the consent holder shall ensure that the area and volume of riverbed disturbance shall so far as is practicable, be minimised and any areas which are disturbed, shall so far as is practicable be reinstated.
5. That during any construction or maintenance the consent holder shall ensure that any disturbance of parts of the riverbed covered by water and/or any works which may result in downstream discolouration of water shall be undertaken only between 1 November and 30 April except where this requirement is waived by the written approval of the Chief Executive, Taranaki Regional Council.
6. That structure(s) which are the subject of this consent shall not obstruct fish passage.
7. That the consent holder shall develop and undertake a monitoring programme to determine the adequacy of fish passage as deemed necessary by the Chief Executive, Taranaki Regional Council, subject to section 35(2)(d) and section 36 of the Resource Management Act 1991. This monitoring information is to be forwarded to the Chief Executive, Taranaki Regional Council, upon request.

Consent 5454-1

8. That the structure(s) authorised by this consent shall be removed and the area reinstated, if and when the structure(s) are no longer required. The consent holder shall notify the Taranaki Regional Council at least 48 hours prior to structure(s) removal and reinstatement.
9. That the Taranaki Regional Council may review any or all of the conditions of this consent by giving notice of review during the month of June 2001 and/or June 2006 and/or June 2012, for the purpose of ensuring that the conditions are adequate to deal with any significant adverse effects on the environment arising from the exercise of this consent, which either were not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Transferred at Stratford on 20 February 2014

For and on behalf of
Taranaki Regional Council

A D McLay
Director-Resource Management

Eltham water supply



Water Permit

**Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council**

PRIVATE BAG 713
47 CLOTEN ROAD
STRATFORD
NEW ZEALAND
PHONE 0-6-765 7127
FAX 0-6-765 5097

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA

Consent Granted
Date: 15 December 1999

Conditions of Consent

Consent Granted: To take and use water from the Waingongoro River for
municipal water supply purposes at or about GR:
Q20:188-014

Expiry Date: 1 June 2018

Review Date(s): June 2002, June 2006, June 2012

Site Location: Finnerty Road, Ngaere, Eltham

Legal Description: Pt 31 Lot 2 DP 2918 Blk V Ngaere SD

Catchment: Waingongoro

Consent 0213-3

General conditions

- a) That on receipt of a requirement from the General Manager, Taranaki Regional Council (hereinafter the General Manager), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) That unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) That the consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions


1. THAT the consent allows the abstraction of:
 - a) 4020 cubic metres/day [47 litres/second] on an unrestricted basis; and
 - b) 1500 cubic metres/day [17 litres/second] on a restricted basis as per condition 6.
2. THAT the consent holder shall install and maintain, to the satisfaction of the General Manager, Taranaki Regional Council, a measuring device capable of recording daily rates of abstraction and shall make such records available to the General Manager, Taranaki Regional Council, upon request.
3. THAT the exercise of this consent shall be undertaken in general accordance with the information supplied in support of application 534, particularly regarding the promotion of the efficiency of use of the water, and the installation of a telemetry system at the water treatment plant.
4. THAT the consent holder shall quantify the reticulation system losses by 31 December 2000 and report the results to the General Manger, Taranaki Regional Council, by 28 February 2001.
5. THAT the consent holder shall investigate and report on the blocking of the intake, and options for addressing this; the report to be received by the General Manager, Taranaki Regional Council, not later than 10 months from the date the consent is granted.
6. THAT the Taranaki Regional Council by the agreement of the consent holder, shall review condition 1(b), pursuant to section 128 of the Resource Management Act 1991, by giving notice of review during the month of June 2002, for the purpose of assessing the success of consent holder 5437 in implementing water conservation measures in reducing plant water use and to demonstrate a need for the water.
7. THAT by the agreement of the consent holder, the consent holder shall mitigate the effects of the abstraction by donating \$10,000 [goods and services tax exclusive] to the Taranaki Tree Trust by 31 January 2000, for the purpose of providing riparian management in the Waingongoro catchment, in the reach above the Climie Stream, and in the Climie Stream catchment.

Consent 0213-3

8. THAT the Taranaki Regional Council may review, according to section 128 of the Resource Management Act 1991, any or all of the conditions of this consent by giving notice of review during June 2002 and/or June 2006 and/or June 2012, for the purpose of ensuring that the conditions are adequate to deal with any significant adverse effects on the environment arising from the exercise of this consent, which either were not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 15 December 1999

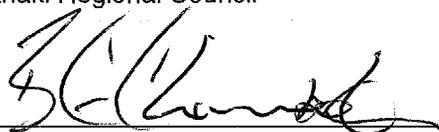For and on behalf of
Taranaki Regional Council

A handwritten signature in black ink, appearing to be 'S. Clouston', written over a horizontal line.

General Manager



Discharge Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date: 5 November 2012

Commencement
Date: 5 November 2012

Conditions of Consent

Consent Granted: To discharge reservoir contents from the Eltham Water
Supply Reservoir onto land adjacent to the Waingongoro
River at or about (NZTM) 1708817E-5639437N

Expiry Date: 1 June 2029

Review Date(s): June 2017, June 2023

Site Location: Finnerty Road Ngaere Eltham

Legal Description: Lot 1 DP 11209 Blk V Ngaere SD
(Discharge source & site)

Catchment: Waingongoro

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General condition

- a. The consent holder shall pay to the Taranaki Regional Council all the administration, monitoring and supervision costs of this consent, fixed in accordance with section 36 of the Resource Management Act 1991.

Special conditions

1. The consent holder shall at all times adopt the best practicable option, as defined in section 2 of the Resource Management Act 1991, to prevent or minimise any adverse effects on the environment from the exercise of this consent including, but not limited to, ensuring the discharge occurs over a period in excess of 4 days.
2. The consent holder shall notify the Council of the intention to discharge at least 2 working days prior to discharge occurring. Notification shall include the consent number and a brief description of the activity consented and be emailed to worknotification@trc.govt.nz.
3. The volume of the discharge shall not exceed 5000 cubic metres and shall occur no more frequently than once every calendar year.
4. The discharge shall only commence when flows in the Waingongoro River at Eltham road are greater than 1050 litres per second.
5. All reservoir contents shall be directed over land before entering the Waingongoro River. There shall be no direct discharge to the Waingongoro River.
6. The consent holder shall, as far as practicable, reduce the volume of sediment and silt in the discharge before entering the Waingongoro River, including the off-site disposal of settled solids from the bottom of the reservoir.
7. The maximum concentration of the suspended solid contained in the discharge shall not exceed 100 gm⁻³.
8. After allowing for reasonable mixing, within a mixing zone extending 100 metres downstream of the discharge point, the discharge shall not, either by itself or in combination with other discharges, give rise to any or all of the following effects in the receiving water:
 - a) the production of any conspicuous oil or grease films, scums or foams, or floatable or suspended materials;
 - b) any conspicuous change in the colour or visual clarity;
 - c) any emission of objectionable odour;
 - d) the rendering of fresh water unsuitable for consumption by farm animals;
 - e) any significant adverse effects on aquatic life.

Consent 0989-3

9. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2017 and/or June 2023, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 5 November 2012

For and on behalf of
Taranaki Regional Council

Director-Resource Management

TRK991810



DISCHARGE PERMIT

**Pursuant to the RESOURCE MANAGEMENT ACT 1991
a resource consent is hereby granted by the
Taranaki Regional Council**

PRIVATE BAG 713
47 CLOTON ROAD
STRATFORD
NEW ZEALAND
PHONE 0-6-765 7127
FAX 0-6-765 5097

Name of
Consent Holder: **SOUTH TARANAKI DISTRICT COUNCIL
PRIVATE BAG 902 HAWERA**

Renewal
Granted Date: **28 July 1999**

CONDITIONS OF CONSENT

Consent Granted: **TO DISCHARGE UP TO 2,000 CUBIC METRES/DAY [50 LITRES/SECOND] OF OVERFLOW AND RESERVOIR DRAINAGE WATER FROM THE ELTHAM WATER SUPPLY RESERVOIR INTO THE MANGAWHARAWHARA STREAM IN THE WAINGONGORO CATCHMENT AT OR ABOUT GR: Q20:220-976**

Expiry Date: **1 June 2017**

Review Date[s]: **June 2005 and June 2011**

Site Location: **ELTHAM WATER SUPPLY RESERVOIR, ANDERSON ROAD,
ELTHAM**

Legal Description: **PT SEC 10 BLK X NGAERE SD**

Catchment: **WAINGONGORO 350.000**

Tributary: **MANGAWHARAWHARA 350.040**

For General, Standard and Special Conditions pertaining to this consent please see reverse side of this document.

TRK991810

General conditions


- a) That on receipt of a requirement from the General Manager, Taranaki Regional Council (hereinafter the General Manager), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) That unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) That the consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

- 1. THAT approval shall be obtained from the General Manager, Taranaki Regional Council, prior to emptying and cleaning of the reservoir.
- 2. THAT the consent holder shall minimise the periods when this consent is exercised.
- 3. THAT the consent holder shall observe all practicable measures to minimise the discharge of accumulated sediments in the reservoir to the receiving water when emptying and cleaning the reservoir.
- 4. THAT after allowing for a mixing zone of 25 metres downstream of the discharge, the discharge shall not give rise to any of the following effects in the tributary of the Mangawharawhara Stream:
 - i) the production of any conspicuous oil or grease films, scums or foams, or floatable or suspended materials;
 - ii) any conspicuous change in the colour or visual clarity;
 - iii) any emission of objectionable odour;
 - iv) the rendering of fresh water unsuitable for consumption by farm animals;
 - v) any significant adverse effects on aquatic life.
- 5. THAT the discharge shall not exceed the following limits at all times:
 - i) suspended solids 20 gm⁻³
 - ii) free available chlorine 0.1 gm⁻³
- 6. THAT the Taranaki Regional Council may review any or all of the conditions of this consent by giving notice of review during the month of June 2005 and/or June 2011, for the purpose of ensuring that the conditions adequately deal with the environmental effects arising from the exercise of this consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 28 July 1999

For and on behalf of
TARANAKI REGIONAL COUNCIL



DIRECTOR—RESOURCE MANAGEMENT

TRK991811



DISCHARGE PERMIT

**Pursuant to the RESOURCE MANAGEMENT ACT 1991
a resource consent is hereby granted by the
Taranaki Regional Council**

PRIVATE BAG 713
47 CLOTON ROAD
STRATFORD
NEW ZEALAND
PHONE 0-6-765 7127
FAX 0-6-765 5097

Name of
Consent Holder: **SOUTH TARANAKI DISTRICT COUNCIL
PRIVATE BAG 902 HAWERA**

Renewal
Granted Date: **28 July 1999**

CONDITIONS OF CONSENT

Consent Granted: **TO DISCHARGE UP TO 220 CUBIC METRES/DAY [20 LITRES/SECOND] OF FILTER BACKWASH FROM THE ELTHAM WATER TREATMENT PLANT VIA A SETTLING POND INTO AN UNNAMED TRIBUTARY OF THE WAINGONGORO RIVER AT OR ABOUT GR: Q20:199-008**

Expiry Date: **1 June 2017**

Review Date[s]: **June 2005 and June 2011**

Site Location: **ELTHAM WATER TREATMENT PLANT, FINNERTY ROAD, NGAERE**

Legal Description: **SEC 33 PT SEC 32 BLK V NGAERE SD**

Catchment: **WAINGONGORO 350.000**

Tributary: **UNNAMED TRIBUTARY**

For General, Standard and Special Conditions pertaining to this consent please see reverse side of this document.

TRK991811

General conditions


- a) That on receipt of a requirement from the General Manager, Taranaki Regional Council (hereinafter the General Manager), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) That unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) That the consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

- 1. THAT the consent holder shall properly and efficiently maintain and operate the settlement pond system. The pond shall be cleaned out to the satisfaction of the General Manager, Taranaki Regional Council, by 16 August 1999.
- 2. THAT after allowing for a mixing zone of 25 metres downstream of the discharge, the discharge shall not give rise to any of the following effects in the tributary of the Waingongoro River:
 - i) the production of any conspicuous oil or grease films, scums or foams, or floatable or suspended materials;
 - ii) any conspicuous change in the colour or visual clarity;
 - iii) any emission of objectionable odour;
 - iv) the rendering of fresh water unsuitable for consumption by farm animals;
 - v) any significant adverse effects on aquatic life.
- 3. THAT the discharge shall not exceed the following limits at all times:
 - i) suspended solids 20 gm^{-3}
 - ii) free available chlorine 0.1 gm^{-3}
- 4. THAT the Taranaki Regional Council may review any or all of the conditions of this consent by giving notice of review during the month of June 2005 and/or June 2011, for the purpose of ensuring that the conditions adequately deal with the environmental effects arising from the exercise of this consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 28 July 1999

For and on behalf of
TARANAKI REGIONAL COUNCIL



DIRECTOR—RESOURCE MANAGEMENT

Hawera water supply

Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Change To
Conditions Date: 28 October 2008 [Granted: 7 June 2000]

Conditions of Consent

Consent Granted: To take and use water from the Kapuni Stream for
municipal water supply purposes at or about (NZTM)
1701447E-5630678N

Expiry Date: 1 June 2020

Review Date(s): June 2011

Site Location: Kapuni Stream, Palmer Road, Kapuni

Legal Description: Adjacent to Lot 1 DP 10570 & Lot 3 DP 10570 Blk XVI
Kaupokonui SD

Catchment: Kapuni

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General conditions

- a) On receipt of a requirement from the Chief Executive, Taranaki Regional Council the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) Unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) The consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

1. That the consent allows the abstraction of:
 - a) 10756.8 cubic metres/ day [124.5 litres/second] on an unrestricted basis; and
 - b) 1343.2 cubic metres/day [15.5 litres/second] on a restricted basis as per condition 4.
2. The consent holder shall install and maintain, to the satisfaction of the Chief Executive, Taranaki Regional Council, a measuring device(s) capable of recording daily rates of abstraction and shall make such records available to the Chief Executive, Taranaki Regional Council, on a monthly basis.

Condition 3 [changed]

3. The exercise of this consent shall be undertaken in general accordance with the information supplied in support of applications 533 and 6128, particularly regarding the promotion of the efficiency of use of the water and reporting on efficiency measures every two years from the commencement of this consent.

Conditions 4 to 7 [unchanged]

4. That the water available under condition 1(b) shall only be used for those times where peak demand exceeds 124.5 litres/second. On each occasion that condition 1(b) is exercised, the consent holder shall, within seven days of the reduction of demand below 124.5 litres/second, provide a written report to the Chief Executive, Taranaki Regional Council, detailing the volumes of water abstracted, the time period during which the abstraction exceeded 124.5 litres/second, and the conservation measures adopted during that time.

Consent 0146-2

5. That, by the agreement of the consent holder, the consent holder shall mitigate the effects of the abstraction by donating a minimum amount of \$3,150 and a maximum of \$12,000 per annum [GST exclusive and inflation adjusted], with a total contribution not to exceed \$63,000 [GST exclusive and inflation adjusted] to the Taranaki Tree Trust, for the purpose of providing riparian management in the Kapuni Stream and its tributaries, preferably above Skeet Road.
6. The consent holder shall prepare and subsequently update and maintain a management plan for the Kapuni Stream between GR's: Q20:116-928 and Q20: 110-913, in conjunction with the other users, including but not restricted to the Natural Gas Corporation of New Zealand Limited and Petrochem Limited, to manage the abstraction of water from and discharge of contaminants to the Kapuni Stream. The management plan shall be submitted to the Chief Executive, Taranaki Regional Council, for approval within three months of the granting of the consent.
7. The consent holder shall undertake a leak detection and repair programme throughout the term of the consent within Hawera, Normanby, Okaiawa and Ohawe Beach townships and report on this programme annually to the Chief Executive, Taranaki Regional Council.

Condition 8 [new]

8. The point of abstraction shall remain at its current location [at or about GR: Q20:115-925 NZMSG] until the new intake to be constructed pursuant to resource consent 7413-1 is commissioned. At that time the point of abstraction shall be at the new intake [at or about 1701447E-5630678N NZTM].

Condition 9 [changed, previously condition 8]

9. The Taranaki Regional Council may review, according to section 128 of the Resource Management Act 1991, any or all of the conditions of this consent by giving notice of review during June 2011, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this consent, which either were not foreseen at the time the application was considered or which it was not appropriate to deal with at the time, and for the purpose of assessing the implementation of the leak detection and repair programme specified in condition 7.

Signed at Stratford on 28 October 2008

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Discharge Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4800

Change To
Conditions Date: 1 February 2007 [Granted: 26 January 2006]

Conditions of Consent

Consent Granted: To discharge up to 227 cubic metres/day of settling pond supernatant from a water treatment plant into the Kapuni Stream at or about GR: Q20:112-916

Expiry Date: 1 June 2023

Review Date(s): June 2008, June 2011, June 2017

Site Location: Palmer Road, Kapuni

Legal Description: Lot 2 DP 3675 Lot 2 DP 10737 Lot 2 DP 15107 Blk XVI
Kaupokonui SD

Catchment: Kapuni

General conditions

- a) On receipt of a requirement from the Chief Executive, Taranaki Regional Council the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) Unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) The consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

Conditions 1 to 3 – unchanged

1. The consent holder shall at all times adopt the best practicable option, as defined in section 2 of the Resource Management Act 1991, to prevent or minimise any adverse effects on the environment from the exercise of this consent.
2. The exercise of this consent shall be undertaken generally in accordance with the documentation submitted in support of application 4516. In the case of any contradiction between the documentation submitted in support of application 4516 and the conditions of this consent, the conditions of this consent shall prevail.
3. The consent holder shall notify the Chief Executive, Taranaki Regional Council, in writing at least seven days prior to the exercise of this consent.

Condition 4 – changed

4. The consent holder shall address the issue of a permanent solution for water treatment residuals with the construction of a new water treatment plant, planned for 2010.

Condition 5 to 9 – unchanged

5. The consent holder shall properly and efficiently maintain and operate the settlement facility to the general satisfaction of the Chief Executive, Taranaki Regional Council.
6. After allowing for a mixing zone of 25 metres downstream of the discharge, the discharge shall not give rise to any of the following effects in the Kapuni Stream:

Consent 0933-3

- i) the production of any conspicuous oil or grease films, scums or foams, or floatable or suspended materials;
- ii) any conspicuous change in the colour or visual clarity;
- iii) any emission of objectionable odour;
- iv) the rendering of fresh water unsuitable for consumption by farm animals; and
- v) any significant adverse effects on aquatic life.

7. The discharge quality shall not exceed the following limits at all times:

Component	Concentration
suspended solids	20 g/m ³
free available chlorine	0.1 g/m ³
pH	6.5 - 8.5

8. This consent shall lapse on the expiry of five years after the date of issue of this consent, unless the consent is given effect to before the end of that period or the Taranaki Regional Council fixes a longer period pursuant to section 125(1)(b) of the Resource Management Act 1991.
9. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2008 and/or June 2011 and/or June 2017, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 1 February 2007

For and on behalf of
Taranaki Regional Council

Director-Resource Management



Land Use Consent
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4800

Change To
Conditions Date: 1 February 2007 [Granted: 19 May 2000]

Conditions of Consent

Consent Granted: To construct, place, use and maintain a weir and intake structure, and to maintain two existing intake structures in the Kapuni Stream for the Hawera water supply at or about GR: Q20:115-925

Expiry Date: 1 June 2017

Review Date(s): June 2005, June 2011

Site Location: Palmer Road, Kaponga

Legal Description: Crown land adjoining Lot 1 & Lot 2 DP 10570 Blk XVI
Kaupokonui SD

Catchment: Kapuni

General conditions

- a) On receipt of a requirement from the Chief Executive, Taranaki Regional Council the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) Unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) The consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.



Special conditions

Conditions 1 to 12 – unchanged

- 1. The consent holder shall notify the Taranaki Regional Council at least 48 hours prior to the commencement and upon completion of the initial construction and again prior to and upon completion of any subsequent maintenance works which would involve the disturbance of or deposition to the streambed or discharges to water.
- 2. The structures authorised by this consent shall be constructed generally in accordance with the documentation submitted in support of the application, and with the finalised engineering diagrams, and shall be maintained to ensure the conditions of this consent are met.
- 3. The structure authorised by this consent shall not be constructed during the period 1 May to 31 October.
- 4. The consent holder shall adopt the best practicable option to avoid or minimise the discharge of silt or other contaminants into water or onto the streambed and to avoid or minimise the disturbance of the streambed and any adverse effects on water quality.
- 5. The consent holder shall ensure that the area and volume of streambed disturbance shall, so far as is practicable, be minimised and any areas which are disturbed shall, so far as is practicable, be reinstated.
- 6. No refuelling of equipment or machinery shall take place on any area of the streambed.
- 7. The structures authorised by this consent shall be constructed so as not to obstruct the passage of fish.
- 8. The consent holder shall maintain, at all times, a sufficient flow down the fish pass to ensure that the passage of fish is not restricted.

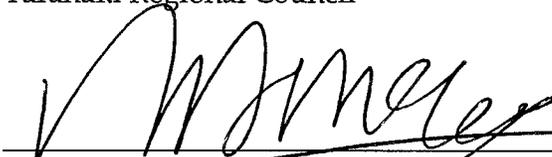
9. The structures authorised by this consent shall be constructed so as not to cause any erosion adjacent to or downstream of the rock riprap ramp.
10. That in the construction of the weir and intake structure the applicant shall extract from the streambed only the material that makes up the existing weir/rock ramp.
11. Any removal of streambed material from above the new weir and intake structure for maintenance purposes shall only occur between 1 November and 30 April.
12. Streambed material removed pursuant to condition 11 shall be placed on dry sections of the streambed or on the banks of the stream downstream of the weir and intake structure in such a way that it can re-enter the stream while minimising adverse effects on the stream.

Condition 13 and 14 [previously condition 14 and 15] - unchanged

13. The structures authorised by this consent shall be removed and the area reinstated, if and when the structures are no longer required. The consent holder shall notify the Taranaki Regional Council at least 48 hours prior to the structure[s] removal and reinstatement.
14. That the Taranaki Regional Council may review any or all of the conditions of this consent by giving notice of review during June 2011, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this consent, which either were not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 1 February 2007

For and on behalf of
Taranaki Regional Council



Director-Resource Management



Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Change To
Conditions Date: 10 February 2009 [Granted: 2 November 2006]

Conditions of Consent

Consent Granted: To take and use up to 4,320 m³/day of groundwater at a maximum rate of 50 l/s as a combined total from up to three water bores in a bore field at the Kapuni reservoir site for municipal, rural, industrial, and recreational supply purposes at or about (NZTM) 1701067E-5629178N

Expiry Date: 1 June 2023

Review Date(s): June 2011, June 2017

Site Location: Kapuni reservoir site, off 1054 Skeet Road, Kapuni

Legal Description: Lot 2 DP 6410 Blk XVI Kaupokonui SD

Catchment: Kapuni

General conditions

- a) On receipt of a requirement from the Chief Executive, Taranaki Regional Council the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) Unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) The consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

Condition 1 to 6 [unchanged]

1. The exercise of this consent shall be undertaken in general accordance with the documentation submitted in support of application 4419 and shall ensure the efficient and effective use of water. In the case of any contradiction between the documentation submitted in support of application 4419 and the conditions of this consent, the conditions of this consent shall prevail.
2. The consent holder shall notify the Chief Executive, Taranaki Regional Council, in writing at least seven days prior to the exercise of this consent.
3. Prior to the exercise of this consent, the consent holder shall provide a report to Chief Executive, Taranaki Regional Council, detailing the results of pump testing (72-hour constant discharge at 50 l/s and recovery tests) of the bores used for water supply to show (1) that the abstraction is sustainable, and (2) the effects of the abstraction on flows in the Kapuni Stream.
4. The volume of groundwater abstracted shall not exceed 4,320 cubic metres per day at a rate not exceeding 50 litres per second as a combined total from the bores in the bore field.
5. The abstraction shall not cause more than a 10% lowering of the static water level by interference in any adjacent registered water bore located beyond the boundary of the bore field.
6. The consent holder shall maintain daily records of the abstraction from each bore including date, abstraction rate and daily volume, and pumping hours, and make these records available to the Chief Executive, Taranaki Regional Council, no later than 31 July of each year, or upon request.

Condition 7 [previously condition 8]

7. The consent holder shall install and maintain a measuring device approved by the Chief Executive, Taranaki Regional Council, on each bore for the purposes of accurately recording the abstraction of water.

Condition 8 [previously condition 9]

8. This consent shall be subject to monitoring by the Taranaki Regional Council and the consent holder shall meet all reasonable costs associated with the monitoring.

Condition 9 [previously condition 10]

9. This consent shall lapse on the expiry of five years after the date of commencement of this consent, unless the consent is given effect to before the end of that period or the Taranaki Regional Council fixes a longer period pursuant to section 125(1)(b) of the Resource Management Act 1991.

Condition 10 [previously condition 11]

10. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2011 and/or June 2017, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 10 February 2009

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Land Use Consent
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Consent Granted
Date: 5 February 2009

Conditions of Consent

Consent Granted: To erect, use and maintain a water intake structure on the bed of the Kapuni Stream, including temporary damming and diversion during construction at or about (NZTM) 1701447E-5630678N

Expiry Date: 1 June 2023

Review Date(s): June 2011, June 2017

Site Location: Kapuni Stream, Palmer Road, Kapuni

Legal Description: Lot 1 DP 10570 Lot 1 DP 3675 Lot 3 DP 10570 Blk XVI
Kaupokonui SD

Catchment: Kapuni

Consent 7413-1

General conditions

- a) On receipt of a requirement from the Chief Executive, Taranaki Regional Council the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) Unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) The consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

1. The exercise of this consent shall be undertaken in accordance with the documentation submitted in support of application 6131, in particular Drawing No. 80066/19. If there is any conflict between the documentation submitted in support of application 6131 and the conditions of this consent, the conditions of this consent shall prevail.
2. Any disturbance of parts of the riverbed covered by water and/or any works which may result in downstream discolouration of water shall be undertaken only between 1 November and 30 April, except where this requirement is waived in writing by the Chief Executive, Taranaki Regional Council.
3. The consent holder shall notify the Chief Executive, Taranaki Regional Council, in writing at least 48 hours prior to the commencement and upon completion of the initial installation and again at least 48 hours prior to and upon completion of any subsequent maintenance works which would involve disturbance of or deposition to the riverbed or discharges to water. Notification shall include the consent number and a brief description of the activity consented and be emailed to worknotification@trc.govt.nz. Notification by fax or post is acceptable only if the consent holder does not have access to email.
4. The consent holder shall ensure that the area and volume of riverbed disturbance shall, so far as is practicable, be minimised and any areas which are disturbed shall, so far as is practicable, be reinstated.
5. The consent holder shall take all reasonable steps to:
 - a. minimise the amount of sediment discharged to the stream;
 - b. minimise the amount of sediment that becomes suspended in the stream; and
 - c. mitigate the effects of any sediment in the stream.

Undertaking work in accordance with *Guidelines for Earthworks in the Taranaki Region*, by the Taranaki Regional Council, will achieve compliance with this condition.

Consent 7413-1

6. Except with the written agreement of the Chief Executive, Taranaki Regional Council, the structure authorised by this consent shall be removed and the area reinstated, if and when the structure is no longer required. A further resource consent may be required to authorise the removal of the structure, and the consent holder is advised to seek advice from the Council on this matter.
7. The consent holder shall monitor and maintain the fish pass, to ensure it performs as designed and allows for the effective passage of fish.
8. In the event that any archaeological remains are discovered as a result of works authorised by this consent, the works shall cease immediately at the affected site and tangata whenua and the Chief Executive, Taranaki Regional Council, shall be notified within one working day. Works may recommence at the affected area when advised to do so by the Chief Executive, Taranaki Regional Council. Such advice shall be given after the Chief Executive has considered: tangata whenua interest and values, the consent holder's interests, the interests of the public generally, and any archaeological or scientific evidence. The New Zealand Police, Coroner, and Historic Places Trust shall also be contacted as appropriate, and the work shall not recommence in the affected area until any necessary statutory authorisations or consents have been obtained.
9. This consent shall lapse on 31 March 2014, unless the consent is given effect to before the end of that period or the Taranaki Regional Council fixes a longer period pursuant to section 125(1)(b) of the Resource Management Act 1991.
10. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2011 and/or June 2017, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 5 February 2009

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Land Use Consent
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Consent Granted
Date: 20 February 2009

Conditions of Consent

Consent Granted: To install, use and maintain an outfall structure on the bank of the Kapuni Stream for the Kapuni Water Treatment Plant at or about (NZTM) 1700804E-5628910N

Expiry Date: 1 June 2023

Review Date(s): June 2011, June 2017

Site Location: Skeet Road, Kapuni

Legal Description: Lot 1 DP 18183 Blk XVI Kaupokonui SD

Catchment: Kapuni

General conditions

- a) On receipt of a requirement from the Chief Executive, Taranaki Regional Council the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) Unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) The consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

1. The exercise of this consent shall be undertaken in accordance with the documentation submitted in support of application 6202, in particular Drawing No. 0652C010. If there is any conflict between the documentation submitted in support of application 6202 and the conditions of this consent, the conditions of this consent shall prevail.
2. Any disturbance of parts of the riverbed covered by water and/or any works which may result in downstream discolouration of water shall be undertaken only between 1 November and 30 April, except where this requirement is waived in writing by the Chief Executive, Taranaki Regional Council.
3. The consent holder shall notify the Chief Executive, Taranaki Regional Council, in writing at least 48 hours prior to the commencement and upon completion of the initial installation and again at least 48 hours prior to and upon completion of any subsequent maintenance works which would involve disturbance of or deposition to the riverbed or discharges to water. Notification shall include the consent number and a brief description of the activity consented and be emailed to worknotification@trc.govt.nz. Notification by fax or post is acceptable only if the consent holder does not have access to email.
4. The consent holder shall ensure that the area and volume of riverbed disturbance shall, so far as is practicable, be minimised and any areas which are disturbed shall, so far as is practicable, be reinstated.
5. The consent holder shall take all reasonable steps to:
 - a. minimise the amount of sediment discharged to the stream;
 - b. minimise the amount of sediment that becomes suspended in the stream; and
 - c. mitigate the effects of any sediment in the stream.

Undertaking work in accordance with *Guidelines for Earthworks in the Taranaki Region*, by the Taranaki Regional Council, will achieve compliance with this condition.

Consent 7447-1

6. Except with the written agreement of the Chief Executive, Taranaki Regional Council, the structure authorised by this consent shall be removed and the area reinstated, if and when the structure is no longer required. A further resource consent may be required to authorise the removal of the structure, and the consent holder is advised to seek advice from the Council on this matter.
7. In the event that any archaeological remains are discovered as a result of works authorised by this consent, the works shall cease immediately at the affected site and tangata whenua and the Chief Executive, Taranaki Regional Council, shall be notified within one working day. Works may recommence at the affected area when advised to do so by the Chief Executive, Taranaki Regional Council. Such advice shall be given after the Chief Executive has considered: tangata whenua interest and values, the consent holder's interests, the interests of the public generally, and any archaeological or scientific evidence. The New Zealand Police, Coroner, and Historic Places Trust shall also be contacted as appropriate, and the work shall not recommence in the affected area until any necessary statutory authorisations or consents have been obtained.
8. This consent shall lapse on 31 March 2014, unless the consent is given effect to before the end of that period or the Taranaki Regional Council fixes a longer period pursuant to section 125(1)(b) of the Resource Management Act 1991.
9. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2011 and/or June 2017, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 20 February 2009

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Inaha water supply

Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date (Change): 29 May 2014

Commencement Date (Change): 29 May 2014 (Granted: 29 August 2006)

Conditions of Consent

Consent Granted: To take water from the Mangatoki Stream in the Waingongoro catchment for Inaha rural water supply purposes

Expiry Date: 01 June 2023

Review Date(s): June 2018

Site Location: Inaha water supply, 1551 Upper Palmer Road, Mahoe

Legal Description: Sec 24 Blk VII Kaupokonui SD Lot 2 DP 421857 Blk VIII Kaupokonui SD (Site of take)

Grid Reference (NZTM) 1700531E-5642453N and 1700921E-5641908N

Catchment: Waingongoro

Tributary: Mangatoki

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General condition

- a) On receipt of a requirement from the Chief Executive, Taranaki Regional Council the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) Unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) The consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

1. The consent holder shall at all times adopt the best practicable option, as defined in section 2 of the Resource Management Act 1991, to prevent or minimise any adverse effects on the environment from the exercise of this consent.
2. The combined rate of taking shall not exceed 29 litres per second, and the volume taken in any 24 hour period ending at midnight (New Zealand Standard Time) shall not exceed 2504 cubic metres.
3. The consent holder shall use the gravity take preferentially over the pumped take. The pumped take may be used exclusively only when the gravity take is not operational due to maintenance, capital works or flood damage.
4. Before exercising this consent the consent holder shall install, and thereafter maintain a water meter and a datalogger at the site of taking (or a nearby site in accordance with Regulation 10 of the *Resource Management (Measurement and Reporting of Water Takes) Regulations 2010*. The water meter and datalogger shall be tamper-proof and shall measure and record the rate and volume of water taken to an accuracy of $\pm 5\%$. Records of the date, the time and the rate and volume of water taken at intervals not exceeding 15 minutes, shall be made available to the Chief Executive, Taranaki Regional Council at all reasonable times.

Note: Water meters and dataloggers must be installed, and regularly maintained, in accordance with manufacturer's specifications in order to ensure that they meet the required accuracy. Even with proper maintenance water meters and dataloggers have a limited lifespan.

Consent 1185-3.1

5. The consent holder shall provide the Chief Executive, Taranaki Regional Council with a document from a suitably qualified person certifying that water measuring and recording equipment required by the conditions of this consent ('the equipment'):
 - (a) has been installed and/or maintained in accordance with the manufacturer's specifications; and/or
 - (b) has been tested and shown to be operating to an accuracy of $\pm 5\%$.The documentation shall be provided:
 - (i) within 30 days of the installation of a water meter or datalogger;
 - (ii) at other times when reasonable notice is given and the Chief Executive, Taranaki Regional Council has reasonable evidence that the equipment may not be functioning as required by this consent; and
 - (iii) no less frequently than once every five years.
6. If any measuring or recording equipment breaks down, or for any reason is not operational, the consent holder shall advise the Chief Executive, Taranaki Regional Council immediately. Any repairs or maintenance to this equipment must be undertaken by a suitably qualified person.
7. The intake structures shall be maintained to the satisfaction of the Chief Executive, Taranaki Regional Council. Once the abstraction licensed by this consent is no longer required, the consent holder shall remove the intake structure to the satisfaction of the Chief Executive, Taranaki Regional Council.
8. The water meter and datalogger shall be accessible to Taranaki Regional Council officers at all reasonable times for inspection and/or data retrieval. In addition the data logger shall be designed and installed so that Council officers can readily verify that it is accurately recording the required information.
9. The records of water taken shall:
 - (a) be in a format that, in the opinion of the Chief Executive, Taranaki Regional Council, is suitable for auditing;
 - (b) specifically record the water taken as 'zero' when no water is taken.
10. That measurements made in accordance with condition 4 be transmitted to Taranaki Regional Councils computer system to maintain "real time" records of the water taken, with a delay of no more than 2 hours.
11. The intake structures shall be screened to avoid the entrainment of fish.
12. The intake structure shall be maintained and operated so that the passage of fish is not obstructed.

Consent 1185-3.1

13. The consent holder shall promote the efficient use of water and undertake a leak detection and repair programme through out the term of the consent for the Inaha Water Supply Scheme and report on this programme annually for the duration of this consent.
14. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2011 and/or June 2018 for the purposes of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 29 May 2014

For and on behalf of
Taranaki Regional Council

A D McLay
Director - Resource Management

Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Chief Executive
Private Bag 902
HAWERA 4800

Consent Granted
Date: 29 August 2006

Conditions of Consent

Consent Granted: To take water from the Waingongoro River for Inaha rural
water supply purposes at or about GR: Q20:104-070

Expiry Date: 1 June 2023

Review Date(s): June 2011, June 2018

Site Location: Inaha Water Supply, Upper Palmer Road, Mahoe

Legal Description: Sec 15 Blk VIII Kaupokonui SD

Catchment: Waingongoro

General conditions

- a) On receipt of a requirement from the Chief Executive, Taranaki Regional Council the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) Unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) The consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

1. The consent holder shall at all times adopt the best practicable option, as defined in section 2 of the Resource Management Act 1991, to prevent or minimise any adverse effects on the environment from the exercise of this consent.
2. The exercise of this consent shall be undertaken generally in accordance with the documentation submitted in support of application 3450. In the case of any contradiction between the documentation submitted in support of application 3450 and the conditions of this consent, the conditions of this consent shall prevail.
3. The volume of water abstracted shall not exceed 2,592 cubic metres/day at a rate not exceeding 30 litres/second.
4. The consent holder shall install and operate a measuring device capable of accurately recording daily rates of abstraction and shall measure, record and make such records available to the Chief Executive, Taranaki Regional Council, upon request.
5. The intake structure shall be maintained to the satisfaction of the Chief Executive, Taranaki Regional Council. Once the abstraction licensed by this consent is no longer required, the consent holder shall remove the intake structure to the satisfaction of the Chief Executive, Taranaki Regional Council.
6. All intake structures shall be screened to avoid the entrainment of fish.
7. The intake structure shall be maintained and operated so that the passage of fish is not obstructed.
8. The consent holder shall promote the efficient use of water and undertake a leak detection and repair programme throughout the term of the consent for the Inaha Water Supply Scheme and report on this programme annually for the duration of this consent.

Consent 1186-3

9. This consent shall lapse on the expiry of five years after the date of issue of this consent, unless the consent is given effect to before the end of that period or the Taranaki Regional Council fixes a longer period pursuant to section 125(1)(b) of the Resource Management Act 1991.
10. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2011 and/or June 2018, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 29 August 2006

For and on behalf of
Taranaki Regional Council

Director-Resource Management

SURRENDERED

29-05-2014

TRK985364



PRIVATE BAG 713
47 CLOTON ROAD
STRATFORD
NEW ZEALAND
PHONE 0-6-765 7127
FAX 0-6-765 5097

WATER PERMIT

**Pursuant to the RESOURCE MANAGEMENT ACT 1991
a resource consent is hereby granted by the
Taranaki Regional Council**

Name of
Consent Holder: SOUTH TARANAKI DISTRICT COUNCIL
PRIVATE BAG 902 HAWERA

Consent
Granted Date: 23 September 1998

CONDITIONS OF CONSENT

Consent Granted: TO TAKE AND USE WATER FROM THE MANGATOKI
STREAM FOR INAHA RURAL WATER SUPPLY SCHEME
PURPOSES AT OR ABOUT GR: Q20:109-037

Expiry Date: 1 June 2017

Review Date[s]: June 2005 and June 2011

Site Location: MANGATOKI STREAM, PALMER ROAD, MAHOE

Legal Description: PT SECS 3 & 4 BLOCK VIII KAUPOKONUI SD

Catchment: WAINGONGORO 350.000

Tributary: MANGATOKI 350.010

For General, Standard and Special Conditions pertaining to this consent please see reverse side of this document.

TRK985364

General conditions

- a) That on receipt of a requirement from the General Manager, Taranaki Regional Council (hereinafter the General Manager), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) That unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) That the consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

1. THAT the abstraction volume shall not exceed 1,382 m³/day and the abstraction rate shall not exceed 16 litres/second.
2. THAT the consent holder shall maintain, to the satisfaction of the General Manager, Taranaki Regional Council, a measuring device capable of recording daily rates of abstraction and shall make such records available to the General Manager, Taranaki Regional Council, upon request.
3. THAT the exercise of this consent shall be undertaken in general accordance with the information supplied in support of application 393, particularly regarding the promotion of the efficiency of use of the water.
4. THAT the consent holder shall mitigate the effects of the abstraction through riparian management in the Mangatoki Stream catchment, to the satisfaction of the General Manager, Taranaki Regional Council.
5. THAT the Taranaki Regional Council reserves the right to temporarily suspend or reduce the abstraction during extreme low flow events, in order to protect the biological communities in the stream, in accordance with 329 of the Resource Management Act 1991.
6. THAT the Taranaki Regional Council may review any or all of the conditions of this consent by giving notice of review during the month of June 2005 and/or June 2011, for the purpose of ensuring that the conditions adequately deal with the environmental effects arising from the exercise of this consent, which were not foreseen at the time the application was considered and which it was not appropriate to deal with at that time.

Signed at Stratford on 23 September 1998

For and on behalf of
TARANAKI REGIONAL COUNCIL



GENERAL MANAGER

TRK993927



DISCHARGE PERMIT

**Pursuant to the RESOURCE MANAGEMENT ACT 1991
a resource consent is hereby granted by the
Taranaki Regional Council**

PRIVATE BAG 713
47 CLOTON ROAD
STRATFORD
NEW ZEALAND
PHONE 0-6-765 7127
FAX 0-6-765 5097

Name of
Consent Holder: SOUTH TARANAKI DISTRICT COUNCIL
PRIVATE BAG 902 HAWERA

Renewal
Granted Date: 4 June 1999

CONDITIONS OF CONSENT

Consent Granted: TO DISCHARGE UP TO 228 CUBIC METRES/DAY OF
BACKWASH WASTES FROM THE INAHA RURAL WATER
SUPPLY TREATMENT PLANT INTO AN UNNAMED
TRIBUTARY OF THE MANGATOKI STREAM IN THE
WAINGONGORO CATCHMENT AT OR ABOUT GR:
Q20:110-030

Expiry Date: 1 June 2017

Review Date[s]: June 2005 and June 2011

Site Location: INAHA WATER TREATMENT PLANT, PALMER ROAD, MAHOE

Legal Description: PT SEC 3 BLK VIII KAUPOKONUI SD

Catchment: WAINGONGORO 350.000

Tributary: MANGATOKI 350.010
UNNAMED TRIBUTARY

For General, Standard and Special Conditions pertaining to this consent please see reverse side of this document.

TRK993927

General conditions

- a) That on receipt of a requirement from the General Manager, Taranaki Regional Council (hereinafter the General Manager), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) That unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) That the consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

- 1. THAT the consent holder shall properly and efficiently maintain and operate the settlement pond system.
- 2. THAT after allowing for a mixing zone of 25 metres downstream of the discharge, the discharge shall not give rise to any of the following effects in the tributary of the Mangatoki Stream:
 - i) the production of any conspicuous oil or grease films, scums or foams, or floatable or suspended materials;
 - ii) any conspicuous change in the colour or visual clarity;
 - iii) any emission of objectionable odour;
 - iv) the rendering of fresh water unsuitable for consumption by farm animals; and
 - v) any significant adverse effects on aquatic life.
- 3. THAT the discharge quality shall not exceed the following limits at all times:

suspended solids	20	gm ⁻³
free available chlorine	0.1	gm ⁻³
- 4. THAT the Taranaki Regional Council may review any or all of the conditions of this consent by giving notice of review during the month of June 2005 and/or June 2011, for the purpose of ensuring that the conditions adequately deal with the environmental effects arising from the exercise of this consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 4 June 1999

For and on behalf of
TARANAKI REGIONAL COUNCIL



DIRECTOR—RESOURCE MANAGEMENT

TRK993928



DISCHARGE PERMIT

Pursuant to the **RESOURCE MANAGEMENT ACT 1991**
a resource consent is hereby granted by the
Taranaki Regional Council

PRIVATE BAG 713
47 CLOTON ROAD
STRATFORD
NEW ZEALAND
PHONE 0-6-765 7127
FAX 0-6-765 5097

Name of Consent Holder: **SOUTH TARANAKI DISTRICT COUNCIL
PRIVATE BAG 902 HAWERA**

Renewal Granted Date: **4 June 1999**

CONDITIONS OF CONSENT

Consent Granted: **TO DISCHARGE UP TO 3,060 CUBIC METRES/DAY OF UNCONTAMINATED OVERFLOW WATER FROM THE INAHA RURAL WATER SUPPLY TREATMENT PLANT VIA A SETTLEMENT POND INTO AN UNNAMED TRIBUTARY OF THE MANGATOKI STREAM AND THEN INTO THE MANGATOKI STREAM IN THE WAINGONGORO CATCHMENT AT OR ABOUT GR: Q20:110-030 and Q20:109-036**

Expiry Date: **1 June 2017**

Review Date[s]: **June 2005 and June 2011**

Site Location: **INAHWA WATER TREATMENT PLANT, PALMER ROAD, MAHOE**

Legal Description: **PT SEC 3 BLK VIII KAUPOKONUI SD**

Catchment: **WAINGONGORO 350.000**

Tributary: **MANGATOKI 350.010
UNNAMED TRIBUTARY**

For General, Standard and Special Conditions pertaining to this consent please see reverse side of this document.

TRK993928

General conditions

- a) That on receipt of a requirement from the General Manager, Taranaki Regional Council (hereinafter the General Manager), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) That unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) That the consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

1. THAT the consent holder shall properly and efficiently maintain and operate the settlement pond system.
2. THAT after allowing for a mixing zone of 25 metres downstream of the discharge, the discharge shall not give rise to any of the following effects in the receiving waters:
 - i) the production of any conspicuous oil or grease films, scums or foams, or floatable or suspended materials;
 - ii) any conspicuous change in the colour or visual clarity;
 - iii) any emission of objectionable odour;
 - iv) the rendering of fresh water unsuitable for consumption by farm animals; and
 - v) any significant adverse effects on aquatic life.
3. THAT the Taranaki Regional Council may review any or all of the conditions of this consent by giving notice of review during the month of June 2005 and/or June 2011, for the purpose of ensuring that the conditions adequately deal with the environmental effects arising from the exercise of this consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 4 June 1999

For and on behalf of
TARANAKI REGIONAL COUNCIL



DIRECTOR - RESOURCE MANAGEMENT



Land Use Consent
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

CHIEF EXECUTIVE
PRIVATE BAG 713
47 CLOTEN ROAD
STRATFORD
NEW ZEALAND
PHONE: 06-765 7127
FAX: 06-765 5097
www.trc.govt.nz

Please quote our file number
on all correspondence

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA

Consent Granted
Date: 15 June 2005

Conditions of Consent

Consent Granted: To maintain an existing low-level weir and fish pass across
the Mangatoki Stream in the Waingongoro catchment at or
about GR: Q20:105-042

Expiry Date: 1 June 2023

Review Date(s): June 2011, June 2017

Site Location: Inaha Intake Site, Palmer Road, Mahoe, Stratford

Legal Description: Sec 24 Blk VII Kaupokonui SD

Catchment: Waingongoro

Tributary: Mangatoki

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

www.trc.govt.nz

Working with people • Caring for our environment

Consent 4102-2

General conditions

- a) On receipt of a requirement from the Chief Executive, Taranaki Regional Council the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) Unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) The consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

1. The consent holder shall at all times adopt the best practicable option, as defined in section 2 of the Resource Management Act 1991, to prevent or minimise any adverse effects on the environment from the exercise of this consent.
2. The exercise of this consent shall be undertaken generally in accordance with the documentation submitted in support of application 3451. In the case of any contradiction between the documentation submitted in support of application 3451 and the conditions of this consent, the conditions of this consent shall prevail.
3. The consent holder shall notify the Chief Executive, Taranaki Regional Council, in writing at least seven days prior to the exercise of this consent.
4. The consent holder shall notify the Chief Executive, Taranaki Regional Council, at least 48 hours prior to any maintenance works of the structure[s] or fish pass licensed by this consent which would involve disturbance of, or deposition to, the streambed or discharges to water.
5. The consent holder, during any maintenance works, shall adopt the best practicable option to avoid or minimise the discharge of silt or other contaminants into water or onto the streambed and to avoid or minimise the disturbance of the streambed and any adverse effects on water quality.
6. The consent holder, during any maintenance, shall ensure that the area and volume of river bed disturbance shall, so far as practicable, be minimised and any areas which are disturbed shall, so far as practicable, be reinstated.
7. No maintenance work shall be conducted during the period 1 May to 31 October unless waived in writing by the Chief Executive, Taranaki Regional Council.
8. The structure[s] authorised by this consent shall be maintained to ensure the conditions of this consent are met.

Consent 4102-2

9. The structure[s] authorised by this consent shall be constructed and maintained so as not to restrict the passage of native fish and trout, to the satisfaction of the Chief Executive, Taranaki Regional Council.
10. The structure[s] authorised by this consent shall be removed and the area reinstated, if and when the structure is no longer required. The consent holder shall notify the Taranaki Regional Council at least 48 hours prior to the removal of the structures and reinstatement of the area
11. This consent shall lapse on the expiry of five years after the date of issue of this consent, unless the consent is given effect to before the end of that period or the Taranaki Regional Council fixes a longer period pursuant to section 125(1)(b) of the Resource Management Act 1991.
12. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2011 and/or June 2017, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 15 June 2005

For and on behalf of
Taranaki Regional Council



Director-Resource Management

TRK985365



PRIVATE BAG 713
47 CLOTEN ROAD
STRATFORD
NEW ZEALAND
PHONE 0-6-765 7127
FAX 0-6-765 5097

LAND USE CONSENT

**Pursuant to the RESOURCE MANAGEMENT ACT 1991
a resource consent is hereby granted by the
Taranaki Regional Council**

Name of
Consent Holder: **SOUTH TARANAKI DISTRICT COUNCIL
PRIVATE BAG 902 HAWERA**

Consent
Granted Date: **23 September 1998**

CONDITIONS OF CONSENT

Consent Granted: **TO ERECT, PLACE AND MAINTAIN A LOW LEVEL INTAKE
WEIR IN THE MANGATOKI STREAM FOR INAHA RURAL
WATER SUPPLY SCHEME PURPOSES AT OR ABOUT GR:
Q20:109-037**

Expiry Date: **1 June 2017**

Review Date[s]: **June 2005 and June 2011**

Site Location: **MANGATOKI STREAM, PALMER ROAD, MAHOE**

Legal Description: **PT SECS 3 & 4 BLK VIII KAUPOKONUI SD**

Catchment: **WAINGONGORO 350.000**

Tributary: **MANGATOKI 350.010**

For General, Standard and Special Conditions pertaining to this consent please see reverse side of this document.

TRK985365

General conditions

- a) That on receipt of a requirement from the General Manager, Taranaki Regional Council (hereinafter the General Manager), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) That unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) That the consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

- 1. THAT the consent holder shall notify the Taranaki Regional Council at least 48 hours prior to, and upon completion of, any major construction or maintenance works which might involve disturbance of, or discharges to, the stream.
- 2. THAT during any construction or maintenance work, the consent holder shall observe every practicable measure to prevent the discharge or placement of silt and/or organics and/or any other contaminant into the stream.
- 3. THAT any works or structure which are the subject of this consent shall not obstruct fish passage.
- 4. THAT the construction and maintenance of the weir shall be undertaken in general accordance with the information supplied in support of application 394.
- 5. THAT it is the responsibility of the consent holder to maintain and operate a safe structure, and the Taranaki Regional Council accepts no responsibility in this regard.
- 6. THAT the consent holder shall remove the weir and reinstate the area to a satisfactory standard, if and when the weir is no longer required.
- 7. THAT the Taranaki Regional Council may review any or all of the conditions of this consent by giving notice of review during the month of June 2005 and/or June 2011, for the purpose of ensuring that the conditions adequately deal with the environmental effects arising from the exercise of this consent, which were not foreseen at the time the application was considered and which it was not appropriate to deal with at that time.

Signed at Stratford on 23 September 1998

For and on behalf of
TARANAKI REGIONAL COUNCIL


GENERAL MANAGER

Opunake water supply

Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date: 30 July 2013

Commencement Date: 20 August 2013

Conditions of Consent

Consent Granted: To take and use water from the Waiaua River for Opunake
town water supply purposes

Expiry Date: 1 June 2030

Review Date(s): June 2018, June 2024

Site Location: Opunake Water Supply Intake, Ihaia Road, Opunake

Legal Description: Sec 4 Blk X Opunake SD (Site of take & use)

Grid Reference (NZTM) 1678013E-5635411N

Catchment: Waiaua

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General condition

- a) The consent holder shall pay to the Taranaki Regional Council all the administration, monitoring and supervision costs of this consent, fixed in accordance to section 36 of the Resource Management Act 1991.

Special conditions

1. Except as provided for in conditions 2 and 3 below, the rate of taking shall not exceed 2200 cubic metres per day or 25.5 litres per second.
2. The taking shall occur through the 'new' intake authorised by consent 9473-1 (NZTM 1678013E-5635411N), except that taking may instead temporarily occur through the 'old' intake (NZTM 1678426E-5635847N):
 - (a) prior to the new intake and associated treatment plant being commissioned; and
 - (b) at other times if the new intake is unable to be used.
3. When taking occurs through the old intake the rate of taking may be up to 3650 cubic metres per day and 42.2 litres per second if that rate necessary to mitigate the effects of high sediment load.
4. If taking occurs through the old intake the consent holder shall advise the Chief Executive, Taranaki Regional Council as soon as practicable. Advice shall be made by emailing worknotification@trc.govt.co.nz with appropriate details including the dates that taking occurred.
5. Before exercising this consent the consent holder shall install, and thereafter maintain a water meter and a datalogger at the site of taking. The water meter and datalogger shall be tamper-proof and shall measure and record the rate and volume of water taken to an accuracy of $\pm 5\%$. Records of the date, the time and the rate and volume of water taken at intervals not exceeding 15 minutes, shall be made available to the Chief Executive, Taranaki Regional Council at all reasonable times.

Note: Water meters and dataloggers must be installed, and regularly maintained, in accordance with manufacturer's specifications in order to ensure that they meet the required accuracy. Even with proper maintenance water meters and dataloggers have a limited lifespan.

Consent 0232-4

6. The consent holder shall provide the Chief Executive, Taranaki Regional Council with a document from a suitably qualified person certifying that water measuring and recording equipment required by the conditions of this consent ('the equipment'):

- (a) has been installed and/or maintained in accordance with the manufacturer's specifications; and/or
- (b) has been tested and shown to be operating to an accuracy of $\pm 5\%$.

The documentation shall be provided:

- (i) within 30 days of the installation of a water meter or datalogger;
 - (ii) at other times when reasonable notice is given and the Chief Executive, Taranaki Regional Council has reasonable evidence that the equipment may not be functioning as required by this consent; and
 - (iii) no less frequently than once every five years.
7. If any measuring or recording equipment breaks down, or for any reason is not operational, the consent holder shall advise the Chief Executive, Taranaki Regional Council immediately. Any repairs or maintenance to this equipment must be undertaken by a suitably qualified person.
8. The water meter and datalogger shall be accessible to Taranaki Regional Council officer's at all reasonable times for inspection and/or data retrieval.
9. The records of water taken shall:
- (a) be in a format that, in the opinion of the Chief Executive, Taranaki Regional Council, is suitable for auditing; and
 - (b) specifically record the water taken as 'zero' when no water is taken.
10. From a date no later than 1 December 2013, the measurements made in accordance with condition 5 of this consent, in a format to be advised by the Chief Executive, Taranaki Regional Council shall be transmitted to the Taranaki Regional Council's computer system to maintain a 'real time' record of the water taken.
11. At all times the consent holder shall adopt the best practicable option to prevent or minimise any actual or likely adverse effect on the environment associated with the abstraction of water, including, but not limited to, the efficient and conservative use of water.
12. The consent holder shall, on an annual basis, provide a report detailing:
- the work done to detect and minimise leaks;
 - water use efficiency and conservation measures undertaken; and
 - water use benchmarking data for the region and how the area supplied by this consent supplied compare.

The report(s) shall be provided to the Chief Executive, Taranaki Regional Council before 31 August each year and cover the previous 1 July to 30 June period.

Consent 0232-4

13. This consent shall lapse on 30 September 2018, unless the consent is given effect to before the end of that period or the Taranaki Regional Council fixes a longer period pursuant to section 125(1)(b) of the Resource Management Act 1991.
14. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2018 and/or June 2024, for the purposes of:
 - (a) discontinuing or amending the authorisation to take via the old intake; and/or
 - (b) ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 30 July 2013

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Discharge Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date: 30 July 2013

Commencement Date: 30 July 2013

Conditions of Consent

Consent Granted: To discharge water treatment residuals, and pond drainage water from the Opunake Water Treatment Plant into the Waiaua River

Expiry Date: 1 June 2030

Review Date(s): June 2018, June 2024

Site Location: Opunake Water Treatment Plant, Ihaia Road, Opunake

Legal Description: Sec 4 Blk X Opunake SD (Discharge source & site)

Grid Reference (NZTM) 1677645E-5635245N

Catchment: Waiaua

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General condition

- a. The consent holder shall pay to the Taranaki Regional Council all the administration, monitoring and supervision costs of this consent, fixed in accordance with section 36 of the Resource Management Act 1991.

Special conditions

1. The consent holder shall at all times adopt the best practicable option, as defined in section 2 of the Resource Management Act 1991, to prevent or minimise any adverse effects on the environment from the exercise of this consent.
2. The discharge shall not exceed 120 cubic metres per day.
3. After allowing for reasonable mixing, within a mixing zone extending 10 metres downstream of the discharge point, the discharge shall not, either by itself or in combination with other discharges, give rise to any or all of the following effects in the receiving water:
 - a) the production of any conspicuous oil or grease films, scums or foams, or floatable or suspended materials;
 - b) any conspicuous change in the colour or visual clarity;
 - c) any emission of objectionable odour;
 - d) the rendering of fresh water unsuitable for consumption by farm animals;
 - e) any significant adverse effects on aquatic life.
4. Constituents of the discharge shall meet the standards shown in the following table.

<u>Constituent</u>	<u>Standard</u>
free available chlorine	Concentration not greater than 0.1 gm ⁻³
pH	Within the range 6.5 to 8.5
suspended solids	Concentration not greater than 50 gm ⁻³

This condition shall apply before entry of the treated wastewater into the receiving waters at a designated sampling point approved by the Chief Executive, Taranaki Regional Council.

5. This consent shall lapse on 30 September 2018, unless the consent is given effect to before the end of that period or the Taranaki Regional Council fixes a longer period pursuant to section 125(1)(b) of the Resource Management Act 1991.

Consent 5574-2

6. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2018 and/or June 2024, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time

Signed at Stratford on 30 July 2013

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Land Use Consent
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date: 21 February 2013

Commencement Date: 21 February 2013

Conditions of Consent

Consent Granted: To construct, place and use a water intake structure on the bed of the Waiaua River for water abstraction purposes

Expiry Date: 1 June 2030

Review Date(s): June 2018, June 2024

Site Location: Opunake Water Treatment Plant, 470 Ihaia Road, Opunake

Legal Description: Sec 4 Blk X Opunake SD (Site of structure)

Grid Reference (NZTM) 1678013E-5635411N

Catchment: Waiaua

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General condition

- a. The consent holder shall pay to the Taranaki Regional Council [the Council] all the administration, monitoring and supervision costs of this consent, fixed in accordance to section 36 of the Resource Management Act.

Special conditions

1. The water intake structure shall:
 - a) have a 0.75 mm slot size wedge wire screen;
 - b) be 300 mm in diameter;
 - c) 1500 mm in length; and
 - d) the bottom of the screen to sit a nominal 225 mm above the existing riverbed.
2. The consent holder shall notify the Chief Executive, Taranaki Regional Council, in writing at least 48 hours prior to the commencement and upon completion of the initial installation and again at least 48 hours prior to and upon completion of any subsequent maintenance works which would involve disturbance of or deposition to the riverbed or discharges to water. Notification shall include the consent number and a brief description of the activity consented and be emailed to worknotification@trc.govt.nz. Notification by fax or post is acceptable only if the consent holder does not have access to email.
3. The consent holder shall ensure that the area and volume of riverbed disturbance shall, so far as is practicable, be minimised and any areas which are disturbed shall, so far as is practicable, be reinstated.
4. The consent holder shall take all reasonable steps to:
 - a. minimise the amount of sediment discharged to the river;
 - b. minimise the amount of sediment that becomes suspended in the river; and
 - c. mitigate the effects of any sediment in the river.

Undertaking work in accordance with *Guidelines for Earthworks in the Taranaki Region*, by the Taranaki Regional Council, will achieve compliance with this condition.

5. The consent holder shall ensure that the water intake structure is appropriately screened to avoid the entrapment of freshwater fauna. The maximum screen slot velocity shall be no more than 0.15 m/s at design capacity.
6. The water intake structure shall not obstruct fish passage.
7. To mitigate the adverse environmental effects of this consent the consent holder shall make a single payment of \$20,000 (excluding GST) to the Taranaki Regional Council as a financial contribution for the purpose of providing riparian planting and management in the Waiaua Stream catchment. The payment shall be made before 1 September 2013.

Consent 9473-1

8. In the event that any archaeological remains are discovered as a result of works authorised by this consent, the works shall cease immediately at the affected site and tangata whenua and the Chief Executive, Taranaki Regional Council, shall be notified within one working day. Works may recommence at the affected area when advised to do so by the Chief Executive, Taranaki Regional Council. Such advice shall be given after the Chief Executive has considered: tangata whenua interest and values, the consent holder's interests, the interests of the public generally, and any archaeological or scientific evidence. The New Zealand Police, Coroner, and Historic Places Trust shall also be contacted as appropriate, and the work shall not recommence in the affected area until any necessary statutory authorisations or consents have been obtained.
9. Except with the written agreement of the Chief Executive, Taranaki Regional Council, the structure authorised by this consent shall be removed and the area reinstated, if and when the structure is no longer required. A further resource consent may be required to authorise the removal of the structure, and the consent holder is advised to seek advice from the Council on this matter.
10. This consent shall lapse on 31 March 2018, unless the consent is given effect to before the end of that period or the Taranaki Regional Council fixes a longer period pursuant to section 125(1)(b) of the Resource Management Act 1991.
11. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2018 and/or June 2024, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 21 February 2013

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Patea water supply

Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Chief Executive
Private Bag 902
Hawera 4640

Decision Date
(Change): 29 October 2014

Commencement Date
(Change): 29 October 2014 (Granted Date: 30 May 2012)

Conditions of Consent

Consent Granted: To take and use groundwater from three bores (known as Bore 1, Bore 4 and Bore 5) for Patea Township water supply purposes

Expiry Date: 01 June 2028

Review Date(s): June 2016, June 2022

Site Location: Egmont St & Taranaki Rd, Patea

Legal Description: Lot 1 DP 5899 (Bore 4)
Lot 1 DP 411166 (Bores 1 & 5)
Patea Dist Blk VI Carlyle SD

Grid Reference (NZTM) 1725370E - 5599180N (Bore 1)
1725010E - 5600000N (Bore 4)
1725360E - 5599180N (Bore 5)

Catchment: Patea
Unnamed Catchment 12

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General condition

- a. The consent holder shall pay to the Taranaki Regional Council all the administration, monitoring and supervision costs of this consent, fixed in accordance with section 36 of the Resource Management Act 1991.

Special conditions

1. The total volume of groundwater taken from the three bores combined shall not exceed 1,125 cubic metres per day.
2. Subject to condition 3, the rate of take from each bore shall not exceed the maximum rate shown in the table below:

Bore #	Maximum rate
1	4.7 litres per second
4	10 litres per second
5	10 litres per second

3. The volume taken from Bore 1 shall not exceed 300 cubic metres per day unless either Bore 4 or Bore 5 is unable to be operated because of breakdown or is shut down for essential maintenance.
4. Before exercising this consent the consent holder shall install, and thereafter maintain a water meter and a datalogger on each bore. The water meters and dataloggers shall be tamper-proof and shall measure and record the rate and volume of water taken to an accuracy of $\pm 5\%$.

Note: Water meters and dataloggers must be installed, and regularly maintained, in accordance with manufacturer's specifications in order to ensure that they meet the required accuracy. Even with proper maintenance water meters and dataloggers have a limited lifespan.

5. Within 30 days of the installation of a water meter or datalogger, and at other times when reasonable notice is given, the consent holder shall provide the Chief Executive, Taranaki Regional Council with a document from a suitably qualified person certifying that:
 - a. water measuring or recording equipment required by the conditions of this consent has been installed and/or maintained in accordance with the manufacturer's specifications; and/or
 - b. water measuring or recording equipment required by the conditions of this consent has been tested and shown to be operating to an accuracy of $\pm 5\%$.
6. If any measuring or recording equipment breaks down, or for any reason is not operational, the consent holder shall advise the Chief Executive, Taranaki Regional Council immediately. Any repairs or maintenance to this equipment must be undertaken by a suitably qualified person.
7. The water meter and datalogger shall be accessible to Taranaki Regional Council officer's at all reasonable times for inspection and/or data retrieval.

Consent 3388-3.1

8. At all times the consent holder shall adopt the best practicable option to prevent or minimise any actual or likely adverse effect on the environment associated with the abstraction of groundwater, including, but not limited to, the efficient and conservative use of water.
9. The consent holder shall measure and record the water level in the Brannigan bore (GND0076, located at grid reference 1725550E-5599498N) to an accuracy of ± 0.05 metres and at intervals not exceeding 15 minutes.
10. An accessible groundwater level indicator shall be installed on the Brannigan bore which shows when groundwater levels have reached 48 metres below ground level (mbgl). Should groundwater reach this level then consultation between the owner of the Brannigan bore and the consent holder shall occur and, if the bore owner requires it, the measures in condition 11 shall be implemented.
11. That the consent holder shall immediately restrict the exercise of this consent and/or provide a suitable unchlorinated alternative water supply for the Brannigan bore owner should the exercise of this consent restrict the use of the Brannigan bore.
12. The taking shall not cause the intrusion of salt water into any freshwater aquifer.
13. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2016 and/or June 2022, for the purposes of:
 - a. ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time; and/or
 - b. to require any data collected in accordance with the conditions of this consent to be transmitted directly to the Council's computer system, in a format suitable for providing a 'real time' record over the internet.

Signed at Stratford on 29 October 2014

For and on behalf of
Taranaki Regional Council

A D McLay
Director - Resource Management

Pope water supply



Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

CHIEF EXECUTIVE
PRIVATE BAG 713
47 CLOTEN ROAD
STRATFORD
NEW ZEALAND
PHONE: 06-765 7127
FAX: 06-765 5097
www.trc.govt.nz

Please quote our file number
on all correspondence

Name of Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date: 7 June 2011

Change To Conditions Date: 7 June 2011 [Granted: 22 November 2000]

Conditions of Consent

Consent Granted: To take water from the Otakeho Stream for the Pope and Waimate West water supply schemes at or about (NZTM) 1691940E-5639453N

Expiry Date: 1 June 2018

Review Date(s): June 2012

Site Location: Mangawhero Road, Kaponga

Legal Description: Sec 7 Blk VI Kaupokonui SD

Catchment: Otakeho

General condition

- a. The consent holder shall pay to the Taranaki Regional Council [the Council] all the administration, monitoring and supervision costs of this consent, fixed in accordance to section 36 of the Resource Management Act.

Special conditions

1. The rate of taking shall not exceed 85 litres per second.
2. Before exercising this consent the consent holder shall install, and thereafter maintain a water meter and datalogger. The water meter and datalogger shall be tamper-proof and shall measure and record the rate and volume of water taken to an accuracy of $\pm 5\%$. Records of the date, the time and the rate and volume of water taken at intervals not exceeding 15 minutes.

Note: Water meters and dataloggers must be installed, and regularly maintained, in accordance with manufacturer's specifications in order to ensure that they meet the required accuracy. Even with proper maintenance water meters and dataloggers have a limited lifespan.

3. The consent holder shall provide the Chief Executive, Taranaki Regional Council with a document from a suitably qualified person certifying that water measuring and recording equipment required by the conditions of this consent ['the equipment']:
 - (a) has been installed and/or maintained in accordance with the manufacturer's specifications; and/or
 - (b) has been tested and shown to be operating to an accuracy of $\pm 5\%$.

The documentation shall be provided:


- (i) within 30 days of the installation of a water meter or datalogger;
 - (ii) at other times when reasonable notice is given and the Chief Executive, Taranaki Regional Council has reasonable evidence that the equipment may not be functioning as required by this consent; and
 - (iii) no less frequently than once every five years.
4. If any measuring or recording equipment breaks down, or for any reason is not operational, the consent holder shall advise the Chief Executive, Taranaki Regional Council immediately. Any repairs or maintenance to this equipment must be undertaken by a suitably qualified person.
5. The water meter and datalogger shall be accessible to Taranaki Regional Council officers at all reasonable times for inspection and/or data retrieval.
6. The records of water taken shall:
 - (a) be in a format that, in the opinion of the Chief Executive, Taranaki Regional Council, is suitable for auditing; and
 - (b) specifically record the water taken as 'zero' when no water is taken.

Consent 3911-2

7. At all times the consent holder shall adopt the best practicable option to prevent or minimise any actual or likely adverse effect on the environment associated with the abstraction of water, including, but not limited to, the efficient and conservative use of water.
8. From a date no later than 30 June 2012, the measurements made in accordance with condition 2 of this consent, in a format to be advised by the Chief Executive, Taranaki Regional Council, shall be transmitted to the Taranaki Regional Council's computer system to maintain a 'real time' record of the water taken, with a delay of no more than 2 hours.
9. The consent holder shall ensure that, before 1 June 2017, all flows of less than 500 litres per second past the intake structure, are measured and recorded to an accuracy $\pm 10\%$ at intervals not exceeding 30 minutes for a continuous period of at least 12 months.
10. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2012, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 7 June 2011

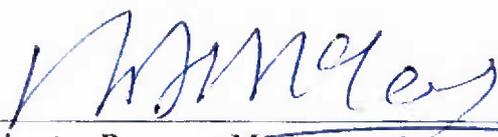For and on behalf of
Taranaki Regional Council



Director-Resource Management

Discharge Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4800

Consent Granted
Date: 9 June 2006

Conditions of Consent

Consent Granted: To discharge treated backwash water from the Pope Rural Water Supply Treatment Plant into an unnamed tributary of the Mangawhero Stream in the Kaupokonui catchment at or about GR: P20:032-003

Expiry Date: 1 June 2023

Review Date(s): June 2011, June 2017

Site Location: Upper Mangawhero Road, Kaponga

Legal Description: Pt Lot 2 DP 7928 Blk VI Kaupokonui SD

Catchment: Kaupokonui

Tributary: Mangawhero 2

General conditions

- a) On receipt of a requirement from the Chief Executive, Taranaki Regional Council the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) Unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) The consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

1. The consent holder shall at all times adopt the best practicable option, as defined in section 2 of the Resource Management Act 1991, to prevent or minimise any adverse effects on the environment from the exercise of this consent.
2. The exercise of this consent shall be undertaken generally in accordance with the documentation submitted in support of application 3452. In the case of any contradiction between the documentation submitted in support of application 3452 and the conditions of this consent, the conditions of this consent shall prevail.
3. The discharge shall not exceed 6 cubic metres per day, at a rate not exceeding 5 litres per second.
4. The discharge quality shall not exceed the following limits at all times:

Component	Concentration
free available chlorine	<0.1g/m ³
suspended solids	20 g/m ³
pH	6.5-8.5

5. The consent holder shall properly and efficiently maintain and operate the settling pond so as to meet the conditions of this consent.
6. After allowing for reasonable mixing, within a mixing zone extending 20 metres below the discharge point, the discharge shall not give rise to any of the following effects in the unnamed tributary of the Mangawhero Stream:
 - (a) the production of any conspicuous oil or grease films, scums or foams, or floatable or suspended materials;
 - (b) any conspicuous change in the colour or visual clarity;
 - (c) any emission of objectionable odour;
 - (d) the rendering of fresh water unsuitable for consumption by farm animals;
 - (e) any significant adverse effects on aquatic life, habitats, or ecology.

Consent 4446-2

7. This consent shall lapse on the expiry of five years after the date of issue of this consent, unless the consent is given effect to before the end of that period or the Taranaki Regional Council fixes a longer period pursuant to section 125(1)(b) of the Resource Management Act 1991.
8. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2011 and/or June 2017, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 9 June 2006

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Rahotu water supply

Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date: 15 August 2013

Commencement Date: 15 August 2013

Conditions of Consent

Consent Granted: To take and use water from the Pungaereere Stream for the Rahotu community water supply

Expiry Date: 1 June 2031

Review Date(s): June 2019, June 2025

Site Location: State Highway 45, Rahotu

Legal Description: Lot 1 DP 15882 (Site of take & use)

Grid Reference (NZTM) 1669415E-5645831N

Catchment: Pungaereere

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General condition

- a) The consent holder shall pay to the Taranaki Regional Council all the administration, monitoring and supervision costs of this consent, fixed in accordance with section 36 of the Resource Management Act 1991.

Special conditions

1. The rate of taking shall not exceed 180 cubic metres per day or 3 litres per second.
2. Before exercising this consent the consent holder shall install, and thereafter maintain a water meter and a datalogger at the site of taking (or a nearby site in accordance with Regulation 10 of the *Resource Management (Measurement and Reporting of Water Takes) Regulations 2010*). The water meter and datalogger shall be tamper-proof and shall measure and record the rate and volume of water taken to an accuracy of $\pm 5\%$. Records of the date, the time and the rate and volume of water taken at intervals not exceeding 15 minutes, shall be made available to the Chief Executive, Taranaki Regional Council at all reasonable times.

Note: Water meters and dataloggers must be installed, and regularly maintained, in accordance with manufacturer's specifications in order to ensure that they meet the required accuracy. Even with proper maintenance water meters and dataloggers have a limited lifespan.

3. The consent holder shall provide the Chief Executive, Taranaki Regional Council with a document from a suitably qualified person certifying that water measuring and recording equipment required by the conditions of this consent ('the equipment'):
 - (a) has been installed and/or maintained in accordance with the manufacturer's specifications; and/or
 - (b) has been tested and shown to be operating to an accuracy of $\pm 5\%$.

The documentation shall be provided:

- (i) within 30 days of the installation of a water meter or datalogger;
 - (ii) at other times when reasonable notice is given and the Chief Executive, Taranaki Regional Council has reasonable evidence that the equipment may not be functioning as required by this consent; and
 - (iii) no less frequently than once every five years.
4. If any measuring or recording equipment breaks down, or for any reason is not operational, the consent holder shall advise the Chief Executive, Taranaki Regional Council immediately. Any repairs or maintenance to this equipment must be undertaken by a suitably qualified person.
 5. The water meter and datalogger shall be accessible to Taranaki Regional Council officer's at all reasonable times for inspection and/or data retrieval.
 6. The records of water taken shall:
 - (a) be in a format that, in the opinion of the Chief Executive, Taranaki Regional Council, is suitable for auditing; and
 - (b) specifically record the water taken as 'zero' when no water is taken.

Consent 3696-3

7. From a date no later than 1 February 2014, the measurements made in accordance with condition 2 of this consent, in a format to be advised by the Chief Executive, Taranaki Regional Council shall be transmitted to the Taranaki Regional Council's computer system to maintain a 'real time' record of the water taken.
8. At all times the consent holder shall adopt the best practicable option to prevent or minimise any actual or likely adverse effect on the environment associated with the abstraction of water, including, but not limited to, the efficient and conservative use of water.
9. The consent holder shall, on an annual basis, provide a report detailing:
 - the work done to detect and minimise leaks;
 - water use efficiency and conservation measures undertaken; and
 - water use benchmarking data for the region and how the area supplied by this consent supplied compare.

The report(s) shall be provided to the Chief Executive, Taranaki Regional Council before 31 August each year and cover the previous 1 July to 30 June period.

10. This consent shall lapse on 30 September 2018, unless the consent is given effect to before the end of that period or the Taranaki Regional Council fixes a longer period pursuant to section 125(1)(b) of the Resource Management Act 1991.
11. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2019 and/or June 2025, for the purposes of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 15 August 2013

For and on behalf of
Taranaki Regional Council

Director-Resource Management



CHIEF EXECUTIVE
PRIVATE BAG 713
47 CLOTEN ROAD
STRATFORD
NEW ZEALAND
PHONE 06-765 7127
FAX 06-765 5097

Please quote our file number
on all correspondence

Discharge Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA

Consent Granted
Date: 2 September 2002

Conditions of Consent

Consent Granted: To discharge filter backwash water and settling tank waste
from the Rahotu Water Treatment Plant into the
Pungaereere Stream at or about GR: P20:794-075

Expiry Date: 1 June 2019

Review Date(s): June 2007, June 2013

Site Location: State Highway 45, Rahotu

Legal Description: Lot 1 DP 15882 Blk I Opunake SD

Catchment: Pungaereere

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General conditions

- a) On receipt of a requirement from the Chief Executive, Taranaki Regional Council (hereinafter the Chief Executive), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) Unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) The consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.


Special conditions

- 1. That after allowing for reasonable mixing, within a mixing zone extending 50 metres below the discharge point, the discharge shall not give rise to any of the following effects in the Pungaereere Stream:
 - (a) the production of any conspicuous oil or grease films, scums or foams, or floatable or suspended materials;
 - (b) any conspicuous change in the colour or visual clarity;
 - (c) any emission of objectionable odour;
 - (d) the rendering of fresh water unsuitable for consumption by farm animals;
 - (e) any significant adverse effects on aquatic life, habitats, or ecology.
- 2. That the discharge quality shall not exceed the following limits at all times:

pH	6.5-8.5
Free available chlorine	0.1 gm ⁻³
- 3. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2007 and/or June 2013, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 2 September 2002

For and on behalf of
Taranaki Regional Council



Director-Resource Management

Wai-inu Beach water supply

Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date: 7 May 2012

Commencement
Date: 7 May 2012

Conditions of Consent

Consent Granted: To take and use groundwater for Waiinu Beach water
supply purposes at or about (NZTM) 1748362E-5586586N

Expiry Date: 1 June 2028

Review Date(s): June 2016, June 2022

Site Location: Nukumaru Domain Reserve, Waiinu Road, Waiinu Beach

Legal Description: Pt Sec 150 Waitotara Dist Blk XIV Wairoa SD
(Site of take & use)

Catchment: Waitotara

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General condition

- a. The consent holder shall pay to the Taranaki Regional Council all the administration, monitoring and supervision costs of this consent, fixed in accordance with section 36 of the Resource Management Act 1991.

Special conditions

1. The volume of water taken shall not exceed 4 litres per second (346 m³/day).
2. Before exercising this consent the consent holder shall install, and thereafter maintain a water meter at the site of taking. The water meter shall be tamper-proof and shall measure and record the volume of water taken to an accuracy of $\pm 5\%$.

Note: Water meters must be installed, and regularly maintained, in accordance with manufacturer's specifications in order to ensure that they meet the required accuracy. Even with proper maintenance water meters have a limited lifespan.

3. The consent holder shall provide the Chief Executive, Taranaki Regional Council with a document from a suitably qualified person certifying that water measuring equipment required by the conditions of this consent ('the equipment'):
 - (a) has been installed and/or maintained in accordance with the manufacturer's specifications; and/or
 - (b) has been tested and shown to be operating to an accuracy of $\pm 5\%$.

The documentation shall be provided:

- (i) within 30 days of the installation of a water meter;
 - (ii) at other times when reasonable notice is given and the Chief Executive, Taranaki Regional Council has reasonable evidence that the equipment may not be functioning as required by this consent; and
 - (iii) no less frequently than once every five years.
4. If any measuring or recording equipment breaks down, or for any reason is not operational, the consent holder shall advise the Chief Executive, Taranaki Regional Council immediately. Any repairs or maintenance to this equipment must be undertaken by a suitably qualified person.
 5. The water meter shall be accessible to Taranaki Regional Council officers at all reasonable times for inspection and/or data retrieval.
 6. The consent holder shall maintain a record of the water taken by recording the meter reading and the date of the reading at monthly intervals. This record shall be provided to the Chief Executive, Taranaki Regional Council, no later than 31 July of each year, or earlier upon request.

Consent 3770-3

7. At all times the consent holder shall adopt the best practicable option to prevent or minimise any actual or likely adverse effect on the environment associated with the abstraction of water, including, but not limited to, the efficient and conservative use of water.
8. This consent shall lapse on 30 June 2017, unless the consent is given effect to before the end of that period or the Taranaki Regional Council fixes a longer period pursuant to section 125(1)(b) of the Resource Management Act 1991.
9. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2017 and/or June 2023, for the purposes of:
 - (a) ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time; and/or
 - (b) to require any data collected in accordance with the conditions of this consent to be transmitted directly to the Council's computer system, in a format suitable for providing a 'real time' record over the internet.

Signed at Stratford on 7 May 2012

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Waimate West water supply

Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date: 7 June 2011

Commencement
Date: 7 June 2011

Conditions of Consent

Consent Granted: To take water from the Mangawheroiti Stream for the
Waimate West water supply at or about (NZTM)
1694422E-5637449N

Expiry Date: 1 June 2023

Review Date(s): June 2018

Site Location: Rowan Road, Kaponga

Legal Description: Pt Sec 79 Blk X Kaupokonui SD

Catchment: Kaupokonui

Tributary: Mangawhero
Mangawheroiti

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General condition

- a. The consent holder shall pay to the Council all the administration, monitoring and supervision costs of this consent, fixed in accordance to section 36 of the Resource Management Act.

Special conditions

1. The rate of taking shall not exceed 121 litres per second [including any water that is taken from the Mangawhero Stream, in accordance with consent 0635, and discharged to the Mangawheroiti Stream].
2. No water shall be taken pursuant to this consent unless water is being concurrently taken from the Otakeho Stream at 85 litres per second. If, for a temporary period, the Otakeho Stream intake and diversion can not supply 85 litres per second, for example during maintenance, the consent holder shall immediately advise the Chief Executive, Taranaki Regional Council and this condition shall not apply.
3. Before exercising this consent the consent holder shall install, and thereafter maintain a water meter and datalogger. The water meter and datalogger shall be tamper-proof and shall measure and record the rate and volume of water taken to an accuracy of $\pm 5\%$. Records of the date, the time and the rate and volume of water taken at intervals not exceeding 15 minutes.

Note: Water meters and dataloggers must be installed, and regularly maintained, in accordance with manufacturer's specifications in order to ensure that they meet the required accuracy. Even with proper maintenance water meters and dataloggers have a limited lifespan.

4. The consent holder shall provide the Chief Executive, Taranaki Regional Council with a document from a suitably qualified person certifying that water measuring and recording equipment required by the conditions of this consent ['the equipment']:
 - (a) has been installed and/or maintained in accordance with the manufacturer's specifications; and/or
 - (b) has been tested and shown to be operating to an accuracy of $\pm 5\%$.

The documentation shall be provided:

- (i) within 30 days of the installation of a water meter or datalogger;
 - (ii) at other times when reasonable notice is given and the Chief Executive, Taranaki Regional Council has reasonable evidence that the equipment may not be functioning as required by this consent; and
 - (iii) no less frequently than once every five years.
5. If any measuring or recording equipment breaks down, or for any reason is not operational, the consent holder shall advise the Chief Executive, Taranaki Regional Council immediately. Any repairs or maintenance to this equipment must be undertaken by a suitably qualified person.
6. The water meter and datalogger shall be accessible to Taranaki Regional Council officers at all reasonable times for inspection and/or data retrieval.

Consent 0634-3

7. The records of water taken shall:
 - (a) be in a format that, in the opinion of the Chief Executive, Taranaki Regional Council, is suitable for auditing; and
 - (b) specifically record the water taken as 'zero' when no water is taken.
8. The taking of water authorised by this consent shall be managed to ensure that the flow in the Mangawheroiti Stream, immediately downstream of the intake, is not less than 32 litres per second.
9. When the flow in the Mangawheroiti Stream is less than 500 litres per second the consent holder shall measure and record the flow of the Mangawheroiti Stream that passes downstream the intake to an accuracy of $\pm 10\%$ at intervals not exceeding 30 minutes.
10. From a date no later than 30 June 2012, the measurements made in accordance with conditions 3 and 9 of this consent, in a format to be advised by the Chief Executive, Taranaki Regional Council, shall be transmitted to the Taranaki Regional Council's computer system to maintain a 'real time' record of the water taken and the flow past the intake, with a delay of no more than 2 hours.
11. The consent holder shall ensure that a staff gauge is installed and maintained to effectively display the water level at the weir to an accuracy of 0.005 m at all times when the flow is less than 500 litres per second.
12. If necessary to comply with condition 9, the consent holder shall ensure that sufficient stream flow measurements are undertaken to maintain a 'rating curve' that accurately translates the water level to stream flow over the weir.

Note: Work required by special condition 12 may be undertaken by the Taranaki Regional Council and all reasonable costs recovered from the consent holder through the annual compliance monitoring programme that is in place for the activity.

13. At all times the consent holder shall adopt the best practicable option to prevent or minimise any actual or likely adverse effect on the environment associated with the abstraction of water, including, but not limited to, the efficient and conservative use of water.
14. The consent holder shall, on an annual basis, provide a report detailing:
 - the work done to detect and minimise leaks within each of the areas supplied;
 - water use efficiency and conservation measures undertaken and planned for all users of the Waimate Water Supply Scheme area; and
 - water use benchmarking data for the region compared to water use for the Waimate Water Supply Scheme.

The report[s] shall be provided to the Chief Executive, Taranaki Regional Council before 1 September each year and cover the previous 1 July to 30 June period. The first report shall be provided by 1 September 2011.

Consent 0634-3

15. The consent holder shall make five annual payments of \$30,600 [GST exclusive] to the Taranaki Regional Council as a financial contribution in order to remedy or mitigate adverse effects on the environment. These payments shall be made no later than 1 September each year from 2011 to 2015.
16. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2018, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 7 June 2011

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date: 7 June 2011

Commencement
Date: 7 June 2011

Conditions of Consent

Consent Granted: To take water from the Mangawhero Stream for the purpose of adding to the flow of the Mangawheroiti Stream and providing water for the Waimate West water supply at or about (NZTM) 1694040E-5640090N

Expiry Date: 1 June 2023

Review Date(s): June 2018

Site Location: Mangawhero Road, Kaponga

Legal Description: Sec 11 Blk VI Kaupokonui SD

Catchment: Kaupokonui

Tributary: Mangawhero

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General condition

- a. The consent holder shall pay to the Taranaki Regional Council [the Council] all the administration, monitoring and supervision costs of this consent, fixed in accordance to section 36 of the Resource Management Act.

Special conditions

1. The rate of taking shall not exceed 70 litres per second.
2. No water shall be taken pursuant to this consent unless water is concurrently being taken from the Otakeho and Mangawheroiti Streams, at 85 litres per second and 121 litres per second, respectively. If, for a temporary period, the Otakeho and Mangawheroiti Streams can not supply 85 litres per second and 121 litres per second respectively, for example during maintenance, the consent holder shall immediately advise the Chief Executive, Taranaki Regional Council and this condition shall not apply.
3. Before exercising this consent the consent holder shall install, and thereafter maintain a water meter and datalogger. The water meter and datalogger shall be tamper-proof and shall measure and record the rate and volume of water taken to an accuracy of $\pm 5\%$. Records of the date, the time and the rate and volume of water taken at intervals not exceeding 15 minutes.

Note: Water meters and dataloggers must be installed, and regularly maintained, in accordance with manufacturer's specifications in order to ensure that they meet the required accuracy. Even with proper maintenance water meters and dataloggers have a limited lifespan.

4. The consent holder shall provide the Chief Executive, Taranaki Regional Council with a document from a suitably qualified person certifying that water measuring and recording equipment required by the conditions of this consent ['the equipment']:
 - (a) has been installed and/or maintained in accordance with the manufacturer's specifications; and/or
 - (b) has been tested and shown to be operating to an accuracy of $\pm 5\%$.

The documentation shall be provided:

- (i) within 30 days of the installation of a water meter or datalogger;
 - (ii) at other times when reasonable notice is given and the Chief Executive, Taranaki Regional Council has reasonable evidence that the equipment may not be functioning as required by this consent; and
 - (iii) no less frequently than once every five years.
5. If any measuring or recording equipment breaks down, or for any reason is not operational, the consent holder shall advise the Chief Executive, Taranaki Regional Council immediately. Any repairs or maintenance to this equipment must be undertaken by a suitably qualified person.

Consent 0635-3

6. The water meter and datalogger shall be accessible to Taranaki Regional Council officers at all reasonable times for inspection and/or data retrieval.
7. The records of water taken shall:
 - (a) be in a format that, in the opinion of the Chief Executive, Taranaki Regional Council, is suitable for auditing; and
 - (b) specifically record the water taken as 'zero' when no water is taken.
8. From a date no later than 30 June 2012, the measurements made in accordance with condition 3 of this consent, in a format to be advised by the Chief Executive, Taranaki Regional Council, shall be transmitted to the Taranaki Regional Council's computer system to maintain a 'real time' record of the water taken, with a delay of no more than 2 hours.
9. At all times the consent holder shall adopt the best practicable option to prevent or minimise any actual or likely adverse effect on the environment associated with the abstraction of water, including, but not limited to, the efficient and conservative use of water.
10. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2018, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 7 June 2011

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date: 7 June 2011

Change To
Conditions Date: 7 June 2011 [Granted: 22 November 2000]

Conditions of Consent

Consent Granted: To take water from the Otakeho Stream for the Pope and
Waimate West water supply schemes at or about (NZTM)
1691940E-5639453N

Expiry Date: 1 June 2018

Review Date(s): June 2012

Site Location: Mangawhero Road, Kaponga

Legal Description: Sec 7 Blk VI Kaupokonui SD

Catchment: Otakeho

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General condition

- a. The consent holder shall pay to the Taranaki Regional Council [the Council] all the administration, monitoring and supervision costs of this consent, fixed in accordance to section 36 of the Resource Management Act.

Special conditions

1. The rate of taking shall not exceed 85 litres per second.
2. Before exercising this consent the consent holder shall install, and thereafter maintain a water meter and datalogger. The water meter and datalogger shall be tamper-proof and shall measure and record the rate and volume of water taken to an accuracy of $\pm 5\%$. Records of the date, the time and the rate and volume of water taken at intervals not exceeding 15 minutes.

Note: Water meters and dataloggers must be installed, and regularly maintained, in accordance with manufacturer's specifications in order to ensure that they meet the required accuracy. Even with proper maintenance water meters and dataloggers have a limited lifespan.

3. The consent holder shall provide the Chief Executive, Taranaki Regional Council with a document from a suitably qualified person certifying that water measuring and recording equipment required by the conditions of this consent ['the equipment']:
 - (a) has been installed and/or maintained in accordance with the manufacturer's specifications; and/or
 - (b) has been tested and shown to be operating to an accuracy of $\pm 5\%$.

The documentation shall be provided:

- (i) within 30 days of the installation of a water meter or datalogger;
 - (ii) at other times when reasonable notice is given and the Chief Executive, Taranaki Regional Council has reasonable evidence that the equipment may not be functioning as required by this consent; and
 - (iii) no less frequently than once every five years.
4. If any measuring or recording equipment breaks down, or for any reason is not operational, the consent holder shall advise the Chief Executive, Taranaki Regional Council immediately. Any repairs or maintenance to this equipment must be undertaken by a suitably qualified person.
5. The water meter and datalogger shall be accessible to Taranaki Regional Council officers at all reasonable times for inspection and/or data retrieval.
6. The records of water taken shall:
 - (a) be in a format that, in the opinion of the Chief Executive, Taranaki Regional Council, is suitable for auditing; and
 - (b) specifically record the water taken as 'zero' when no water is taken.

Consent 3911-2

7. At all times the consent holder shall adopt the best practicable option to prevent or minimise any actual or likely adverse effect on the environment associated with the abstraction of water, including, but not limited to, the efficient and conservative use of water.
8. From a date no later than 30 June 2012, the measurements made in accordance with condition 2 of this consent, in a format to be advised by the Chief Executive, Taranaki Regional Council, shall be transmitted to the Taranaki Regional Council's computer system to maintain a 'real time' record of the water taken, with a delay of no more than 2 hours.
9. The consent holder shall ensure that, before 1 June 2017, all flows of less than 500 litres per second past the intake structure, are measured and recorded to an accuracy $\pm 10\%$ at intervals not exceeding 30 minutes for a continuous period of at least 12 months.
10. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2012, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 7 June 2011

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Land Use Consent
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of
Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date: 10 December 2010

Change To
Conditions Date: 10 December 2010 [Granted: 1 March 1999]

Conditions of Consent

Consent Granted: To place, use and maintain a water intake structure and associated erosion protection structures, including upgrading the intake structure and constructing a new fish pass, on the bed of the Otakeho Stream at or about (NZTM) 1691980E-5639445N

Expiry Date: 1 June 2017

Review Date(s): June 2011

Site Location: Upper Mangawhero Road, Riverlea

Legal Description: Section 7 Blk VI Kaupokonui SD [Site of structure]

Catchment: Otakeho

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General conditions

- a) That on receipt of a requirement from the Chief Executive, Taranaki Regional Council [hereinafter the Chief Executive], the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) That unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) That the consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

1. The consent holder shall notify the Chief Executive, Taranaki Regional Council, in writing at least 48 hours prior to the commencement and upon completion of any construction and/or maintenance works which would involve disturbance of or deposition to the riverbed or discharges to water. Notification shall include the consent number and a brief description of the activity consented and be emailed to worknotification@trc.govt.nz.
2. The structure[s] authorised by this consent shall be constructed in accordance with the documentation submitted in support of applications 95/185, 542, and 6622 [specifically Drawing No. 80357] and shall be maintained to ensure the conditions of this consent are met.
3. During any construction or maintenance the consent holder shall adopt the best practicable option to avoid or minimise the discharge of silt or other contaminants into water or onto the riverbed and to avoid or minimise the disturbance of the riverbed and any adverse effects on water quality.
4. During any construction or maintenance the consent holder shall ensure that the area and volume of riverbed disturbance shall so far as is practicable, be minimised and any areas which are disturbed, shall so far as is practicable be reinstated.
5. During any construction or maintenance the consent holder shall ensure that any disturbance of parts of the riverbed covered by water and/or any works which may result in downstream discolouration of water shall be undertaken only between 1 November and 30 April except where this requirement is waived by the written approval of the Chief Executive, Taranaki Regional Council.
6. The structure[s] shall provide for the passage of fish to the satisfaction of the Chief Executive, Taranaki Regional Council as determined by a monitoring programme conducted by the Taranaki Regional Council at the consent holders expense.

Consent 4826-2

7. A Taranaki Regional Council Freshwater Biologist shall be present during the placement and concreting of rocks in the fish pass.
8. Except with the written agreement of the Chief Executive, Taranaki Regional Council, the structure[s] authorised by this consent shall be removed and the area reinstated, if and when the structure is no longer required. A further resource consent may be required to authorise the removal of the structure, and the consent holder is advised to seek advice from the Council on this matter.
9. The Taranaki Regional Council may review any or all of the conditions of this consent by giving notice of review during the month of June 2001 and/or June 2005 and/or June 2011, for the purpose of ensuring that the conditions are adequate to deal with the any significant adverse effects arising from the exercise of this consent, which either were not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 10 December 2010

For and on behalf of
Taranaki Regional Council

Director-Resource Management

TRK995451



LAND USE CONSENT

**Pursuant to the RESOURCE MANAGEMENT ACT 1991
a resource consent is hereby granted by the
Taranaki Regional Council**

PRIVATE BAG 713
47 CLOTEN ROAD
STRATFORD
NEW ZEALAND
PHONE 0-6-765 7127
FAX 0-6-765 5097

Name of
Consent Holder: SOUTH TARANAKI DISTRICT COUNCIL
PRIVATE BAG 902 HAWERA

Consent
Granted Date: 1 March 1999

CONDITIONS OF CONSENT

Consent Granted: TO ERECT, PLACE, USE AND MAINTAIN A WATER INTAKE STRUCTURE AND ANCILLARY STRUCTURES ON AND OVER THE BED OF THE MANGAWHEROITI STREAM A TRIBUTARY OF THE MANGAWHERO STREAM IN THE KAUPOKONUI CATCHMENT FOR WATER ABSTRACTION PURPOSES AT OR ABOUT GR: P20:044-992

Expiry Date: 1 June 2017

Review Date[s]: June 2001, June 2005 and June 2011

Site Location: MANGAWHEROITI STREAM, ROWAN ROAD, KAPONGA

Legal Description: SO 10908 PT SEC 79 BLK X KAUPOKONUI SD

Catchment: KAUPOKONUI 355.000

Tributary: MANGAWHERO 355.010
MANGAWHROITI 355.014

For General, Standard and Special Conditions pertaining to this consent please see reverse side of this document.

TRK995451

General conditions

- a) That on receipt of a requirement from the General Manager, Taranaki Regional Council (hereinafter the General Manager), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) That unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) That the consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

- 1. THAT the consent holder shall notify the Taranaki Regional Council, at least 48 hours prior to commencement and upon completion of the initial construction, and again prior to, and upon completion of, any subsequent maintenance works which would involve disturbance of, or the deposition to the riverbed or discharges to water.
- 2. THAT the stricture[s] authorised by this consent shall be constructed generally in accordance with the documentation submitted in support of the application and shall be maintained to ensure the conditions of this consent are met.
- 3. THAT during any construction or maintenance the consent holder shall adopt the best practicable option to avoid or minimise the discharge of silt or other contaminants into the water or onto the riverbed and to avoid or minimise the disturbance of the riverbed and any adverse effects on water quality.
- 4. THAT during any construction or maintenance the consent holder shall ensure that the area and volume of riverbed disturbance shall so far as is practicable, be minimised and any areas which are disturbed, shall so far as is practicable be reinstated.
- 5. THAT during any construction or maintenance the consent holder shall ensure that any disturbance of parts of the riverbed covered by water and/or any works which may result in downstream discolouration of water shall be undertaken only between 1 November and 30 April except where this requirement is waived by the written approval of the General Manager, Taranaki Regional Council.
- 6. THAT structure[s] which are the subject of this consent shall not obstruct fish passage.
- 7. THAT the consent holder shall develop and undertake a monitoring programme to determine the adequacy of fish passage as deemed necessary by the General Manager, Taranaki Regional Council, subject to section 35(2)(d) and section 36 of the Resource Management Act 1991. This monitoring information is to be forwarded to the General Manager, Taranaki Regional Council, upon request.
- 8. THAT the structure[s] authorised by this consent shall be removed and the area reinstated, if and when the structure[s] are no longer required. The consent holder shall notify the Taranaki Regional Council at least 48 hours prior to structure[s] removal and reinstatement.

TRK995451

9. THAT the Taranaki Regional Council may review any or all of the conditions of this consent by giving notice of review during the month of June 2001 and/or June 2005 and/or June 2011, for the purpose of ensuring that the conditions are adequate to deal with any significant adverse effects on the environment arising from the exercise of this consent, which either were not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 1 March 1999

For and on behalf of
TARANAKI REGIONAL COUNCIL



DIRECTOR - RESOURCE MANAGEMENT

TRK995452



LAND USE CONSENT

Pursuant to the RESOURCE MANAGEMENT ACT 1991
a resource consent is hereby granted by the
Taranaki Regional Council

PRIVATE BAG 713
47 CLOTEN ROAD
STRATFORD
NEW ZEALAND
PHONE 0-6-765 7127
FAX 0-6-765 5097

Name of
Consent Holder: SOUTH TARANAKI DISTRICT COUNCIL
PRIVATE BAG 902 HAWERA

Consent
Granted Date: 1 March 1999

CONDITIONS OF CONSENT

Consent Granted: TO ERECT, PLACE, USE AND MAINTAIN A WATER INTAKE STRUCTURE AND ASSOCIATED ANCILLARY STRUCTURES INCLUDING EROSION PROTECTION AND RIVER CONTROL WORKS UPSTREAM, AND A SWINGBRIDGE DOWNSTREAM, OF THE INTAKE STRUCTURE ON THE BED OF THE MANGAWHERO STREAM IN THE KAUPOKONUI CATCHMENT FOR WATER ABSTRACTION PURPOSES AT OR ABOUT GR: P20:041-016

Expiry Date: 1 June 2017

Review Date[s]: June 2001, June 2005 and June 2011

Site Location: MANGAWHERO STREAM, MANGAWHERO ROAD, KAPONGA

Legal Description: SO370 SEC 11 BLK VI KAUPOKONUI SD

Catchment: KAUPOKONUI 355.000

Tributary: MANGAWHERO 355.010

For General, Standard and Special Conditions pertaining to this consent please see reverse side of this document.

TRK995452

General conditions

- a) That on receipt of a requirement from the General Manager, Taranaki Regional Council (hereinafter the General Manager), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) That unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) That the consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions

1. THAT the consent holder shall notify the Taranaki Regional Council, at least 48 hours prior to the commencement and upon completion of the initial construction, and again prior to, and upon completion of, any subsequent maintenance works which would involve disturbance of, or the deposition to the riverbed or discharges to water.
2. THAT the structure[s] authorised by this consent shall be constructed generally in accordance with the documentation submitted in support of the application and shall be maintained to ensure the conditions of this consent are met.
3. THAT during any construction or maintenance the consent holder shall adopt the best practicable option to avoid or minimise the discharge of silt or other contaminants into the water or onto the riverbed and to avoid or minimise the disturbance of the riverbed and any adverse effects on water quality.
4. THAT during any construction or maintenance the consent holder shall ensure that the area and volume of riverbed disturbance shall so far as is practicable, be minimised and any areas which are disturbed, shall so far as is practicable be reinstated.
5. THAT during any construction or maintenance the consent holder shall ensure that any disturbance of parts of the riverbed covered by water and/or any works which may result in downstream discolouration of water shall be undertaken only between 1 November and 30 April except where this requirement is waived by the written approval of the General Manager, Taranaki Regional Council.
6. THAT structure[s] which are the subject of this consent shall not obstruct fish passage.
7. THAT the consent holder shall develop and undertake a monitoring programme to determine the adequacy of fish passage as deemed necessary by the General Manager, Taranaki Regional Council, subject to section 35(2)(d) and section 36 of the Resource Management Act 1991. This monitoring information is to be forwarded to the General Manager, Taranaki Regional Council, upon request.
8. THAT the structure[s] authorised by this consent shall be removed and the area reinstated, if and when the structure[s] are no longer required. The consent holder shall notify the Taranaki Regional Council at least 48 hours prior to structure[s] removal and reinstatement.

TRK995452

9. THAT the Taranaki Regional Council may review any or all of the conditions of this consent by giving notice of review during the month of June 2001 and/or June 2005 and/or June 2011, for the purpose of ensuring that the conditions are adequate to deal with any significant adverse effects on the environment arising from the exercise of this consent, which either were not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 1 March 1999

For and on behalf of
TARANAKI REGIONAL COUNCIL



DIRECTOR—RESOURCE MANAGEMENT

Waverley water supply

Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

Name of Consent Holder: South Taranaki District Council
Private Bag 902
HAWERA 4640

Decision Date (Change): 23 January 2013

Commencement Date (Change): 23 January 2013 (Granted: 23 September 2010)

Conditions of Consent

Consent Granted: To take and use groundwater from the "Fookes Street" bore (GND0244) at or about (NZTM) 1739130E-5597816N, the "Chester Street" bore (GND0059) at or about (NZTM) 1740040E-5597843N and the "Swinbourne Street" bore (GND2242)) at or about (NZTM) 1739058E-5597248N for municipal water supply purposes at Waverley

Expiry Date: 1 June 2022

Review Date(s): June 2016

Site Location: Fookes Street, Chester Street & Swinbourne Street, Waverley

Legal Description: Pt Sec 31 SO 34857 Waverley Tn Belt (Fookes Street)
Sec 28 Waverley Tn Belt (Chester Street)
Pt Sec 32 SO 34857 Waverley Tn Belt (Swinbourne Street)(Site of takes)

Catchment: Whenuakura
Wairoa

*For General, Standard and Special conditions
pertaining to this consent please see reverse side of this document*

General condition

- a. The consent holder shall pay to the Taranaki Regional Council all the administration, monitoring and supervision costs of this consent, fixed in accordance with section 36 of the Resource Management Act 1991.

Special conditions

1. The combined total volume of water taken from the 'Fookes Street' bore (GND0244), the 'Chester Street' bore (GND0059) and the 'Swinbourne Street' bore (GND2242) shall not exceed 900 cubic metres per day and the combined rate shall not exceed 14.2 litres per second.
2. The daily maximum take volume and abstraction rate from each individual bore shall not exceed the limits specified below:

Production bore ID	Maximum daily abstraction volume (cubic metres per day)	Maximum daily abstraction rate (litres per second)
Fookes Street (GND0244)	500	7.2
Chester Street (GND0059)	400	7.0
Swinbourne Street (GND2242)	890	10.3

3. The bores shall be easily identifiable by permanent labels, which may be welded or engraved on the casing, or on the equivalent fixed part of the well construction or associated building. The label shall show the bore number assigned by the Taranaki Regional Council (GND0244 at Fookes Street, GND0059 at Chester Street and GND2242 at Swinbourne Street).
4. Prior to the exercise this consent the consent holder shall install, and thereafter maintain a water meter and a datalogger on each bore. The water meters and dataloggers shall be tamper-proof and shall measure and record the rate and volume of water taken to an accuracy of $\pm 5\%$.

Note: Water meters and dataloggers must be installed, and regularly maintained, in accordance with manufacturer's specifications in order to ensure that they meet the required accuracy. Even with proper maintenance water meters and dataloggers have a limited life-span.

5. Prior to the commencement of abstraction from the Swinbourne Street production bore, the consent holder shall in each bore, install and subsequently maintain equipment approved by the Taranaki Regional Council to measure and record the water level within each bore.
6. The consent shall, for each bore, maintain an abstraction record, including the date and time of abstraction, instantaneous rate and cumulative abstraction volume. The consent holder shall also maintain a record of water level in each bore, at intervals not exceeding 15 minutes, and include the date and time of measurement. All records shall be made available to the Chief Executive, Taranaki Regional Council in an approved format, by 31 July each year or earlier upon request.

Consent 3313-3

7. Within 30 days of the installation of a water meter or datalogger, and upon request, the consent holder shall provide the Chief Executive, Taranaki Regional Council with a document from a suitably qualified person certifying that:
 - a. water measuring or recording equipment required by the conditions of this consent has been installed and/or maintained in accordance with the manufacturer's specifications; and
 - b. water measuring or recording equipment required by the conditions of this consent has been tested and shown to be operating to an accuracy of $\pm 5\%$.
8. If any measuring or recording equipment breaks down, or for any reason is not operational, the consent holder shall advise the Chief Executive, Taranaki Regional Council immediately. Any repairs or maintenance to this equipment must be undertaken by a suitably qualified person.
9. At all times the consent holder shall adopt the best practicable option to prevent or minimise any actual or likely adverse effect on the environment associated with the abstraction of groundwater, including, but not limited to, the efficient and conservative use of water.
10. The taking shall not cause the intrusion of salt water into any freshwater aquifer.
11. The consent holder shall ensure that there is access into the well that enables the measurement of static and pumping water levels.

Note: Compliance with this condition can be achieved with the existing wellhead configuration by allowing access to the well via the water level monitoring transducer installation tubing.

12. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2016 for the purposes of:
 - (a) ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time; and/or
 - (b) to require any data collected in accordance with the conditions of this consent to be transmitted directly to the Council's computer system, in a format suitable for providing a 'real time' record over the internet.

Signed at Stratford on 23 January 2013

For and on behalf of
Taranaki Regional Council

Director-Resource Management

Oaonui water supply



Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

PRIVATE BAG 713
47 CLOTEN ROAD
STRATFORD
NEW ZEALAND
PHONE 0-6-765 7127
FAX 0-6-765 5097

Name of
Consent Holder: Oaonui Water Supply Limited
R Stanley
P O Box 593
NEW PLYMOUTH

New Address:
P O Box 3157
Fitzroy
New Plymouth 4347

Consent Granted
Date: 22 November 2000

Conditions of Consent

Consent Granted: To take and use water from the Oaonui Stream for a rural community water supply scheme and the Maui Production Station at or about GR: P20:866-027

Expiry Date: 1 June 2018

Review Date(s): June 2006, June 2012

Site Location: Arawhata Road, Oaonui

Legal Description: Lot 1 DP 3682 Blk VII Opunake SD

Catchment: Oaonui

Consent 0231-3

General conditions

- a) That on receipt of a requirement from the Chief Executive, Taranaki Regional Council (hereinafter the Chief Executive), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) That unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) That the consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions


1. The resource consent allows the abstraction of up to 3,500 cubic metres/day at a maximum rate of up to 50 litres/second.
2. The resource consent holder shall maintain, to the satisfaction of the Chief Executive, Taranaki Regional Council, a measuring device capable of accurately recording daily rates of abstraction and shall measure, record and make such records available to the Chief Executive, Taranaki Regional Council, upon request.
3. The resource consent holder shall promote the efficient use of water and undertake a leak detection and repair programme throughout the term of the consent for the Oaonui Rural Water Supply Scheme and report on this programme by 31 May 2001, 2002, 2003, 2006, 2012 to the Chief Executive, Taranaki Regional Council.
4. The resource consent holder shall mitigate the effects of the abstraction by donating annually to the Taranaki Tree Trust \$1,000 [GST exclusive] for the purposes of providing riparian management in the Oaonui Stream catchment. The amount shall be adjusted annually according to the consumer price index, or similar index, to account for the effects of inflation.
5. The resource consent holder may apply to the Taranaki Regional Council for a change or cancellation of the conditions of this resource consent, in accordance with section 127(1)(a) of the Resource Management Act 1991, to take into account operational requirements or the results of monitoring.
6. In accordance with section 128 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review amend, delete or add to the conditions of this resource consent, at the resource consent holders expense, by giving notice of review during the month of June 2001, June 2002, June 2003, June 2006 and/or June 2012 for the purpose of:

Consent 0231-3

- (a) ensuring that the conditions are adequate to deal with any significant adverse effects arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at that time; and
- (b) assessing the reports prepared under condition 3 and scheme water use efficiency.

Signed at Stratford on 22 November 2000

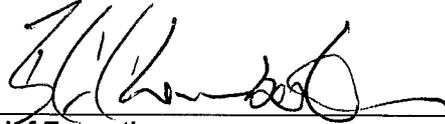For and on behalf of
Taranaki Regional Council



Chief Executive



Land Use Consent
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

PRIVATE BAG 713
47 CLOTEN ROAD
STRATFORD
NEW ZEALAND
PHONE 0-6-765 7127
FAX 0-6-765 5097

Name of
Consent Holder: Oaonui Water Supply Limited
R Stanley
P O Box 593
NEW PLYMOUTH

New Address:
P O Box 3157
Fitzroy
New Plymouth 4347

Consent Granted
Date: 1 March 1999

Conditions of Consent

Consent Granted: To erect, place, use and maintain a water intake structure on the bed of the Oaonui Stream for water abstraction purposes at or about GR: P20:865-031

Expiry Date: 1 June 2018

Review Date(s): June 2001, June 2006, June 2012

Site Location: Oaonui Stream, 685 Arawhata Road, Opunake

Legal Description: Lot 29 DP 682 Blk VIII Opunake SD

Catchment: Oaonui

Consent 5453-1

General conditions

- a) That on receipt of a requirement from the General Manager, Taranaki Regional Council (hereinafter the General Manager), the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) That unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) That the consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

Special conditions


1. THAT the consent holder shall notify the Taranaki Regional Council, at least 48 hours prior to the commencement and upon completion of the initial construction, and again prior to, and upon completion of, any subsequent maintenance works which would involve disturbance of, or deposition to the riverbed or discharges to water.
2. THAT the structure[s] authorised by this consent shall be constructed generally in accordance with the documentation submitted in support of the application and shall be maintained to ensure the conditions of this consent are met.
3. THAT during any construction or maintenance the consent holder shall adopt the best practicable option to avoid or minimise the discharge of silt or other contaminants into the water or onto the riverbed and to avoid or minimise the disturbance of the riverbed and any adverse effects on water quality.
4. THAT during any construction or maintenance the consent holder shall ensure that the area and volume of riverbed disturbance shall so far as is practicable, be minimised and any areas which are disturbed, shall so far as is practicable be reinstated.
5. THAT during any construction or maintenance the consent holder shall ensure that any disturbance of parts of the riverbed covered by water and/or any works which may result in downstream discolouration of water shall be undertaken only between 1 November and 30 April except where this requirement is waived by the written approval of the General Manager, Taranaki Regional Council.
6. THAT structure[s] which are the subject of this consent shall not obstruct fish passage.
7. THAT the consent holder shall develop and undertake a monitoring programme to determine the adequacy of fish passage as deemed necessary by the General Manager, Taranaki Regional Council, subject to section 35(2)(d) and section 36 of the Resource Management Act 1991. This monitoring information is to be forwarded to the General Manager, Taranaki Regional Council, upon request.
8. THAT the structure[s] authorised by this consent shall be removed and the area reinstated, if and when the structure[s] are no longer required. The consent holder shall notify the Taranaki Regional Council at least 48 hours prior to structure[s] removal and reinstatement.

Consent 5453-1

9. THAT the Taranaki Regional Council may review any or all of the conditions of this consent by giving notice of review during the month of June 2001 and/or June 2006 and/or June 2012, for the purpose of ensuring that the conditions are adequate to deal with any significant adverse effects on the environment arising from the exercise of this consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Transferred at Stratford on 19 October 2000

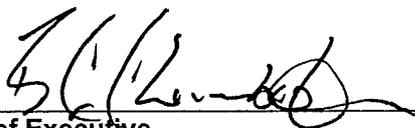For and on behalf of
Taranaki Regional Council



Chief Executive

Nukumaru water supply



Water Permit
Pursuant to the Resource Management Act 1991
a resource consent is hereby granted by the
Taranaki Regional Council

CHIEF EXECUTIVE
PRIVATE BAG 713
47 CLOTEN ROAD
STRATFORD
NEW ZEALAND
PHONE 06-765 7127
FAX 06-765 5097

Please quote our file number
on all correspondence

Name of Consent Holder: Nukumaru Water Scheme Society Inc
P O Box 53
WAITOTARA
NEW ADDRESS
186 Parsons Street
WANGANUI

Consent Granted Date: 20 October 2004

Conditions of Consent

Consent Granted: To take and use groundwater from up to two bores for the purpose of supplying the Nukumaru community rural water scheme at or about GR: R22:662-549

Expiry Date: 1 June 2039

Review Date(s): June 2010, June 2017, June 2025

Site Location: Pakaraka Road, Waitotara

Legal Description: Lot 1 DP 26645 Lot 1 DP 85667 Secs 8, 20 Blk V Secs 4, 20 Blk VI Pt Sec 4 Blk IX Nukumaru SD

Catchment: Waitotara

Tributary: Ohie

General conditions

- a) On receipt of a requirement from the Chief Executive, Taranaki Regional Council the consent holder shall, within the time specified in the requirement, supply the information required relating to the exercise of this consent.
- b) Unless it is otherwise specified in the conditions of this consent, compliance with any monitoring requirement imposed by this consent must be at the consent holder's own expense.
- c) The consent holder shall pay to the Council all required administrative charges fixed by the Council pursuant to section 36 in relation to:
 - i) the administration, monitoring and supervision of this consent; and
 - ii) charges authorised by regulations.

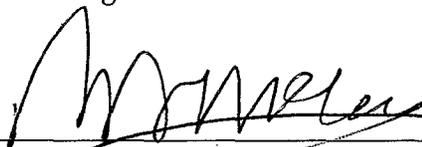
Special conditions

1. The exercise of this consent shall be undertaken in general accordance with the documentation submitted in support of application 3297 and shall ensure the efficient and effective use of water. In the case of any contradiction between the documentation submitted in support of application 3297 and the conditions of this consent, the conditions of this consent shall prevail.
2. The volume of groundwater abstracted shall not exceed 605 cubic metres per day at a rate not exceeding 7.0 litres per second.
3. The consent holder shall install and maintain a water meter approved by the Chief Executive, Taranaki Regional Council, for the purposes of accurately recording the abstraction of water.
4. The consent holder shall maintain weekly records of the abstraction including date, pumping hours and volume pumped, and make these records available to the Chief Executive, Taranaki Regional Council, no later than 31 July of each year, or upon request.
5. This consent shall be subject to monitoring by the Taranaki Regional Council and the consent holder shall meet all reasonable costs associated with the monitoring.
6. This consent shall lapse on the expiry of five years after the date of commencement of this consent, unless the consent is given effect to before the end of that period or the Taranaki Regional Council fixes a longer period pursuant to section 125(1)(b) of the Resource Management Act 1991.

7. In accordance with section 128 and section 129 of the Resource Management Act 1991, the Taranaki Regional Council may serve notice of its intention to review, amend, delete or add to the conditions of this resource consent by giving notice of review during the month of June 2010 and/or June 2017 and/or June 2025, for the purpose of ensuring that the conditions are adequate to deal with any adverse effects on the environment arising from the exercise of this resource consent, which were either not foreseen at the time the application was considered or which it was not appropriate to deal with at the time.

Signed at Stratford on 20 October 2004

For and on behalf of
Taranaki Regional Council



~~Director Resource Management~~

Appendix II

Biomonitoring reports and fish survey reports

To Job Manager, Scott Cowperthwaite
 From Scientific Officers, Chris Fowles and Bart Jansma
 Report No CF612
 Document No 1377686
 Date July 2014

Biomonitoring of the Mangawheroiti Stream in relation to the South Taranaki District Council's Waimate West Water Supply Scheme, November 2013

Introduction

The South Taranaki District Council ('STDC') owns and operates the Waimate West Water Supply Scheme (WWWSS) which involves the abstraction of water from three streams; the Mangawheroiti Stream, the Mangawhero Stream and the Otakeho Stream. This scheme provides water for dairy farms, industry, and domestic use. The main intake for the WWWWSS is on the Mangawheroiti Stream. However, the flow in Mangawheroiti Stream is supplemented by water diverted into it from the Mangawhero Stream upstream of the intake.

Consent 0634-3 authorises the taking of water from the Mangawheroiti Stream for the water supply scheme. This consent contains a Special Condition (8) that requires STDC to ensure that a minimum flow of 32 litres per second (0.032 m³/s) is provided at all times immediately downstream of the intake structure.

This biological survey was the first of two programmed for the 2013-2014 monitoring period, the inaugural survey having been performed in January 2012 and the most recent survey undertaken in March 2013. The intention of these surveys was to monitor the health of the macroinvertebrate communities in the Mangawheroiti Stream in relation to any effects of water abstraction by the WWWWSS.

Methods

This survey was undertaken on 15 November 2013 at four sites on the Mangawheroiti Stream; a control site upstream of the intake weir (1), a primary impact site approximately 40 metres downstream of the intake weir (2), a secondary impact site nearly three kilometres downstream of that intake and a tertiary impact site approximately 8.3 kilometres downstream of the intake and 340 metres upstream of the confluence with the Mangawhero Stream (Figure 1).

Table 1 Biomonitoring sites in the Mangawheroiti Stream in relation to the WWWWSS

Site	Site code	GPS location	Location	Elevation (m asl)	Distance from NPK boundary (km)
1	MWI000170	E1694422 N5637468	Upstream of the intake weir	340	3.6
2	MWI000174	E1694425 N5637409	Approximately 40 metres downstream of the water intake	340	3.7
3	MWI000330	E1694186 N5635091	Approximately 3 km downstream of the water intake (580 metres upstream of Eltham Road bridge)	270	6.5
4	MWI000490	E1693732 N5631251	Approximately 8.3 km downstream of the water intake (340 metres upstream of confluence with the Mangawhero Stream)	180	11.9

The standard '400 ml kick-sampling' technique was used to collect streambed macroinvertebrates from all sites. The 'kick-sampling' technique is very similar to Protocol C1 (hard-bottomed, semi-quantitative), of the New Zealand Macroinvertebrate Working Group (NZMWG) protocols for macroinvertebrate samples in wadeable streams (Stark *et al.*, 2001).

Samples were preserved with Kahle's Fluid for later sorting and identification under a stereomicroscope using protocol P1 of NZMWG protocols for sampling macroinvertebrates in wadeable streams (Stark *et al.* 2001). Macroinvertebrate taxa found in each sample were recorded as:

R (rare)	= less than 5 individuals;
C (common)	= 5-19 individuals;
A (abundant)	= estimated 20-99 individuals;
VA (very abundant)	= estimated 100-499 individuals;
XA (extremely abundant)	= estimated 500 individuals or more.

Stark (1985) developed a scoring system for macroinvertebrate taxa according to their sensitivity to organic pollution in stony New Zealand streams (MCI). Highly 'sensitive' taxa were assigned the highest scores of 9 or 10, while the most 'tolerant' forms scored 1 and 0.1 in hard bottomed and soft bottomed streams respectively. The sensitivity scores for certain taxa found in hard bottomed streams have been modified in accordance with Taranaki experience. After extensive use of the MCI, categories were assigned to the sensitivity scores, to clarify their 'relative' sensitivity e.g. taxa that scored between 1 and 4 inclusive are considered tolerant (see Table 3).

By averaging the scores obtained from a list of taxa taken from one site and multiplying by a scaling factor of 20, a Macroinvertebrate Community Index (MCI) value was obtained. The MCI is a measure of the overall sensitivity of macroinvertebrate communities to the effects of organic pollution. More 'sensitive' communities inhabit less polluted waterways.

A semi-quantitative MCI value (SQMCI_s) has also been calculated for the taxa present at each site by multiplying each taxon score by a loading factor (related to its abundance), totalling these products, and dividing by the sum of the loading factors (Stark 1998 and 1999). The loading factors were 1 for rare (R), 5 for common (C), 20 for abundant (A), 100 for very abundant (VA) and 500 for extremely abundant (XA). Unlike the MCI, the SQMCI_s is not multiplied by a scaling factor of 20, so that its corresponding range of values is 20x lower.

Results

During this November 2013 survey, there was a low, steady, clear, and uncoloured flow at all sites except the upstream site (1) where there was a slower flow. In the absence of a lengthy flow record for the Mangawheroiti Stream at the time of this survey, the flow data from the neighbouring Kaupokonui Stream indicated that it had been 14 days since a three times median flow and seven times median flow. In the four weeks prior to this survey, the flow in the Mangawheroiti Stream upstream of the intake weir ranged between 260 and 2900 L/s with the flow during the majority of the period below 400 L/s. The flow at the time of the survey was about 280 L/s at this recently established hydrological recording site. Water abstraction of approximately 100 L/s at the time of the survey resulted in a residual flow of 200 L/s below the weir. Water temperatures ranged from 10.2°C at the two sites adjacent to the intake, through 12.3°C (site 3), to 13.6°C at the downstream site (4) at the time of this mid morning to midday survey.

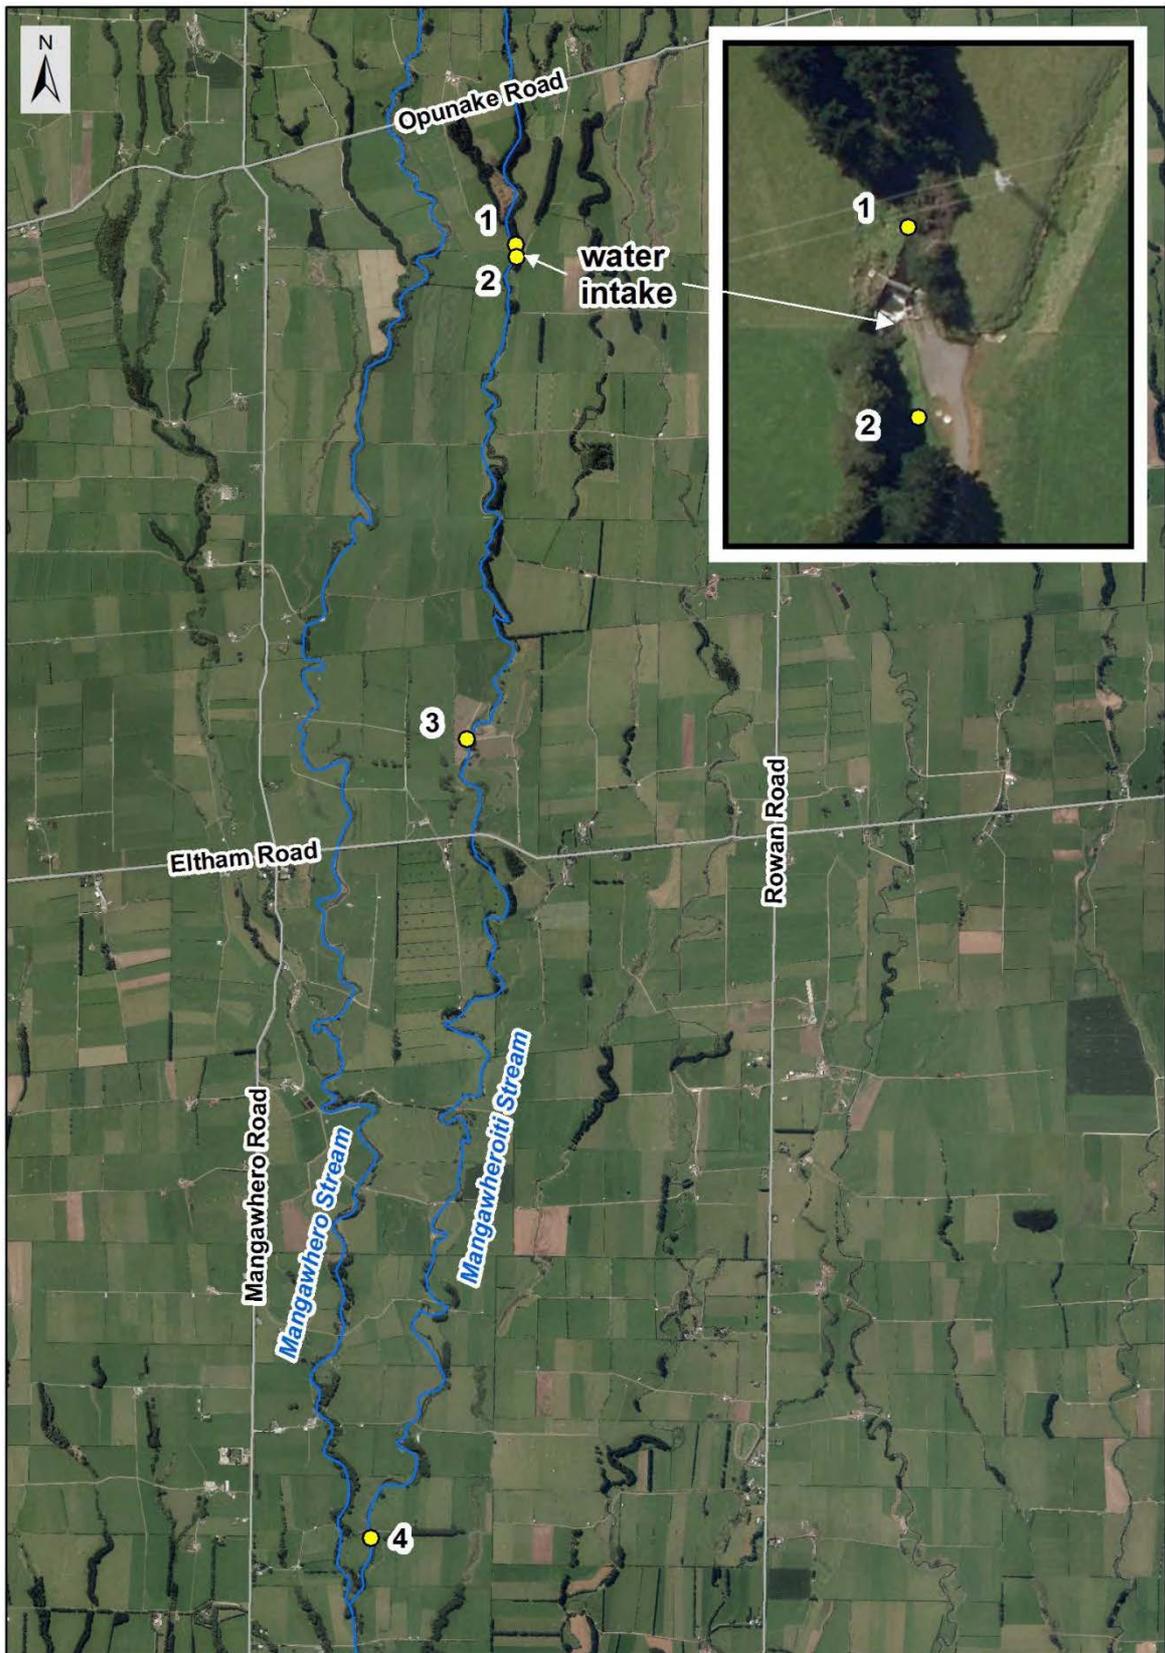


Figure 1 Biomonitoring sites related to the WWWS intake on the Mangawheroiti Stream.

Slippery mats but no filamentous algae were recorded at the partially shaded control site (1) upstream of the intake weir on the Mangawheroiti Stream. Patchy moss and leaves were also recorded at this site where the substrate composition predominantly consisted of cobbles with smaller proportions of sand, gravels, and boulders resulting in a moderately stable bed. Iron-oxide despots were noticeable in pools and at the margins of the stream bed.

At the slightly more open site 2, 40m downstream of the intake weir, thin mats but no filamentous algae were recorded, together with patchy moss and leaves. The bed substrate at this site primarily consisted of boulders, cobbles, and gravels, although there was a moderate proportion of sand and fine gravels at this site which was reflected in the very stable bed recorded by this survey.

Periphyton growth recorded at site 3 consisted of patchy mats, moss, and filamentous algae at this open site. The cyanobacteria, *Phormidium* was noted amongst the periphyton. The stream bed was composed predominantly of boulders and cobbles and there were also smaller quantities of fine and coarse gravels, and sand, recorded at this site by the current survey.

At the partially shaded site 4, upstream of the confluence with the Mangawhero Stream, there were patchy algal mats, moss, leaves, and filamentous algae present. Cobbles were predominant at this site with some coarse and fine gravels, and boulders. Smaller quantities of silt and sand were also present.

Macroinvertebrate communities

A summary of the results from the previous survey is presented in Table 2 and from the current survey in Table 3 along with predicted MCI scores using established relationships between MCI scores and ringplain stream altitude and distance from the National Park boundary (Stark and Fowles (2009)). Equations generated from these relationships can be used to predict MCI values at a particular location on a stream or river on the ringplain.

Table 2 Summary of macroinvertebrate taxa numbers, MCI and SQMCI_s values for the previous surveys performed between January 2012 and March 2013

Site	Site code	No. of surveys	Taxa numbers		MCI values		SQMCI _s value	
			Range	Median	Range	Median	Range	Median
1	MWI000170	3	31-37	34	123-132	130	7.1-7.5	7.3
2	MWI000174	3	33-36	35	122-127	125	7.0-7.3	7.1
3	MWI000330	3	20-28	26	111-129	118	7.3-8.0	7.5
4	MWI000490	3	20-30	24	95-101	97	4.4-5.3	4.7

Table 3 Results of the survey of 15 November 2013 in relation to WWWSS, and predicted MCI scores (from Stark and Fowles (2009)).

Site No.	Results			Predicted MCI scores	
	No. of taxa	MCI	SQMCI _s	Altitude	Distance
1	36	122	6.2	119	117
2	28	131	7.0	119	117
3	45	113	6.4	112	111
4	28	99	4.7	103	104

The macroinvertebrate fauna recorded by the current survey at each of the four sites are presented in Table 4.

Table 4 Macroinvertebrate fauna recorded at four sites in the Mangawheroiti Stream in relation to the WWWS water abstraction, 15 November 2013

Taxa List	Site Number	MCI score	1	2	3	4
	Site Code		MWI000170	MWI000174	MWI000330	MWI000490
	Sample Number		FWB13316	FWB13317	FWB13318	FWB13319
PLATYHELMINTHES (FLATWORMS)	<i>Cura</i>	3	-	-	R	-
NEMERTEA	Nemertea	3	-	-	R	-
NEMATODA	Nematoda	3	R	-	-	R
ANNELIDA (WORMS)	Oligochaeta	1	A	C	VA	VA
	Lumbricidae	5	R	R	R	R
MOLLUSCA	<i>Potamopyrgus</i>	4	R	R	C	A
CRUSTACEA	<i>Paracalliope</i>	5	R	R	-	R
	Talitridae	5	-	-	R	-
EPHEMEROPTERA (MAYFLIES)	<i>Acanthophlebia</i>	9	-	R	-	-
	<i>Ameletopsis</i>	10	C	R	R	-
	<i>Austroclima</i>	7	-	C	A	C
	<i>Coloburiscus</i>	7	-	VA	VA	R
	<i>Deleatidium</i>	8	A	A	XA	VA
	<i>Ichthyobolus</i>	8	R	-	R	-
	<i>Neozephlebia</i>	7	C	-	-	-
	<i>Nesameletus</i>	9	A	A	A	R
	<i>Oniscigaster</i>	10	R	-	R	-
	<i>Zephlebia group</i>	7	A	C	C	R
PLECOPTERA (STONEFLIES)	<i>Acroperla</i>	5	-	-	R	-
	<i>Megaleptoperla</i>	9	R	-	R	-
	<i>Stenoperla</i>	10	R	R	-	-
	<i>Zelandobius</i>	5	-	-	C	A
	<i>Zelandoperla</i>	8	-	R	R	-
HEMIPTERA (BUGS)	<i>Saldula</i>	5	-	-	R	-
	<i>Sigara</i>	3	-	-	R	-
COLEOPTERA (BEETLES)	Elmidae	6	VA	VA	XA	VA
	Hydraenidae	8	-	A	A	-
	Ptilodactylidae	8	R	-	R	R
	Scirtidae	8	R	-	-	-
	Staphylinidae	5	-	-	-	R
MEGALOPTERA (DOBSONFLIES)	<i>Archichauliodes</i>	7	C	C	A	A
TRICHOPTERA (CADDISFLIES)	<i>Aoleapsyche</i>	4	R	R	A	A
	<i>Costachorema</i>	7	R	-	C	C
	<i>Hydrobiosis</i>	5	-	R	C	C
	<i>Neurochorema</i>	6	-	-	R	-
	<i>Orthopsyche</i>	9	-	R	-	-
	<i>Plectrocnemia</i>	8	-	-	R	-
	<i>Beraeoptera</i>	8	C	VA	A	-
	<i>Helicopsyche</i>	10	C	R	C	-
	Oeconesidae	5	R	-	-	-
	<i>Olinga</i>	9	C	C	C	-
	<i>Oxyethira</i>	2	-	-	R	A
	<i>Pycnocentria</i>	7	C	-	-	-
	<i>Pycnocentroides</i>	5	R	R	VA	VA
	<i>Triplectides</i>	5	R	R	-	R
<i>Zelolessica</i>	7	R	-	-	-	
DIPTERA (TRUE FLIES)	<i>Aphrophila</i>	5	R	C	C	C
	Eriopterini	5	-	C	R	-
	<i>Maoridiamesa</i>	3	-	-	C	A
	Orthoclaadiinae	2	C	-	A	A
	<i>Polypedilum</i>	3	-	-	R	-
	Tanypodinae	5	A	C	R	-
	Tanytarsini	3	-	-	R	C
	Empididae	3	R	C	R	R
	Psychodidae	1	R	-	-	-
	<i>Austrosimulium</i>	3	R	-	R	C
Tabanidae	3	-	-	R	-	
Tanyderidae	4	R	-	R	-	
ACARINA (MITES)	Acarina	5	R	-	-	R
No of taxa			36	28	45	28
MCI			122	131	113	99
SQMCIs			6.2	7.0	6.4	4.7
EPT (taxa)			19	17	21	11
%EPT (taxa)			53	61	47	39
'Tolerant' taxa		'Moderately sensitive' taxa		'Highly sensitive' taxa		

R = Rare C = Common A = Abundant VA = Very Abundant XA = Extremely Abundant

Site 1 (upstream of intake weir)

A very high richness (36 taxa) was recorded, well above the median number (23 taxa) and close to the maximum (37 taxa) found by more than 175 previous surveys of National Park-sourced streams at 'control' sites between 300 and 350 m asl (TRC, 1999 (updated 2013)). This richness was in the range found by the three previous surveys performed at this site. The community was comprised of a very high proportion (75%) of 'sensitive' taxa, twelve of which were 'highly sensitive' taxa. The community was characterised by two 'highly sensitive' taxa [mayflies (*Deleatidium* and *Nesameletus*)]; three 'moderately sensitive' taxa [mayfly (*Zephlebia* group), elmids beetles, and tanypod midges]; and one 'tolerant' taxon [oligochaete worms]. The numerical dominance by 'sensitive' taxa (particularly one 'moderately sensitive' taxon), resulted in the moderately high SQMCI_s value of 6.2 units, but 0.9 to 1.3 units below values recorded by the three previous surveys when some 'highly sensitive' taxa were predominant (Table 2). This was indicative of good physical habitat and preceding physicochemical water quality, typical of the upper mid-reaches of ringplain streams.

The high proportion of 'sensitive' taxa comprising the community resulted in the relatively high MCI score (122 units) which was one unit below the minimum of the range recorded by the three previous surveys and an insignificant 4 units above the median MCI score recorded by more than 175 surveys of 'control' sites in National Park-sourced rivers and streams between 300 and 350 m asl (TRC, 1999 (updated 2013)). It was also 3 and 5 units above predicted (Stark & Fowles, 2009) altitude and distance scores respectively (Table 3) and categorised this site as having 'very good' generic stream health and 'expected' predictive health (TRC, 2014) for a site in the upper mid-reaches of a ringplain stream.

Site 2 (40 m downstream of intake weir)

A moderately high richness (28 taxa) was found at this site, eight taxa fewer than at the site upstream of the weir, and five taxa more than the median richness recorded by more than 175 previous surveys at similar 'control' sites (see above and TRC, 1999 (updated, 2013)). This was five to eight taxa fewer than the richnesses recorded by the three previous surveys at this site (Table 2) with a community composition mainly comprised of 'sensitive' taxa (86% of richness), 11 of which were 'highly sensitive' taxa. The community was characterised by three of the six dominant taxa at the upstream 'control' site, with the addition of two 'highly sensitive' taxa [hydraenid beetles and flare-cased caddisfly (*Beraeoptera*)] and one 'moderately sensitive' taxon [mayfly (*Coloburiscus*)]; and three fewer taxa ['moderately sensitive' mayfly (*Zephlebia* group) and tanypod midges, and 'tolerant' oligochaete worms]. The continued numerical dominance by 'sensitive' taxa (four 'highly sensitive' and two 'moderately sensitive' taxa in particular) resulted in a high SQMCI_s value of 7.0 units, within the range of scores recorded by the previous three surveys (Table 2) and 0.8 unit higher than the score at the upstream site (Table 4). This was also indicative of good physical habitat and preceding physicochemical water quality, typical of the upper, mid-reaches of ringplain streams, and coincidental with minimal periphyton substrate cover.

The high proportion of 'sensitive' taxa in the composition of the community was reflected in the high MCI score (131 units), an insignificant nine units above that found at the 'control' site upstream of the intake weir, four units higher than the maximum score recorded by the three previous surveys and a significant (Stark, 1998) 13 units above the median score recorded by more than 175 previous surveys at similar sites (see above and TRC, 1999 (updated, 2013)). The score was also significantly 12 and 14 units above predicted altitude and distance scores respectively (Stark and Fowles, 2009; Table 3). This categorised the site

as having 'very good' generic stream health and 'better than expected' predictive health (TRC, 2014) for a site in the upper mid reaches of a ringplain stream.

Site 3 (approximately 3 km downstream of the intake)

Taxa richness (45) was extremely high for a site in the mid-reaches of a ringplain stream; nine taxa above the maximum richness found to date by 170 surveys of 'control' sites in National Park-sourced streams at altitudes between 250 and 299 m asl (and the maximum richness found to date at any ringplain site in the region (TRC, 1999 (updated, 2013))). This richness was 17 taxa more than the highest richness of the three previous surveys at this site (Table 2). The community comprised a high proportion (67%) of 'sensitive' taxa, thirteen of which were 'highly sensitive' taxa. It was characterised by all of the same 'highly sensitive' and 'moderately sensitive' taxa also dominant at site 2 (3 km upstream), plus three additional 'moderately sensitive' taxa [mayfly (*Austroclima*), dobsonfly (*Archichauliodes*), and stony-cased caddisfly (*Pycnocentroides*)] and three 'tolerant' taxa [oligochaete worms, net-spinning caddisfly (*Aoteapsyche*), and orthoclad midges]. This continued numerical dominance mainly by 'sensitive' taxa resulted in a relatively high SQMCI_s value of 6.2 units which was 1.1 to 1.8 units lower than the range found by the three previous surveys (Table 2) but 0.2 unit higher than recorded at the upstream 'control' site (1). This was an indication of relatively good physical habitat and preceding physicochemical water quality (under conditions of about 36% reduction in upstream flow), and better than typical of the mid-reaches of ringplain streams, coincidental with moderate periphyton substrate cover.

The relatively high proportion of 'sensitive' taxa comprising this community resulted in a moderate MCI value of 113 units, which was typically lower (by 9 units) than the score upstream of the intake weir but also from 16 units lower to 2 units higher than recorded by the three previous surveys at this site. This current score was also an insignificant 2 units below the median score recorded by 170 previous surveys at similar sites (see above and TRC, 1999 (updated, 2013)) and within two units of predicted altitude and distance from the National Park boundary scores respectively (Stark and Fowles, 2009; Table 2). This score characterised the site as having 'good' generic stream health and 'expected' predictive health (TRC, 2014) for a site in the mid-reaches of a ringplain stream.

Site 4 (approximately 8 km downstream of the intake weir)

The moderately high richness (28 taxa) at this site was eight taxa more than the median taxa number found by 358 previous surveys of National Park-sourced streams at 'control' sites between 155 and 199 m asl (TRC, 1999 (updated, 2013)), and from two taxa less to eight taxa more than found by the three previous surveys at this site (Table 2). The community comprised a higher proportion (36%) of 'tolerant' taxa than in any of the three upstream sites' communities, and fewer (three) 'highly sensitive' taxa. It was characterised by only one 'highly sensitive' taxon [mayfly (*Deleatidium*)]; four 'moderately sensitive' taxa [stonefly (*Zelandobius*), elmid beetles, dobsonfly (*Archichauliodes*), and stony-cased caddisfly (*Pycnocentroides*)]; and six 'tolerant' taxa [oligochaete worms, snail (*Potamopyrgus*), net-building caddisfly (*Aoteapsyche*), algal-piercing caddisfly (*Oxyethira*), and midges (orthoclads and *Maoridiamesa*)]. Several significant differences in individual taxon abundances were found between adjacent sites (3 and 4) which principally involved decreasing numbers within 'highly sensitive' (five) and 'moderately sensitive' (one) taxa and increasing numbers within one 'tolerant' taxon. The numerical dominance shared between three 'sensitive' and one 'tolerant' taxa (particularly the oligochaete worms) was responsible for the moderate SQMCI_s value of 4.7 units which was equivalent with the median found by the three previous surveys at this site, and significantly lower (1.7 units) than the score at the nearest upstream site, 3 (Table 4). This value was coincident with more dense filamentous algae

streambed periphyton cover although there was a similar algal mat cover. The moderately high percentage of 'sensitive' taxa was indicative of relatively good preceding physicochemical water quality conditions during the wet early spring period preceding this survey.

The relative balance between 'tolerant' and 'sensitive' taxa (but lower 'highly sensitive' taxa component) comprising this community resulted in a moderate MCI score of 99 units, a significant 14 units (Stark, 1998) lower than the score at site 3 (5.4 km upstream), and two units higher than the median score recorded by the three previous surveys at this site (Table 2). The current score was 8 units below the median score recorded by more than 358 previous surveys of 'control' sites in National Park-sourced streams situated between 155 and 199 m asl (TRC, 1999 (updated, 2013)) and four to five units lower than predicted altitude and distance from the National Park boundary values (Stark and Fowles, 2009 (Table 3)). This characterised the site as having 'fair' generic stream health and 'expected' predictive health (TRC, 2014) for a site in the mid reaches of a ringplain stream.

Discussion and conclusions

The abstraction of surface water particularly for extended periods of time may result in significant adverse effects on the macroinvertebrate communities living within a waterbody by altering stream temperature, flow conditions, wetted habitat, periphyton growth, and certain aspects of physicochemical water quality. This November 2013 survey was undertaken to monitor whether the operation of the WWSS was having an effect on the macroinvertebrate communities in the Mangawheroiti Stream downstream of the water take under spring relatively low flow conditions after a wet early spring period.

The macroinvertebrate communities recorded at sites 1 and 2 comprised very high proportions of 'sensitive' taxa and were numerically dominated by up to three very or extremely abundant 'sensitive' taxa. The composition of the communities at both sites reflected the partially shaded, relatively cool, stony nature of the stream located in the upper mid-reaches of the catchment. This resulted in relatively high and similar MCI and SQMCI_s scores at both sites which were higher than the predicted scores for each site, based on altitude and distance from the National Park boundary. This was consistent with good preceding physical habitat conditions immediately upstream and downstream of the intake weir indicative of no recent significant impacts of water abstraction over a recent period of residual flow with a minimum of about 100 L/sec, and an actual residual flow of about 180 L/sec at the time of the survey.

At site 3, approximately 3 kilometres downstream of the water intake, the macroinvertebrate community again comprised a high proportion of 'sensitive' taxa which was reflected in the MCI score of 113 units. This MCI score was very similar to the predicted scores for altitude and distance from the National Park (Stark and Fowles 2009), and typically, was lower than at site 1 and site 2. This result reflected the differences in site location within the catchment and in habitat quality between sites (eg. a more intact riparian margin at sites 1 and 2 compared to site 3). The extremely taxa rich community at site 3 was dominated by relatively similar 'sensitive' taxa including two very or extremely abundant 'highly sensitive' taxa but with the addition of three 'tolerant' taxa coincident with increases in filamentous algal and mats periphyton substrate cover. However, most of these dominant taxa were indicative of relatively good preceding physicochemical water quality and habitat conditions.

In the current survey, the lowest MCI and SQMCI_s scores were recorded at site 4 where the community was comprised of the highest proportion of 'tolerant' taxa. This community was also numerically dominated by more 'tolerant taxa' and fewer 'highly and moderately sensitive' taxa than at the three upstream sites, a typical downstream trend in ringplain streams. There was a significant (Stark, 1998) decrease in both the MCI and SQMCI_s scores between sites 3 and 4. This was coincident with some increase in the density of filamentous algal periphyton substrate cover at site 4, a probable reflection of the cumulative impacts of increased nutrient inputs to the stream from point source and non-point source discharges and increased water temperatures in a downstream direction through the mid-catchment under more recent lower flow, late spring conditions.

The overall MCI score decline of 23 and 32 units between sites 1 and 4 and sites 2 and 4 respectively over a stream distance of 8.3 km equated to rates of decline of 2.8 and 3.9 units/km, which were markedly higher than the predicted rate of 1.6 units/km for the equivalent reach of a National Park sourced stream (Stark and Fowles, 2009), and the rate (2.6 units/km) found by the previous spring survey (in November 2012), but below the rate (4.2 units/km) found by the previous (summer) survey in March, 2013. The rate of decline between sites 2 and 3 and sites 3 and 4 (over stream lengths of 2.8 and 5.4 km respectively) of 6.4 and 2.6 units/km were significantly 4.3 and 1.9 MCI units/km higher than predicted for those equivalent reaches, indicative of more marked deterioration in macroinvertebrate community health in these lower mid-reaches of the Mangawheroiti Stream.

These effects may have been exacerbated by a reduction in available instream dilution of any point source discharges due to the abstraction of higher quality flow upstream by the water supply scheme.

Summary

Macroinvertebrate sampling was undertaken on 15 November 2013, at four sites in the Mangawheroiti Stream; a control site upstream of the intake weir (1), a primary impact site approximately 40 metres downstream of the intake weir (2), a secondary impact site 3 kilometres downstream of that intake and a tertiary impact site approximately 5.6 kilometres downstream of the intake and 340 metres upstream of the confluence with the Mangawhero Stream. Sampling was performed at all four sites using the 'kick' sampling technique, a standard sampling technique used by the Council. This was undertaken to assess whether the abstraction of water from the Mangawheroiti Stream for the WWWS had had any adverse effects on the macroinvertebrate communities of this stream. Samples were processed to provide number of taxa (richness), MCI and SQMCI_s scores for each site.

The MCI is a measure of the overall sensitivity of the macroinvertebrate community to the effects of organic pollution in stony streams. It is based on the presence/absence of taxa with varying degrees of sensitivity to environmental conditions. The SQMCI_s takes into account taxa abundance as well as sensitivity to pollution, and may reveal more subtle changes in communities, particularly if non-organic impacts are occurring. Significant differences in the MCI or the SQMCI_s between sites indicate the degree of adverse effects (if any) of the activity monitored.

This late spring survey did not indicate that the water abstraction for the WWWS from the Mangawheroiti Stream had significantly affected the freshwater macroinvertebrate communities immediately downstream of the abstraction point.

Relatively high MCI and SQMCI_s scores were recorded at the upstream control site (1). These scores were relatively similar although better than those recorded at site 2, located approximately 40 metres downstream of the water take. Typically there was a marked decline in MCI score between sites 2 and 3 although the SQMCI_s score at site 3 remained relatively high due to increased numerical abundances within some 'sensitive' taxa. It was noted that these typical trends continued coincidental with the extremely rich community recorded at site 3 (45 taxa); the highest richness recorded at any site on the Taranaki ringplain or anywhere else in the region to date (TRC, 1999 (updated, 2013)).

The results of this survey showed a significant decline in the macroinvertebrate communities in the reaches between sites 1 and 4, sites 2 and 3, and sites 3 and 4, where the MCI rates of decline were significantly higher than predicted. This is consistent with a general trend of increasing water temperature and decreasing physicochemical water quality with decreasing altitude in ringplain streams in the region coincident with point and non-point source discharges within such reaches. Abstraction of water from the Mangawheroiti Stream may exacerbate the decline in macroinvertebrate 'health' by reducing available dilution of such discharges particularly as cumulative impacts occur in a downstream direction.

References

- Fowles CR and Smith KL, 2012: Biomonitoring of the Mangawheroiti Stream in relation to the Waimate West Water Supply Scheme, November 2012. TRC Internal Report CF580.
- Fowles CR and Jansma B, 2013: Biomonitoring of the Mangawheroiti Stream in relation to the Waimate West Water Supply Scheme, March 2013. TRC Internal Report CF582.
- Smith KL, 2012: Biomonitoring of the Mangawheroiti Stream in relation to the Waimate West Water Supply Scheme, January 2012. TRC Internal Report KS017.
- Stark JD, 1985: A macroinvertebrate community index of water quality for stony streams. *Water and Soil Miscellaneous Publication No. 87*.
- Stark JD, 1998: SQMCI: a biotic index for freshwater macroinvertebrate coded abundance data. *New Zealand Journal of Marine and Freshwater Research* 32(1): 55-66.
- Stark JD, 1999: An evaluation of Taranaki Regional Council's SQMCI biomonitoring index. Cawthron Institute, Nelson. Cawthron Report No. 472.
- Stark JD, Boothroyd IKG, Harding JS, Macted JR, Scarsbrook MR, 2001: Protocols for sampling macroinvertebrates in wadeable streams. New Zealand Macroinvertebrate Working Group Report No. 1. Prepared for the Ministry for the Environment. Sustainable Management Fund Project No. 5103. 57p.
- Stark JD and Macted JR, 2004. Macroinvertebrate community indices for Auckland's soft-bottomed streams and applications to SOE reporting. Prepared for Auckland Regional Council. Cawthron Report No. 970. Cawthron Institute, Nelson. ARC Technical Publication 303. 59p.

Stark JD and Maxted JR, 2007. A biotic index for New Zealand's soft bottomed streams. *New Zealand Journal of Marine and Freshwater Research* 41(1).

Stark JD and Maxted JR, 2007a. A user guide for the macroinvertebrate community index. Cawthron Institute, Nelson. Cawthron Report No. 1166.

Stark JD and Fowles CR, 2009. Relationships between MCI, site altitude, and distance from source Taranaki ring plain streams. Stark Environmental report No. 2009-01

TRC, 1999: Some statistics from the Taranaki Regional Council database of freshwater macroinvertebrate surveys performed during the period from January 1980 to 31 December 1998. TRC Technical Report 99-17.

TRC, 2014: Freshwater macroinvertebrate fauna biological monitoring programme Annual SEM Report 2012-2013. Technical Report 2013-48.

To Job Manager, Scott Cowperthwaite
 From Scientific Officer, Brooke Thomas
 Report No BT035
 Document No 1419591
 Date October 2014

Biomonitoring of the Mangawheroiti Stream in relation to the South Taranaki District Council's Waimate West Water Supply Scheme, February 2014

Introduction

The South Taranaki District Council ('STDC') owns and operates the Waimate West Water Supply Scheme (WWSS) which involves the abstraction of water from three streams; the Mangawheroiti Stream, the Mangawhero Stream and the Otakeho Stream. This scheme provides water for dairy farms, industry, and domestic use. The main intake for the WWSS is on the Mangawheroiti Stream. However, the flow in Mangawheroiti Stream is supplemented by water diverted into it from the Mangawhero Stream upstream of the intake.

Consent 0634-3 authorises the taking of water from the Mangawheroiti Stream for the water supply scheme. This consent contains a Special Condition (8) that requires STDC to ensure that a minimum flow of 32 litres per second (0.032 m³/s) is provided at all times immediately downstream of the intake structure.

This biological survey was the second of two programmed for the 2013-2014 monitoring period, the inaugural survey having been performed in January 2012 and the most recent survey undertaken in February 2014. The intention of these surveys was to monitor the health of the macroinvertebrate communities in the Mangawheroiti Stream in relation to any effects of water abstraction by the WWSS.

Methods

This survey was undertaken on 05 February 2014 at four sites on the Mangawheroiti Stream; a control site upstream of the intake weir (1), a primary impact site approximately 40 metres downstream of the intake weir (2), a secondary impact site nearly three kilometres downstream of that intake and a tertiary impact site approximately 8.3 kilometres downstream of the intake and 340 metres upstream of the confluence with the Mangawhero Stream (Figure 1).

Table 1 Biomonitoring sites in the Mangawheroiti Stream in relation to the WWSS

Site	Site code	GPS location	Location	Elevation (m asl)	Distance from NPK boundary (km)
1	MWI000170	E1694422 N5637468	Upstream of the intake weir	340	3.6
2	MWI000174	E1694425 N5637409	Approximately 40 metres downstream of the water intake	340	3.7
3	MWI000330	E1694186 N5635091	Approximately 3 km downstream of the water intake (580 metres upstream of Eltham Road bridge)	270	6.5
4	MWI000490	E1693732 N5631251	Approximately 8.3 km downstream of the water intake (340 metres upstream of confluence with the Mangawhero Stream)	180	11.9

The standard '400 ml kick-sampling' technique was used to collect streambed macroinvertebrates from all sites. The 'kick-sampling' technique is very similar to Protocol C1 (hard-bottomed, semi-quantitative), of the New Zealand Macroinvertebrate Working Group (NZMWG) protocols for macroinvertebrate samples in wadeable streams (Stark *et al.*, 2001).

Samples were preserved with Kahle's Fluid for later sorting and identification under a stereomicroscope using protocol P1 of NZMWG protocols for sampling macroinvertebrates in wadeable streams (Stark *et al.* 2001). Macroinvertebrate taxa found in each sample were recorded as:

R (rare)	= less than 5 individuals;
C (common)	= 5-19 individuals;
A (abundant)	= estimated 20-99 individuals;
VA (very abundant)	= estimated 100-499 individuals;
XA (extremely abundant)	= estimated 500 individuals or more.

Stark (1985) developed a scoring system for macroinvertebrate taxa according to their sensitivity to organic pollution in stony New Zealand streams (MCI). Highly 'sensitive' taxa were assigned the highest scores of 9 or 10, while the most 'tolerant' forms scored 1 and 0.1 in hard bottomed and soft bottomed streams respectively. The sensitivity scores for certain taxa found in hard bottomed streams have been modified in accordance with Taranaki experience. After extensive use of the MCI, categories were assigned to the sensitivity scores, to clarify their 'relative' sensitivity e.g. taxa that scored between 1 and 4 inclusive are considered tolerant (see Table 3).

By averaging the scores obtained from a list of taxa taken from one site and multiplying by a scaling factor of 20, a Macroinvertebrate Community Index (MCI) value was obtained. The MCI is a measure of the overall sensitivity of macroinvertebrate communities to the effects of organic pollution. More 'sensitive' communities inhabit less polluted waterways.

A semi-quantitative MCI value (SQMCI_s) has also been calculated for the taxa present at each site by multiplying each taxon score by a loading factor (related to its abundance), totalling these products, and dividing by the sum of the loading factors (Stark 1998 and 1999). The loading factors were 1 for rare (R), 5 for common (C), 20 for abundant (A), 100 for very abundant (VA) and 500 for extremely abundant (XA). Unlike the MCI, the SQMCI_s is not multiplied by a scaling factor of 20, so that its corresponding range of values is 20x lower.

Results

During this February 2014 survey, there was a low, slow, clear, and uncoloured flow at all sites except at site 2 where there was a steady flow. In the absence of a lengthy flow record for the Mangawheroiti Stream at the time of this survey, the flow data from the neighbouring Kaupokonui Stream indicated that it had been nine days since a three times median flow and 15 days since a seven times median flow. In the four weeks prior to this survey, the flow in the Mangawheroiti Stream upstream of the intake weir ranged between 221 L/s and 2913 L/s with the flow during the majority of the period below 302 L/s. The flow at the time of the survey was about 245 L/s at this recently established hydrological recording site. Water abstraction of approximately 101 L/s at the time of the survey resulted in a residual flow of 144 L/s below the weir. Water temperatures ranged from 12.9°C at site 1 and 13.0°C at site 2 adjacent to the intake, to 16.2°C at site 3 and 17.3°C at site 4.

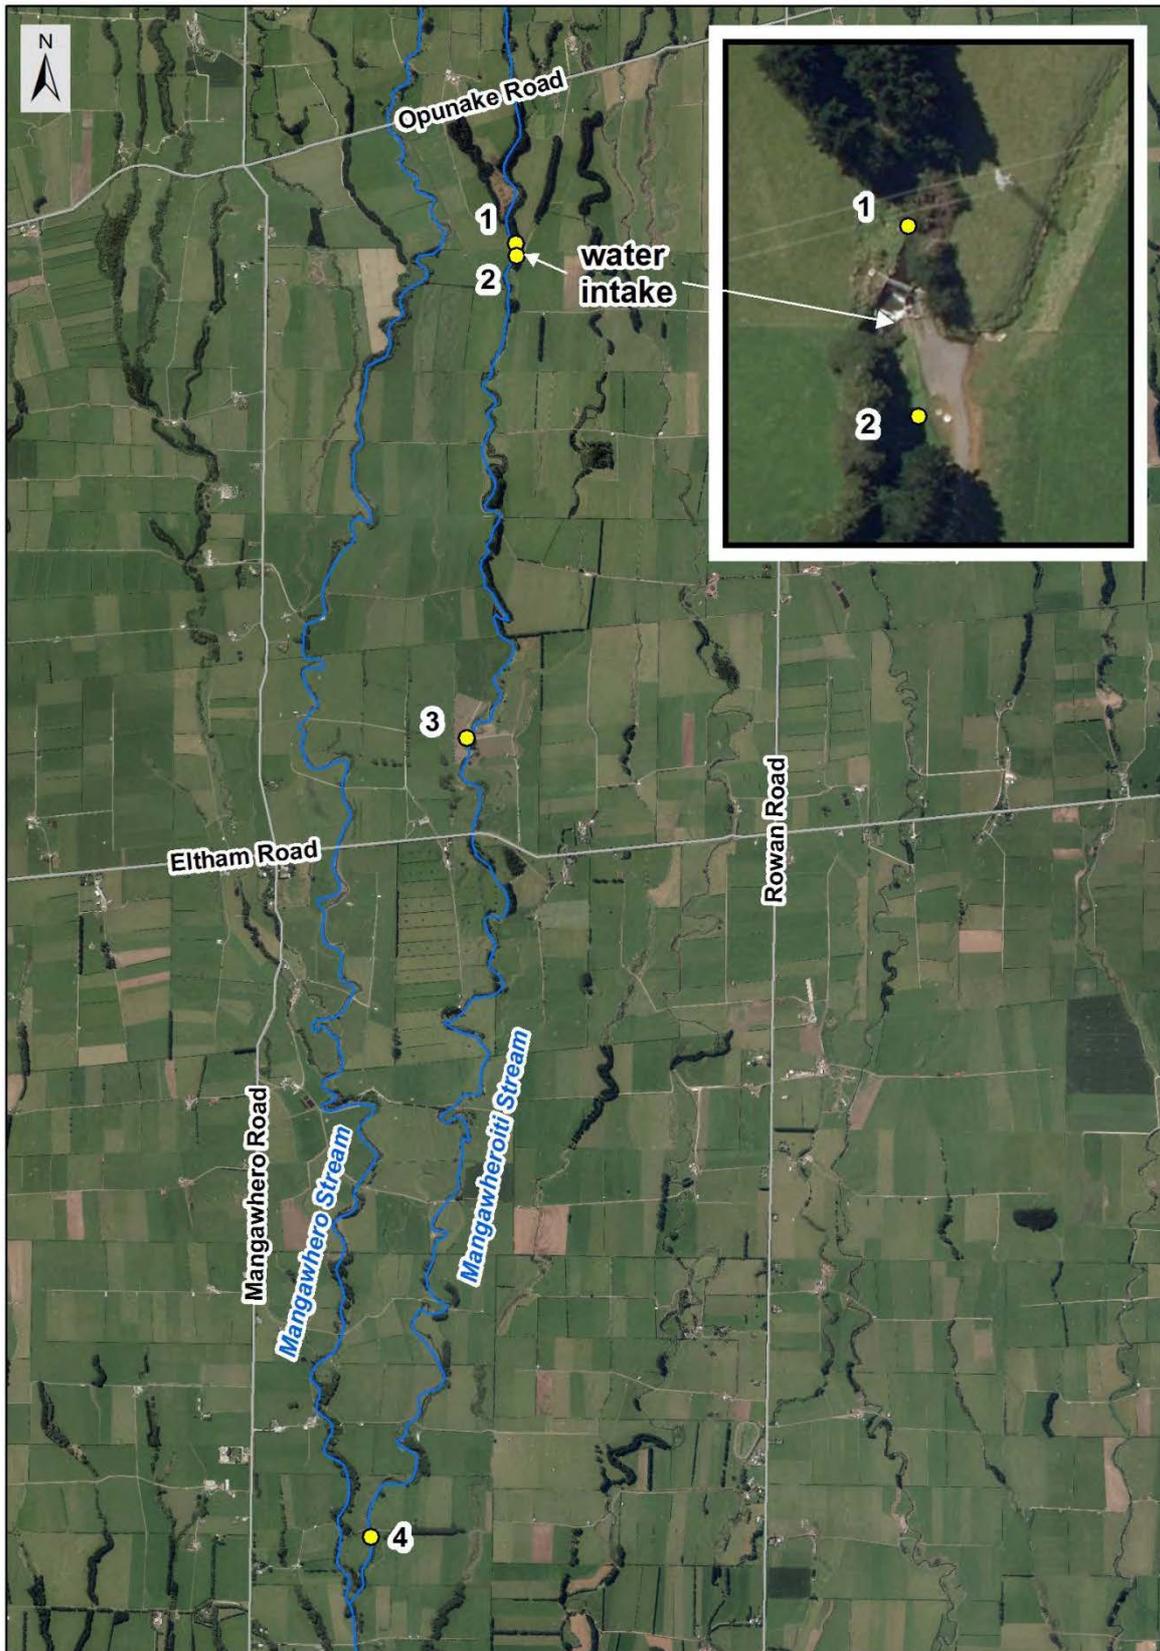


Figure 1 Biomonitoring sites related to the WWWS intake on the Mangawheroiti Stream.

Widespread mats and patchy filaments of algae were recorded at the partially shaded control site 1 upstream of the intake weir on the Mangawheroiti Stream. Widespread moss and patchy leaves were also recorded at this site where the substrate composition predominantly consisted of cobbles with smaller proportions of silt, sand, gravels, and boulders resulting in a moderately stable bed. Iron-oxide despoths were noticeable in pools and at the margins of the stream bed.

At the partially shaded site 2, 40m downstream of the intake weir, slippery mats but no filamentous algae were recorded, together with patchy moss. Macrophytes were recorded, but only at the edges of the stream. The bed substrate at this site primarily consisted of cobbles and gravels, although there was a moderate proportion of silt, sand and boulders at this site which was reflected in the moderately stable bed recorded by this survey.

Periphyton growth recorded at site 3 consisted of widespread mats and filaments. Patchy moss and macrophytes growing at the edges of the stream were also recorded at this open site. The stream bed was composed predominantly of boulders and cobbles and there were also smaller quantities of fine and coarse gravels sand and silt.

At the partially shaded site 4, upstream of the confluence with the Mangawhero Stream, widespread mats and patchy filaments of algae were recorded. Patchy moss was also present, and macrophytes were recorded growing at the edges of the stream. Cobbles were predominant at this site with some boulders, coarse and fine gravels, and smaller quantities of silt and sand.

Macroinvertebrate communities

A summary of the results from the previous survey is presented in Table 2 and from the current survey in Table 3 along with predicted MCI scores using established relationships between MCI scores and ringplain stream altitude and distance from the National Park boundary (Stark and Fowles (2009)). Equations generated from these relationships can be used to predict MCI values at a particular location on a stream or river on the ringplain.

Table 2 Summary of macroinvertebrate taxa numbers, MCI and SQMCI_s values for the previous surveys performed between January 2012 and February 2014

Site	Site code	No. of surveys	Taxa numbers		MCI values		SQMCI _s value	
			Range	Median	Range	Median	Range	Median
1	MWI000170	4	31-37	35	121-132	127	6.2-7.5	7.2
2	MWI000174	4	28-36	34	122-131	126	7.0-7.3	7.1
3	MWI000330	4	20-45	27	111-129	116	7.4-8.0	7.4
4	MWI000490	4	20-30	26	95-101	98	4.4-5.3	4.7

Table 3 Results of the survey of 05 February 2014 in relation to WWWS, and predicted MCI scores (from Stark and Fowles (2009)).

Site No.	Results			Predicted MCI scores	
	No. of taxa	MCI	SQMCI _s	Altitude	Distance
1	38	129	7.0	119	117
2	25	125	7.4	119	117
3	24	107	4.8	112	111
4	29	101	3.9	103	104

The macroinvertebrate fauna recorded by the current survey at each of the four sites are presented in Table 4.

Table 4 Macroinvertebrate fauna recorded at four sites in the Mangawheroiti Stream in relation to the WWWS water abstraction, 05 February 2014

Taxa List	Site Number	MCI score	Site 1	Site 2	Site 3	Site 4
	Site Code		MWI000170	MWI000174	MWI000330	MWI000490
	Sample Number		FWB14060	FWB14061	FWB14062	FWB14063
NEMERTEA	Nemertea	3	-	-	-	R
NEMATODA	Nematoda	3	-	-	-	R
ANNELIDA (WORMS)	Oligochaeta	1	C	R	R	A
	Lumbricidae	5	R	R	R	R
MOLLUSCA	<i>Potamopyrgus</i>	4	R	R	-	A
CRUSTACEA	<i>Paracalliope</i>	5	-	-	-	R
EPHEMEROPTERA (MAYFLIES)	<i>Acanthophlebia</i>	9	R	-	-	-
	<i>Ameletopsis</i>	10	R	-	-	-
	<i>Austroclima</i>	7	VA	A	VA	A
	<i>Coloburiscus</i>	7	VA	XA	VA	C
	<i>Deleatidium</i>	8	VA	XA	A	A
	<i>Neozephlebia</i>	7	R	-	-	-
	<i>Nesameletus</i>	9	C	R	C	R
	<i>Oniscigaster</i>	10	R	-	-	-
	<i>Zephlebia group</i>	7	R	-	-	-
	PLECOPTERA (STONEFLIES)	<i>Acroperla</i>	5	R	-	-
<i>Austroperla</i>		9	-	R	-	-
<i>Megaleptoperla</i>		9	C	A	-	-
<i>Stenoperla</i>		10	R	-	-	-
<i>Zelandobius</i>		5	-	-	-	R
<i>Zelandoperla</i>		8	C	A	R	R
Elmidae		6	VA	VA	A	A
COLEOPTERA (BEETLES)	Dytiscidae	5	R	-	-	-
	Hydraenidae	8	A	A	R	R
	Ptilodactylidae	8	R	-	-	R
MEGALOPTERA (DOBSONFLIES)	<i>Archichauliodes</i>	7	A	A	R	A
TRICHOPTERA (CADDISFLIES)	<i>Aoteapsyche</i>	4	A	A	VA	XA
	<i>Costachorema</i>	7	-	-	C	A
	<i>Hydrobiosis</i>	5	C	R	C	A
	<i>Hydrobiosella</i>	9	R	-	-	-
	<i>Neurochorema</i>	6	-	-	R	-
	<i>Orthopsyche</i>	9	C	C	-	-
	<i>Beraeoptera</i>	8	VA	VA	-	R
	<i>Confluens</i>	5	C	-	R	-
	<i>Helicopsyche</i>	10	C	C	-	-
	<i>Olinga</i>	9	A	A	R	-
	<i>Oxyethira</i>	2	-	-	R	C
	<i>Pychocentroides</i>	5	-	-	C	A
	<i>Triplectides</i>	5	R	-	-	-
	DIPTERA (TRUE FLIES)	<i>Aphrophila</i>	5	A	A	C
Eriopterini		5	R	R	-	-
<i>Maoriidamesa</i>		3	R	C	VA	VA
Orthoclaadiinae		2	C	-	VA	VA
Tanypodinae		5	R	-	-	-
Tanytarsini		3	-	-	C	VA
Empididae		3	R	R	-	C
Muscidae		3	-	-	C	R
<i>Austrosimulium</i>		3	C	-	R	C
Tabanidae		3	-	R	-	-
Tanyderidae		4	-	R	-	-
ACARINA (MITES)	Acarina	5	R	-	-	-
No of taxa			38	25	24	29
MCI			129	125	107	101
SQMCIs			7.0	7.4	4.8	3.9
EPT (taxa)			22	13	12	11
%EPT (taxa)			58	52	50	38
'Tolerant' taxa		'Moderately sensitive' taxa		'Highly sensitive' taxa		

R = Rare C = Common A = Abundant VA = Very Abundant XA = Extremely Abundant

Site 1 (upstream of intake weir)

A very high richness (38 taxa) was recorded, well above the median number (23 taxa) and one higher than the maximum (37 taxa) found by more than 176 previous surveys of National Park-sourced streams at 'control' sites between 300 and 350 m asl (TRC, 1999 (updated 2013)). This richness was the highest found to date by the four previous surveys performed at this site. The community was comprised of a very high proportion (82%) of 'sensitive' taxa, 15 of which were 'highly sensitive' taxa. The community was characterised by four 'highly sensitive' taxa [mayfly (*Deleatidium*), smooth cased caddisflies (*Beraeoptera* and *Olinga*) and Hydraenidae beetles]; five 'moderately sensitive' taxa [mayflies (*Austroclima* and *Coloburiscus*), elmid beetles, dobsonfly larvae (*Archichauliodes*) and crane fly (*Aphrophila*); and one 'tolerant' taxon [caddisfly (*Aoteapsyche*)]. The numerical dominance by 'sensitive' taxa resulted in the moderately high SQMCI_s value of 7.0 units, which was 0.8 unit higher than recorded in the previous survey but similar to the median value recorded by the four previous surveys (Table 2). This was indicative of good physical habitat and preceding physicochemical water quality, typical of the upper mid-reaches of ringplain streams.

The high proportion of 'sensitive' taxa comprising the community resulted in the high MCI score (129 units) which was three units below the maximum of the range recorded by the four previous surveys and a significant 11 units above the median MCI score recorded by more than 176 surveys of 'control' sites in National Park-sourced rivers and streams between 300 and 350 m asl (TRC, 1999 (updated 2013)). It was also 10 and 12 units above predicted (Stark & Fowles, 2009) altitude and distance scores respectively (Table 3) and categorised this site as having 'very good' generic stream health and slightly better than 'expected' predictive health (TRC, 2014) for a site in the upper mid-reaches of a ringplain stream.

Site 2 (40 m downstream of intake weir)

A moderately high richness (25 taxa) was found at this site, 13 taxa fewer than at the site upstream of the weir, and two taxa more than the median richness recorded by more than 176 previous surveys at similar 'control' sites (see above and TRC, 1999 (updated, 2013)). This was the lowest taxa richness recorded to date and well below the median (34) for this site (Table 2). The community composition mainly comprised of 'sensitive' taxa (72% of richness), 10 of which were 'highly sensitive' taxa. The community was characterised by the same 10 dominant taxa at the upstream 'control' site, with the addition of two 'highly sensitive' taxa [stoneflies (*Megaleptoperla* and *Zelandoperla*)]. The continued numerical dominance by 'sensitive' taxa (one 'highly sensitive' and one 'moderately sensitive' taxa in particular) resulted in a high SQMCI_s value of 7.4 units, which was the highest score recorded to date (Table 2) and 0.4 unit higher than the score at the upstream site (Table 4). This was also indicative of good physical habitat and preceding physicochemical water quality, typical of the upper, mid-reaches of ringplain streams, and coincidental with minimal periphyton substrate cover.

The high proportion of 'sensitive' taxa in the composition of the community was reflected in the high MCI score (125 units), an insignificant four units below that found at the 'control' site upstream of the intake weir, 1 unit below the median score recorded by the four previous surveys and an insignificant (Stark, 1998) seven units above the median score recorded by more than 176 previous surveys at similar sites (see above and TRC, 1999 (updated, 2013)). The score was also six and eight units above predicted altitude and distance scores respectively (Stark and Fowles, 2009; Table 3). This categorised the site as having 'very good' generic stream health and 'better than expected' predictive health (TRC, 2014) for a site in the upper mid reaches of a ringplain stream.

Site 3 (approximately 3 km downstream of the intake)

Taxa richness (24) was moderate for a site in the mid-reaches of a ringplain stream; one taxa below the median richness found to date by 170 surveys of 'control' sites in National Park-sourced streams at altitudes between 250 and 299 m asl (TRC, 1999 (updated, 2013)). This richness was three taxa less than the median richness of the four previous surveys at this site (Table 2). The community comprised a moderate proportion (67%) of 'sensitive' taxa, five of which were 'highly sensitive' taxa. It was characterised by one 'highly sensitive' taxon [mayfly (*Deleatidium*)], three 'moderately sensitive' taxa [mayflies (*Austroclima*) and (*Coloburiscus*) and elmid beetles], and three 'tolerant' taxa [orthoclad midges, net-spinning caddisfly (*Aoteapsyche*) and chironomid midge (*Maoridiamesa*)]. The similar numerical dominance by 'sensitive' and 'tolerant' taxa resulted in a relatively low SQMCI_s value of 4.8 units which was a significant (Stark, 1998) 2.6 units lower than the median found by the four previous surveys (Table 2) and a significant 2.2 units lower than recorded at the upstream 'control' site 1. This was an indication of moderate physical habitat conditions and moderate preceding physicochemical water quality, coincidental with widespread periphyton substrate cover and moderate stock damage at this site.

The moderate proportion of 'sensitive' taxa comprising this community resulted in the MCI value of 107 units, which was typically lower (by 22 units) than the score upstream of the intake weir and the lowest score recorded at this site to date (by 4 units). This current score was however an insignificant 8 units below the median score recorded by 170 previous surveys at similar sites (see above and TRC, 1999 (updated, 2013)) and within five and four units of predicted altitude and distance from the National Park boundary scores respectively (Stark and Fowles, 2009; Table 2). This score characterised the site as having 'good' generic stream health and 'expected' predictive health (TRC, 2014) for a site in the mid-reaches of a ringplain stream.

Site 4 (approximately 8 km downstream of the intake weir)

The moderately high richness (29 taxa) at this site was nine taxa more than the median taxa number found by 358 previous surveys of National Park-sourced streams at 'control' sites between 155 and 199 m asl (TRC, 1999 (updated, 2013)), and from one taxon less to nine taxa more than found by the four previous surveys at this site (Table 2). The community comprised a higher proportion (41%) of 'tolerant' taxa than in any of the three upstream sites' communities. It was characterised by the same dominant taxa as site 3 (although excluded the 'moderately sensitive' taxon (mayfly (*Coloburiscus*)), with the addition of four 'moderately sensitive' taxa [dobsonfly (*Archichauliodes*), free-living caddisflies (*Costachorema* and *Hydrobiosis*) and stony-cased caddis (*Pycnocentroides*)] and three 'tolerant' taxa [oligochaete worms, snail (*Potamopyrgus*) and chironomid midge (*Tanytarsini*)]. Several significant differences in individual taxon abundances were found between adjacent sites (3 and 4) which principally involved decreasing numbers within 'sensitive' (one) taxa and increasing numbers within (three) 'tolerant' taxa. The numerical dominance of four 'tolerant' taxa in particular was responsible for the moderately low SQMCI_s value of 3.9 units which was 0.8 unit lower than the median found by the four previous surveys at this site, and significantly lower (0.9 unit) than the score at the nearest upstream site, 3 (Table 4). This value was coincident with more dense filamentous algae streambed periphyton cover although there was a similar algal mat cover. The moderately high percentage of 'sensitive' taxa was indicative of relatively good preceding physicochemical water quality conditions preceding this survey.

The slight dominance of 'sensitive' taxa comprising this community resulted in a moderate MCI score of 101 units, an insignificant six units (Stark, 1998) lower than the score at site 3 (5.4 km upstream), and three units higher than the median score recorded by the four previous surveys at this site (Table 2). The current score was six units below the median score recorded by more than 358 previous surveys of 'control' sites in National Park-sourced streams situated between 155 and 199 m asl (TRC, 1999 (updated, 2013)) and two to three units lower than predicted altitude and distance from the National Park boundary values (Stark and Fowles, 2009 (Table 3)). This characterised the site as having 'good' generic stream health and 'expected' predictive health (TRC, 2014) for a site in the mid reaches of a ringplain stream.

Discussion and conclusions

The abstraction of surface water particularly for extended periods of time may result in significant adverse effects on the macroinvertebrate communities living within a waterbody by altering stream temperature, flow conditions, wetted habitat, periphyton growth, and certain aspects of physicochemical water quality. This February 2014 survey was undertaken to monitor whether the operation of the WWSS was having an effect on the macroinvertebrate communities in the Mangawheroiti Stream downstream of the water take under summer relatively low flow conditions.

The macroinvertebrate communities recorded at sites 1 and 2 comprised very high proportions of 'sensitive' taxa and were numerically dominated by up to five very or extremely abundant 'sensitive' taxa. The composition of the communities at both sites reflected the partially shaded, relatively cool, stony nature of the stream located in the upper mid-reaches of the catchment. This resulted in relatively high and similar MCI and SQMCI_s scores at both sites which were higher than the predicted scores for each site, based on altitude and distance from the National Park boundary. This was consistent with good preceding physical habitat conditions immediately upstream and downstream of the intake weir indicative of no recent significant impacts of water abstraction over a recent period of residual flow with a minimum of about 118 L/sec, and an actual residual flow of about 144 L/sec at the time of the survey.

At site 3, approximately 3 kilometres downstream of the water intake, the macroinvertebrate community again comprised a high proportion of 'sensitive' taxa which was reflected in the MCI score of 107 units. This MCI score was very similar to the predicted scores for altitude and distance from the National Park (Stark and Fowles 2009), and typically, was lower than at site 1 and site 2. This result reflected the differences in site location within the catchment and in habitat quality between sites (eg. a more intact riparian margin at sites 1 and 2 compared to site 3). The community at site 3 was dominated by relatively similar 'sensitive' taxa to site 2 including two very abundant 'moderately sensitive' taxa, however this site had the addition of two 'tolerant' taxa coincident with increases in filamentous and mat periphyton cover. Most of these dominant taxa were indicative of relatively good preceding physicochemical water quality and habitat conditions.

In the current survey, the lowest MCI and SQMCI_s scores were recorded at site 4 where the community was comprised of the highest proportion of 'tolerant' taxa. This community was also numerically dominated by more 'tolerant taxa' and fewer 'highly and moderately sensitive' taxa than at the three upstream sites, a typical downstream trend in ringplain streams. There was a significant (Stark, 1998) decrease in SQMCI_s score between sites 3 and 4. This was coincident with some increase in the density of filamentous algal periphyton substrate cover at site 4, a probable reflection of the cumulative impacts of increased

nutrient inputs to the stream from point source and non-point source discharges and increased water temperatures in a downstream direction through the mid-catchment under more recent lower flow, summer conditions.

The overall MCI score decline of 28 units between sites 1 and 4 over a stream distance of 8.3 km equated to a rate of decline of 3.4 units/km, which were markedly higher than the predicted rate of 1.6 units/km for the equivalent reach of a National Park sourced stream (Stark and Fowles, 2009), and the rate (2.8 units/km) found by the previous spring survey (in November 2013), but below the rate (4.2 units/km) found by the previous (summer) survey in March, 2013. The rate of decline between sites 3 and 4 (over the stream length of 5.4 km) of 1.1 units/km was an insignificant 0.4 MCI units/km higher than predicted for those equivalent reaches, indicative of minor deterioration in macroinvertebrate community health in the lower to mid-reaches of the Mangawheroiti Stream.

Summary

Macroinvertebrate sampling was undertaken on 5 February 2014, at four sites in the Mangawheroiti Stream; a control site upstream of the intake weir (1), a primary impact site approximately 40 metres downstream of the intake weir (2), a secondary impact site 3 kilometres downstream of that intake and a tertiary impact site approximately 5.6 kilometres downstream of the intake and 340 metres upstream of the confluence with the Mangawhero Stream. Sampling was performed at all four sites using the 'kick' sampling technique, a standard sampling technique used by the Council. This was undertaken to assess whether the abstraction of water from the Mangawheroiti Stream for the WWWS had had any adverse effects on the macroinvertebrate communities of this stream. Samples were processed to provide number of taxa (richness), MCI and SQMCI_s scores for each site.

The MCI is a measure of the overall sensitivity of the macroinvertebrate community to the effects of organic pollution in stony streams. It is based on the presence/absence of taxa with varying degrees of sensitivity to environmental conditions. The SQMCI_s takes into account taxa abundance as well as sensitivity to pollution, and may reveal more subtle changes in communities, particularly if non-organic impacts are occurring. Significant differences in the MCI or the SQMCI_s between sites indicate the degree of adverse effects (if any) of the activity monitored.

This summer survey did not indicate that the water abstraction for the WWWS from the Mangawheroiti Stream had significantly affected the freshwater macroinvertebrate communities immediately downstream of the abstraction point. Relatively high MCI and SQMCI_s scores were recorded at the upstream control site 1. These scores were relatively similar to site 2, located approximately 40 metres downstream of the water take. Typically there was a marked decline in MCI score between sites 2 and 3, mainly due to an increase in 'tolerant' taxa.

The results of this survey showed a significant decline in the macroinvertebrate communities in the reaches between sites 1 and 4, where the MCI rate of decline was significantly higher than predicted. This is consistent with a general trend of increasing water temperature and decreasing physicochemical water quality with decreasing altitude in ringplain streams in the region coincident with point and non-point source discharges within such reaches. Abstraction of water from the Mangawheroiti Stream may exacerbate the decline in macroinvertebrate 'health' by reducing available dilution of such discharges particularly as cumulative impacts occur in a downstream direction.

References

- Fowles CR and Smith KL, 2012: Biomonitoring of the Mangawheroiti Stream in relation to the Waimate West Water Supply Scheme, November 2012. TRC Internal Report CF580.
- Fowles CR and Jansma B, 2013: Biomonitoring of the Mangawheroiti Stream in relation to the Waimate West Water Supply Scheme, March 2013. TRC Internal Report CF582.
- Fowles CR and Jansma B, 2013: Biomonitoring of the Mangawheroiti Stream in relation to the Waimate West Water Supply Scheme, November 2013. TRC Internal Report CF612.
- Smith KL, 2012: Biomonitoring of the Mangawheroiti Stream in relation to the Waimate West Water Supply Scheme, January 2012. TRC Internal Report KS017.
- Stark JD, 1985: A macroinvertebrate community index of water quality for stony streams. *Water and Soil Miscellaneous Publication No. 87*.
- Stark JD, 1998: SQMCI: a biotic index for freshwater macroinvertebrate coded abundance data. *New Zealand Journal of Marine and Freshwater Research* 32(1): 55-66.
- Stark JD, 1999: An evaluation of Taranaki Regional Council's SQMCI biomonitoring index. Cawthron Institute, Nelson. Cawthron Report No. 472.
- Stark JD, Boothroyd IKG, Harding JS, Macted JR, Scarsbrook MR, 2001: Protocols for sampling macroinvertebrates in wadeable streams. New Zealand Macroinvertebrate Working Group Report No. 1. Prepared for the Ministry for the Environment. Sustainable Management Fund Project No. 5103. 57p.
- Stark JD and Macted JR, 2004. Macroinvertebrate community indices for Auckland's soft-bottomed streams and applications to SOE reporting. Prepared for Auckland Regional Council. Cawthron Report No. 970. Cawthron Institute, Nelson. ARC Technical Publication 303. 59p.
- Stark JD and Macted JR, 2007. A biotic index for New Zealand's soft bottomed streams. *New Zealand Journal of Marine and Freshwater Research* 41(1).
- Stark JD and Macted JR, 2007a. A user guide for the macroinvertebrate community index. Cawthron Institute, Nelson. Cawthron Report No. 1166.
- Stark JD and Fowles CR, 2009. Relationships between MCI, site altitude, and distance from source Taranaki ring plain streams. Stark Environmental report No. 2009-01
- TRC, 1999: Some statistics from the Taranaki Regional Council database of freshwater macroinvertebrate surveys performed during the period from January 1980 to 31 December 1998. TRC Technical Report 99-17.
- TRC, 2014: Freshwater macroinvertebrate fauna biological monitoring programme Annual SEM Report 2012-2013. Technical Report 2013-48.

To Job Manager, S Cowperthwaite
From Freshwater Biologist, B Jansma
File 03-02-005-15/01; 0933;
Report No BJ251
Doc No 1479996
Date 6 March 2015

Biomonitoring of the Kapuni Stream in relation to the Kapuni Water Treatment Plant, February 2014

Introduction

This survey of two sites in the Kapuni Stream was conducted to determine if there had been adverse effects related to the discharge of filter backwash and settling tank sediment from the Kapuni Water Treatment Plant. The survey fulfilled the biological monitoring requirements for this STDC consent monitoring programme in the 2013-2014 monitoring year. Results from surveys performed since the 2000-01 monitoring year are detailed in the references.

This survey was the fifth to follow commissioning of the Kapuni Water Treatment Plant. The new discharge point is now located just upstream of the Skeet Road bridge, and the sampling sites have consequently been changed, to enable monitoring of this new location.

At the time of the initial survey, no discharge of filter backwash and settling tank sediment had yet occurred from this new discharge point, and therefore that survey acted as a baseline survey, with which future surveys can be compared. The current survey is the fourth survey undertaken since the plant became fully operational.

Methods

The standard '400 ml kick-sampling' technique was used to collect streambed macroinvertebrates from two established sites in the Kapuni Stream in relation to the Kapuni Water Treatment Plant on 24 February 2014. This 'kick-sampling' technique is very similar to Protocol C1 (hard-bottomed, semi-quantitative) of the New Zealand Macroinvertebrate Working Group (NZMWG) protocols for macroinvertebrate samples in wadeable streams (Stark et al, 2001). The sites are described in Table 1 and Figure 1.

Samples were preserved with Kahle's Fluid for later sorting and identification under a stereomicroscope according to Taranaki Regional Council methodology using protocol P1 of NZMWG protocols for sampling macroinvertebrates in wadeable streams (Stark et al. 2001). Macroinvertebrate taxa found in each sample were recorded as:

R (rare)	= less than 5 individuals;
C (common)	= 5-19 individuals;
A (abundant)	= estimated 20-99 individuals;
VA (very abundant)	= estimated 100-499 individuals;
XA (extremely abundant)	= estimated 500 individuals or more.

Table 1 Biomonitoring sites in the Kapuni Stream in relation to the Kapuni Water Treatment Plant

Site No.	Site Code	Location
1	KPN000300	Approximately 30 metres upstream of Skeet Rd, upstream of the Kapuni water treatment plant discharge.
2	KPN000301	Approximately 30m downstream of Skeet Rd & 50m downstream of Kapuni water treatment plant discharge

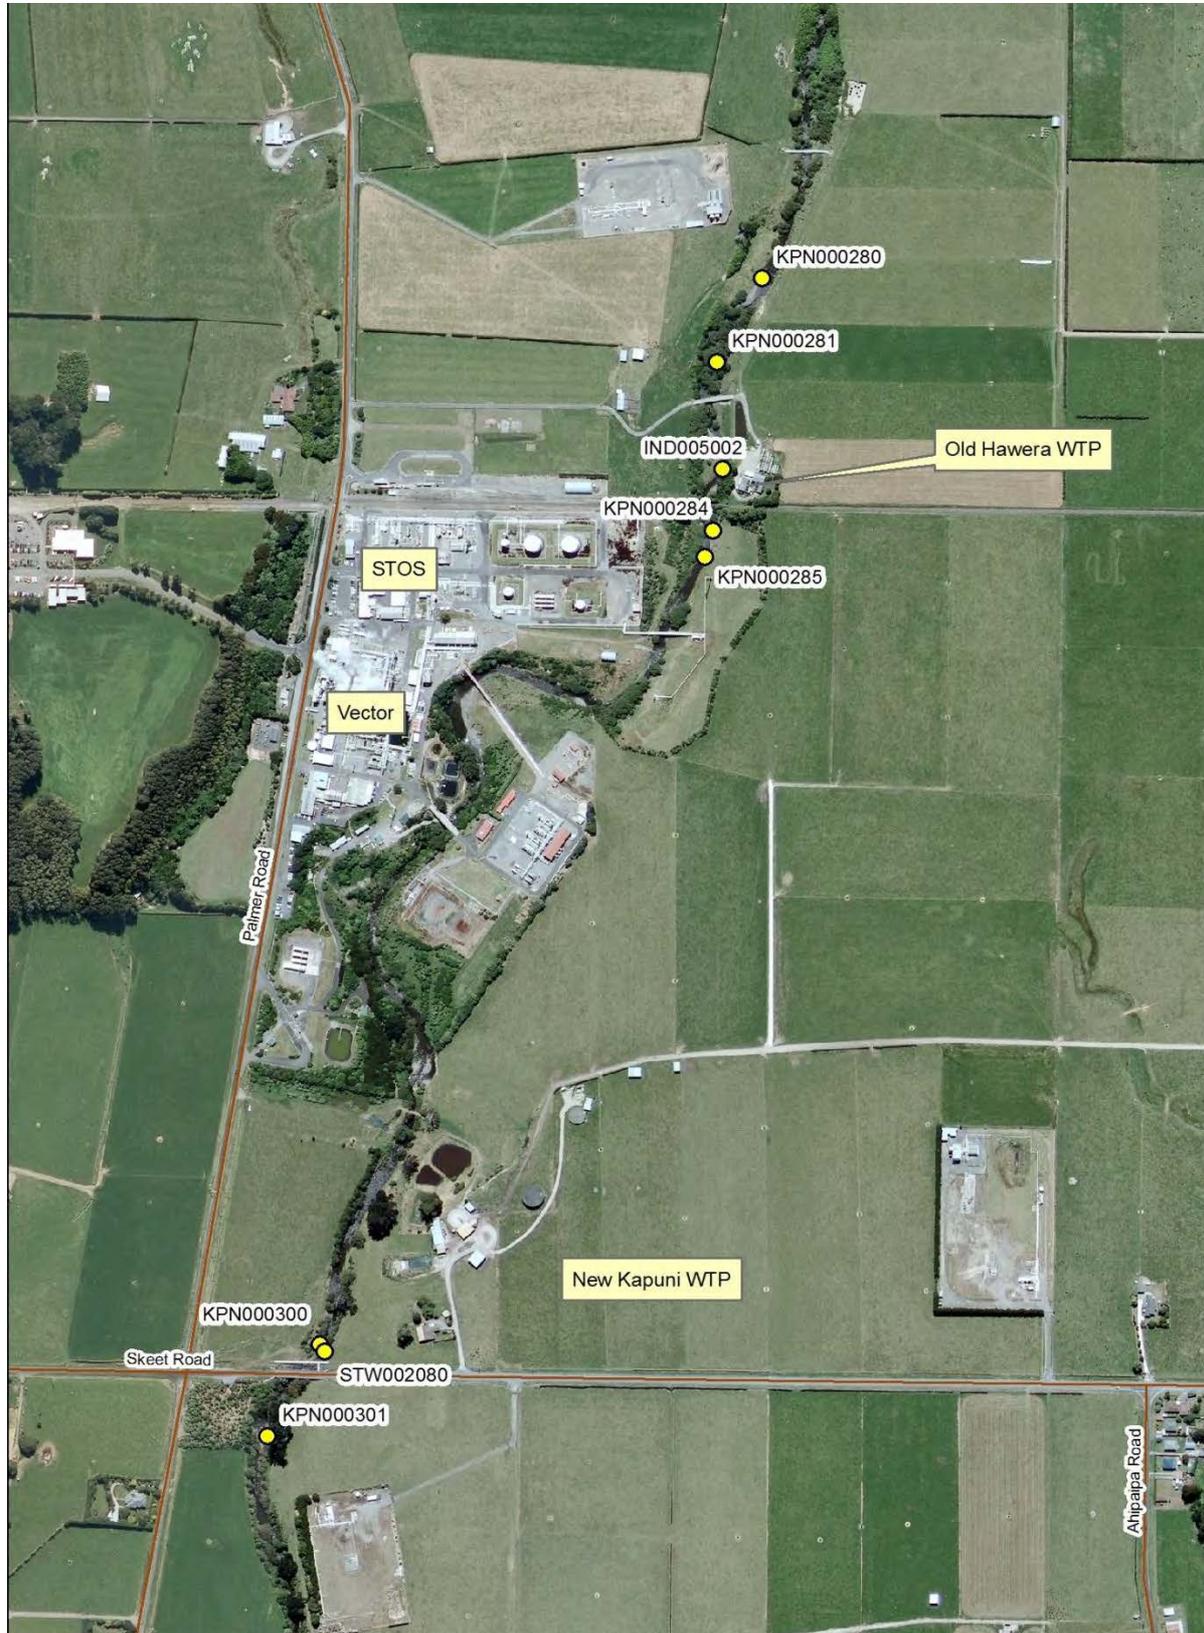


Figure 1 Aerial photo showing the location of the old and new water treatment facilities, and relevant sampling sites.

Stark (1985) developed a scoring system for macroinvertebrate taxa according to their sensitivity to organic pollution in stony New Zealand streams. Highly 'sensitive' taxa were assigned the highest scores of 9 or 10, while the most 'tolerant' forms scored 1. Sensitivity scores for certain taxa have been modified in accordance with Taranaki experience. By averaging the scores obtained from a list of taxa taken from one site and multiplying by a scaling factor of 20, a Macroinvertebrate Community Index (MCI) value was obtained. The MCI is a measure of the overall sensitivity of macroinvertebrate communities to the effects of organic pollution. More 'sensitive' communities inhabit less polluted waterways.

A semi-quantitative MCI value (SQMCI_s) has also been calculated for the taxa present at each site by multiplying each taxon score by a loading factor (related to its abundance), totalling these products, and dividing by the sum of the loading factors (Stark, 1998 and 1999). The loading factors were 1 for rare (R), 5 for common (C), 20 for abundant (A), 100 for very abundant (VA) and 500 for extremely abundant (XA). Unlike the MCI, the SQMCI_s is not multiplied by a scaling factor of 20, so that its corresponding range of values is 20x lower.

Results and discussion

At the time of this morning survey there was a clear, uncoloured flow in the Kapuni Stream and the water temperature ranged from 14.2 to 14.7°C. The survey was performed during a period of flow, 29 days after a fresh in excess of three times median flow and 50 days after a fresh in excess of 7 times median flow. The bed of the stream at both sites comprised predominantly cobbles, coarse gravel and boulders, with some fine gravel and sand. Both sites had only a thin film of algae on the substrate and neither site enjoyed any shading from riparian vegetation.

It was noted during the previous survey (March 2013) that a backwash discharge was causing notable discolouration downstream (Photo 1). No such discharge was observed during the current survey.



Photo 1 The backwash discharge entering the Kapuni Stream from the left, 13 March 2013

Macroinvertebrate communities

Previous biological surveys in the Kapuni Stream have generally recorded macroinvertebrate communities that would be expected in clean, mid-catchment ringplain streams. The communities have had moderate to relatively good numbers of taxa and

moderately high MCI values. The results of previous surveys are summarised in Table 2, together with current results and for site 1 are illustrated in Figure 2. The full results of the current survey are presented in Table 3.

Site 1 - upstream of WTP discharge

This site has an extensive historical dataset, as a result of monitoring undertaken in relation to the Vector Kapuni and Ballance Agri-Nutrients Kapuni Ltd sites, located upstream. This dataset extends as far back as October 1982 and can also be used as a reference for results at site 2 (KPN000301), until a suitable data record has been established there. It should be noted however, that the monitoring undertaken in relation to the Vector Kapuni and Ballance Agri-Nutrients Kapuni Ltd sites is done so using slightly different methodology, which has the potential to produce lower taxa richness and higher MCI scores.

Table 2 Numbers of taxa and MCI values recorded in previous surveys performed in the Kapuni Stream in relation to the Kapuni WTP, together with current results

Site	Number of previous surveys	Numbers of taxa			MCI values		
		Median	Range	Current	Median	Range	Current
1	119	17	6-40	25	109	60-145	116
2	5	22	17-25	22	112	110-116	117

The macroinvertebrate community at site 1 (upstream of the water treatment plant) had a moderately high richness of 25 taxa which significantly higher than the median richness of all surveys conducted at this site to date (Table 2). Five 'highly sensitive' taxa were found, indicative of generally high preceding physicochemical water quality conditions and good physical habitat. The faunal community was characterised by two of these 'highly sensitive' taxa ((extra abundant mayfly (*Deleatidium*) and abundant *Beraeoptera* caddisfly); one 'moderately sensitive' taxon (elmid beetles); and one 'tolerant' taxon (net-building caddisfly (*Aoteapsyche*)).

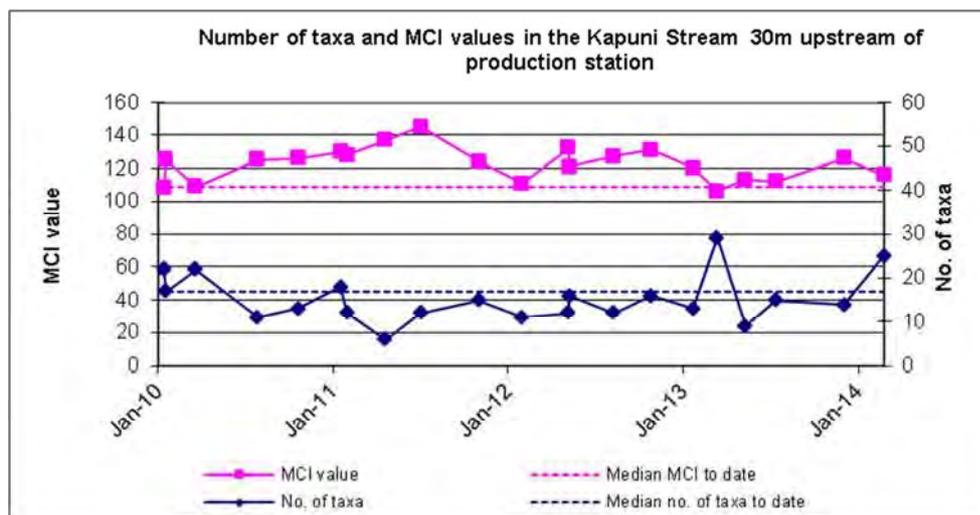


Figure 2 Numbers of taxa and MCI values in the Kapuni Stream upstream of Kapuni WTP

The moderate proportion of 'sensitive' taxa (76% of taxa numbers) comprising this community was reflected in the MCI score of 116 units, which was an insignificant seven units higher than to the median, and within the range of scores recorded in recent surveys (Figure 2, Table 2). However, this score was significantly higher than the predicted score for this site (99 units), 19.1 km downstream of the National Park boundary (Stark and Fowles, 2009, Stark, 1998).

Table 3 Macroinvertebrate fauna of the Kapuni Stream in relation STDC Kapuni WTP sampled on 24 February 2014

Taxa List	Site Number	MCI score	1	2	
	Site Code		KPN000300	KPN000301	
	Sample Number		FWB14149	FWB14150	
ANNELIDA (WORMS)	Oligochaeta	1	R	R	
MOLLUSCA	<i>Potamopyrgus</i>	4	R	C	
EPHEMEROPTERA (MAYFLIES)	<i>Austroclima</i>	7	C	C	
	<i>Coloburiscus</i>	7	C	C	
	<i>Deleatidium</i>	8	XA	XA	
	<i>Nesameletus</i>	9	R	C	
	<i>Zephlebia group</i>	7	R	-	
PLECOPTERA (STONEFLIES)	<i>Zelandoperla</i>	8	R	R	
COLEOPTERA (BEETLES)	Elmidae	6	VA	XA	
	Hydraenidae	8	-	R	
MEGALOPTERA (DOBSONFLIES)	<i>Archichauliodes</i>	7	C	A	
TRICHOPTERA (CADDISFLIES)	<i>Hydropsyche (Aoteapsyche)</i>	4	VA	VA	
	<i>Costachorema</i>	7	R	C	
	<i>Hydrobiosis</i>	5	C	A	
	<i>Psilochorema</i>	6	R	C	
	<i>Beraeoptera</i>	8	A	A	
	<i>Olinga</i>	9	R	R	
	<i>Pycnocentria</i>	7	R	-	
	<i>Pycnocentrodus</i>	5	C	C	
	DIPTERA (TRUE FLIES)	<i>Aphrophila</i>	5	C	A
		Eriopterini	5	R	R
<i>Harrisius</i>		6	R	-	
Orthoclaadiinae		2	-	R	
<i>Polypedilum</i>		3	R	-	
Tanypodinae		5	R	R	
Tanytarsini		3	R	R	
Tabanidae	3	R	-		
No of taxa			25	22	
MCI			116	117	
SQMCIs			7.1	6.7	
EPT (taxa)			14	12	
%EPT (taxa)			56	55	
'Tolerant' taxa		'Moderately sensitive' taxa		'Highly sensitive' taxa	

R = Rare C = Common A = Abundant VA = Very Abundant XA = Extremely Abundant

Site 2 - downstream of WTP

Taxa richness at site 2, 30m downstream of the water treatment plant discharge, was 22 taxa, slightly lower than that recorded at site 1 (Table 2). The difference in community composition between sites was relatively insignificant as in all instances it was due to the presence/absence of taxa found only as rarities (less than 5 individuals per taxon) at the upstream site when they were absent/present downstream. Six 'highly sensitive' taxa were present, with the community characterised by the same taxa as those dominant at site 1 with the addition of three moderately sensitive taxa (dobson fly larvae (*Archichauliodes*), free swimming caddisfly (*Hydrobiosis*) and *Aphrophila* crane fly) (Table 3). Due to only relatively subtle differences in community composition, the MCI score at site 2 (117 units) was only one unit higher than the score recorded at site 1 upstream, and this was not a statistically significant result (Stark, 1998). This score was higher than (but not significantly so) the

median of past scores from KPN00300 and similar to that recorded at this site in the previous two surveys. In addition, when the nature of the changes is considered, it is not considered to be indicative of impacts from the water treatment plant discharge. Because of the proximity of KPN00300 to this site, the historical data for this site can be used for comparison at this site, which was only sampled for the fifth time in this survey.

No significant changes in individual taxon abundance were recorded between sites, reflecting the similarity in community composition. The relative similarity in dominant taxa at the two sites was reflected in the SQMCI₅ scores which similar, differing by only 0.4 unit (Table 3).

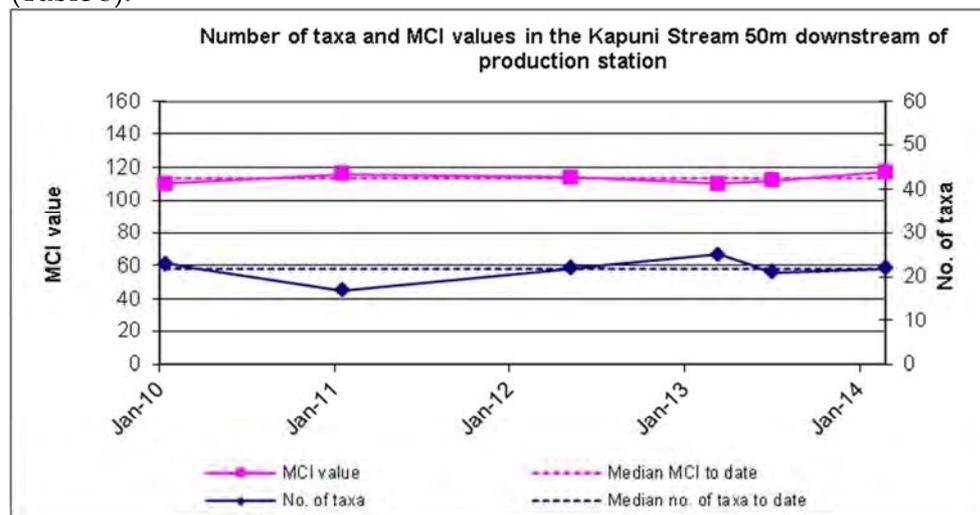


Figure 3 Numbers of taxa and MCI values in the Kapuni Stream downstream of Kapuni WTP

Summary and conclusions

The Council's standard 'kick-sampling' technique was used on 24 February 2014 at two sites to collect streambed macroinvertebrates from the Kapuni Stream to determine if there had been any adverse effects on the macroinvertebrate community of the stream from Kapuni water treatment plant backwash discharges. Samples were sorted and identified to provide number of taxa (richness) and MCI and SQMCI₅ scores for each site.

The MCI is a measure of the overall sensitivity of the macroinvertebrate community to the effects of organic pollution in stony streams. It is based on the presence/absence of taxa with varying degrees of sensitivity to environmental conditions. The SQMCI₅ takes into account taxa abundance as well as sensitivity to pollution, and may reveal more subtle changes in communities, particularly if non-organic impacts are occurring. Significant differences in either the MCI or the SQMCI₅ between sites indicate the degree of adverse effects (if any) of the discharges being monitored.

This survey was the fourth to follow full commissioning of the Kapuni Water Treatment Plant. The new discharge point is now located just upstream of the Skeet Road bridge, and the sampling sites were consequently changed, to enable monitoring of this new location. Site 1 has an extensive historical dataset, as a result of monitoring undertaken in relation to the Vector Kapuni and Ballance Agri-Nutrients Kapuni Ltd sites, located upstream. This dataset can also be used as a reference for site 2 (KPN000301), until a suitable data record has been established here. It should be noted however, that the monitoring undertaken in relation to the Vector Kapuni and Ballance Agri-Nutrients Kapuni Ltd sites is done so using slightly different methodology, which has the potential to produce lower taxa richness and higher MCI scores.

This late summer macroinvertebrate survey indicated that there were only relatively subtle differences between site 1, upstream of the discharge point, and site 2, downstream of the discharge point. There is no evidence to suggest that the discharge of filter backwash and settling tank sediment had resulted in an impact on the macroinvertebrate communities of the Kapuni Stream. This is supported by the MCI score recorded downstream of the discharge being higher than the median score for the upstream site, that recorded during the previous two surveys, though not statistically so.

The macroinvertebrate communities of the Kapuni Stream contained significant proportions of 'sensitive' taxa at both sites and the communities were generally dominated by 'sensitive' taxa. Taxonomic richness (number of taxa) was high at the control site 1 and decreased only slightly at site 2 downstream of the discharge, although there were some changes in the presence/absence of a few taxa found as rarities (less than 5 individuals). Both sites recorded above average MCI scores. An insignificant change in the MCI value between sites was a result of some subtle differences in taxa presence/absence. The SQMCI_s values were similar between sites, reflective of the similarity in dominant taxa.

References

- Colgan BG, 2003: Biomonitoring of the Kapuni Stream, upstream and downstream of the Hawera Water Treatment Plant, April 2003. TRC report BC009.
- Dunning KJ, 2001: Biomonitoring of the Kapuni Stream, upstream and downstream of the Hawera Water Treatment Plant, April 2001. TRC report KD68.
- Dunning KJ, 2002: Biomonitoring of the Kapuni Stream, upstream and downstream of the Hawera Water Treatment Plant, March 2002. TRC report KD118.
- Fowles CR and Hope KJ, 2005: Biomonitoring of the Kapuni Stream, upstream and downstream of the Hawera Water Treatment Plant, March 2005. TRC report CF386.
- Fowles CR and Moore SC, 2004: Biomonitoring of the Kapuni Stream, upstream and downstream of the Hawera Water Treatment Plant, March 2004. TRC report CF316.
- Fowles CR and Jansma B, 2008: Biomonitoring of the Kapuni Stream in relation to the Hawera Water Treatment Plant, February 2008. TRC report CF454.
- Hope K J, 2006: Biomonitoring of the Kapuni Stream, upstream and downstream of the Hawera Water Treatment Plant, February 2006. TRC report KH084.
- Jansma B, 2009: Biomonitoring of the Kapuni Stream in relation to the Hawera Water Treatment Plant, January 2009. TRC report BJ076.
- Jansma B, 2010: Biomonitoring of the Kapuni Stream in relation to the Kapuni Water Treatment Plant, January 2010. TRC report BJ114.
- Jansma B, 2011: Biomonitoring of the Kapuni Stream in relation to the Kapuni Water Treatment Plant, January 2011. TRC report BJ147.
- Jansma B, 2013: Biomonitoring of the Kapuni Stream in relation to the Kapuni Water Treatment Plant, May 2012. TRC report BJ186.

- Jansma B, 2013: Biomonitoring of the Kapuni Stream in relation to the Kapuni Water Treatment Plant, March 2013. TRC Report BJ204.
- McWilliam H, 2000: Biomonitoring of the Kapuni Stream, in relation to the Hawera Water Treatment Plant, March 2000. TRC report HM216.
- Stark JD, 1985: A macroinvertebrate community index of water quality for stony streams. *Water and Soil Miscellaneous Publication No. 87.*
- Stark JD, 1998: SQMCI: a biotic index for freshwater macroinvertebrate coded abundance data. *New Zealand Journal of Marine and Freshwater Research* 32(1): 55-66.
- Stark JD, 1999: An evaluation of Taranaki Regional Council's SQMCI biomonitoring index. Cawthron Institute, Nelson. Cawthron Report No. 472.
- Stark JD, Boothroyd IKG, Harding JS, Maxted JR, Scarsbrook MR, 2001: Protocols for sampling macroinvertebrates in wadeable streams. New Zealand Macroinvertebrate Working Group Report No. 1. Prepared for the Ministry for the Environment. Sustainable Management Fund Project No. 5103. 57p.
- Stark JD and Fowles CR, 2009: Relationships between MCI, site altitude, and distance from source for Taranaki ring plain stream. Prepared for Taranaki Regional Council. Stark Environmental Report No. 2009-01. 47p.
- Taranaki Regional Council, 1999: Some statistics from the Taranaki Regional Council database (FWB) of freshwater macroinvertebrates surveys performed during the period from January 1980 to 31 December 1998. (State of the Environment Monitoring Reference Report). Technical Report 99-17

Memorandum

To Scott Cowperthwaite, Job Manager
From Bart Jansma, Scientific Officer
Report No. BJ252
Doc No. 1480192
Date 6 March 2015

Fish survey in the Kapuni Stream in relation to the STDC water intake weir and fish pass, January 2014

Introduction

South Taranaki District Council (STDC) hold resource consents in relation to several rural water supply schemes. The monitoring programmes for these schemes include fish monitoring of a selection of the weirs each year. The programme for the 2013-2014 monitoring period included monitoring of the Kapuni Stream weir and intake. The consent relating to this weir is as follows:

7413-1 To erect, use and maintain a water intake structure on the bed of the Kapuni Stream, including temporary damming and diversion during construction at or about (NZTM) 1701447E-5630678N

A special condition of resource consent 7413 requires the consent holder to monitor and maintain the fish pass, to ensure it performs as designed and allows for the effective passage of fish. The purpose of this fish survey is to satisfy this condition.

The Kapuni Stream weir is relatively new, having been installed in 2009. It is also a relatively unique design, being intended to take much of the river flow, and intended to provide for both climbing and swimming species. During installation, rocks were placed in the concrete, to provide for variation in flow and rest areas. The shape of the pass was dished to provide some deep water for swimming fish to use. Photo 1 shows the pass during installation.



Photo 1 The STDC fish pass being installed September 2009



Photo 2 The Kapuni Stream fishpass in October 2009 (top) and January 2014 bottom

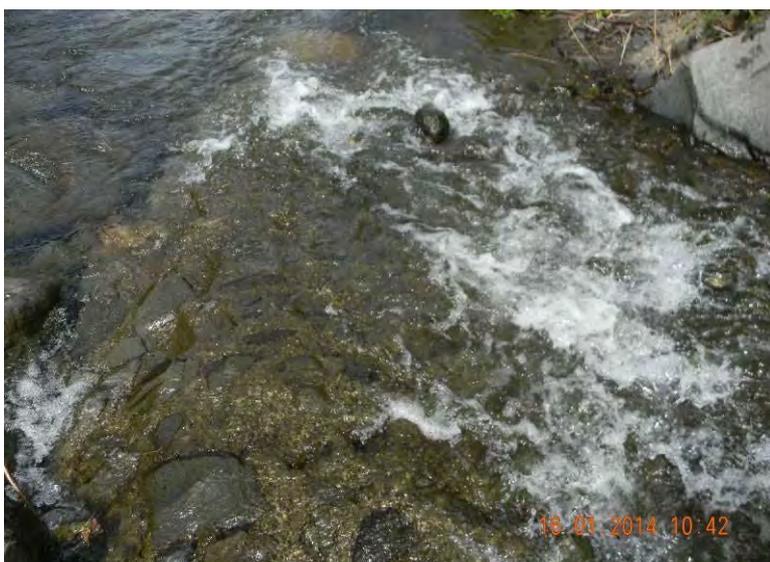


Photo 3 The lower section of the fishpass showing where the large rocks have been sheared off

An inspection undertaken in October 2009, shortly after flow was restored to the original channel, found that the pass had been well designed, with it appearing much like the natural rapids present in the stream (Photo 2) Observations made during the current survey found that despite the low flow there was still a good water depth down the pass (Photo 3).

However, most of the largest rocks had been sheared off by high flows, resulting in the bed of the fish pass being smooth over large areas. This is only likely to affect swimming species, as the edge of the fish pass was still suitable for climbing species. The degree of impact on swimming species will be assessed and hopefully determined through subsequent monitoring.

There has been annual fish monitoring undertaken in the Kapuni Stream in relation to the Kapuni production station and Ballance sites downstream, and the results to date are summarised in Stark, 2014.

These surveys have recorded a population impacted by numerous barriers to fish passage, although over the years, these barriers have been steadily remediated. The most recent works were completed on the weir located beneath the railway line, located approximately 900m downstream of the STDC weir. This was undertaken in March 2014, after the survey reported herein. This needs to be considered when interpreting the results.



Figure 1 Sites sampled in the Kapuni Catchment, in relation to the STDC water intake weir and fish pass

Methods

The current survey was performed at four sites in the Kapuni Stream catchment on 16 January 2014. Details of the sites surveyed in the current survey are presented in Table 1, and their locations are shown in Figure 1.

Table 1 Location and description of fish monitoring sites in relation to the Kapuni Lactose factory

Site	Site code	Site description	Grid reference	Distance to coast (km)	Approximate Altitude (m)
1	KPN000132	Kapuni stream – 10m upstream of farm bridge	1698559-5642038	35.1	470
2	KPN000142	Kapuni Stream tributary – 130m downstream of race	1698882-5642127	35.1	470
3	KPN000275	Kapuni Stream – 60m upstream of STDC weir	1701438-5630711	19.1	190
4	KPN000276	Kapuni Stream – 60m downstream of STDC weir	1701413-5630592	19.0	180

The sites were surveyed using the electric fishing method, which employed a Kainga EFM machine. Those fish captured were identified and counted, where possible. Inevitably some fish eluded capture, although some were identified before reaching cover. The length of each fish was estimated, following which they were released. The results of this survey are presented in Table 2 together with the results of previous surveys.

In addition, some observations were made regarding the habitat present at the sites surveyed.

Results

The sites surveyed all included similar habitat, with the substrate comprising predominantly boulders and cobbles, with lesser proportions of gravels and sand. Site 1 was partially shaded, while site 2 enjoyed complete shading. Sites 3 and 4 were unshaded. Only site 4 had had any undercut bank while sites 1 and 2 had overhanging vegetation. Water clarity was good during this survey, with uncoloured and clear flow at all sites.

The results for each site are summarised in Table 2.

Only two species were recorded at site 1, with three recorded at site 2, four at site 3 and five at site 4. Longfin eel, shortfin eel, koaro and redfin bully were all recorded both upstream and downstream of the weir, while brown trout were only recorded upstream of the weir. A juvenile rainbow trout was recorded just above the weir, although this was not included in table 2, as it was not within the surveyed area. Freshwater crayfish were recorded at all sites, being most abundant at sites 1 and 4. The low species abundance recorded at sites 1 and 2 was not surprising given the altitude of these sites, as few species migrate so far inland. For example, redfin bully are rarely recorded at altitudes in excess of 400m.

There are three primary aspects to monitoring fish communities in order to determine whether passage is provided for at a structure:

- Is there evidence of fish accrual below the structure?
- Is there a significant difference in species richness when comparing upstream and downstream communities?
- Is the size structure of the upstream communities indicative of an actively recruiting population?

Table 2 and figure 3 indicate that there were more than twice as many fish downstream of the weir as immediately upstream of the weir. Although this suggests fish accrual, the

majority of these fish were eels, which would have had no problem migrating past the weir. This therefore indicates that this higher abundance is habitat related, rather than reflective of fish accrual. Although there were more redfin bully recorded downstream than upstream, the relative abundance was low at both sites, and therefore no firm conclusions can be made. It is likely that the abundance of redfin bully in this reach had been reduced by downstream barriers, such as the railway weir.

Although species richness was highest at site 4, the species richness at site 3 was equivalent in terms of native species. Overall the differences in species richness does not provide any indication that there the weir presents a barrier to fish passage.

Juvenile koaro were recorded as high as site 1, and small eels were recorded upstream of the weir. This indicates that those species found upstream of the weir were actively recruiting.

Table 2 Fish species and abundance recorded during the current survey.

Site:		Site 1	Site 2	Site 3	Site 4
Area fished (m ²):		120	105	162	175
Longfin eel (<i>Anguilla dieffenbachii</i>)	Number	2	1	1	15
	Length range (mm)	200-350	450	220	150-500
Shortfin eel (<i>Anguilla australis</i>)	Number			1	1
	Length range (mm)			150	300
Unidentified eel	Number			5	3
	Length range (mm)			200-450	100-200
Redfin bully	Number			1	5
	Length range (mm)			70	60-90
Koaro (<i>Galaxias brevipinnis</i>)	Number	7	1	2	2
	Length range (mm)	50-140	100	30-40	50
Brown trout	Number		2		
	Length range (mm)		120		
Unidentified trout	Number				1
	Length range (mm)				100
Crayfish	Number	4	1	1	4
Total number of species		2	3	4	5
Total number of fish		9	4	10	27

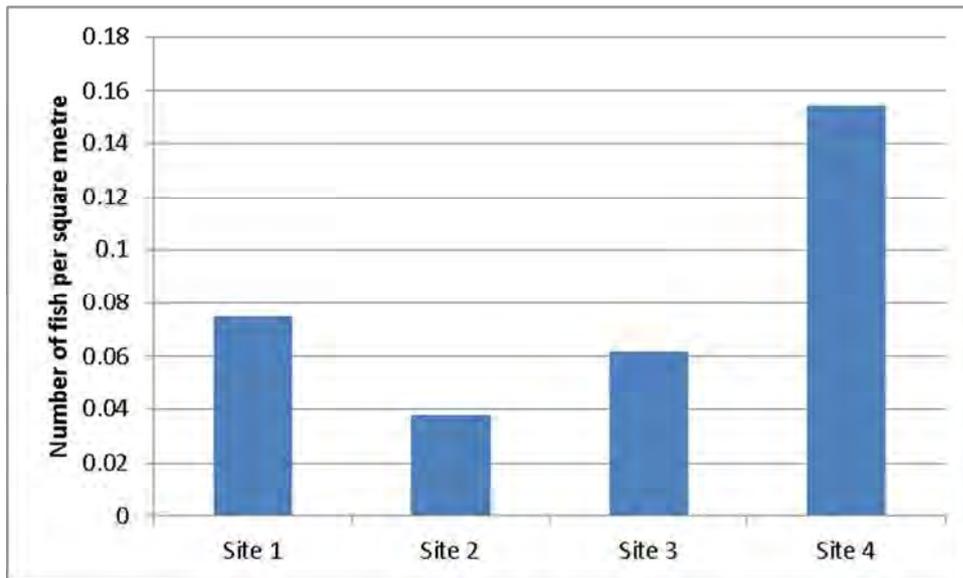


Figure 3 Number of fish per square metre recorded at each site

Summary and Conclusions

A four site fish survey was undertaken in the Kapuni Stream on 16 January 2014, in order to determine whether the water intake structure on the bed of the Kapuni Stream effectively provided for fish passage. The fish communities were surveyed using the electric fishing technique, with all fish identified where possible, counted, and lengths estimated. It should be noted that fish migration in the Kapuni Stream may be impeded by other structures, including the railway weir, located approximately 900m downstream of the STDC weir.

There are three primary aspects to monitoring fish communities in order to determine whether passage is provided for at a structure:

- Is there evidence of fish accrual below the structure?
- Is there a significant difference in species richness when comparing upstream and downstream communities?
- Is the size structure of the upstream communities indicative of an actively recruiting population?

Five fish species were recorded during this survey, being longfin and shortfin eel, redfin bully, koaro and brown trout. Redfin bully were recorded in relatively low abundance, possibly reflecting the impact of the railway weir.

All five species were recorded upstream of the intake weir, although the two sites closest to the national park only contained two migratory species (longfin eels and koaro). In addition, although the highest fish abundance was recorded immediately downstream of the weir, this is considered to be a reflection of habitat variation, rather than fish accrual. This is because the majority of fish recorded at this site were eels, which would easily negotiate the weir. Juvenile koaro and small eels were recorded upstream of the weir, including close to the National Park. This indicates that these species are actively recruiting. Unfortunately, due to the low numbers of redfin bully recorded during this survey, few conclusions can be made about the passage of this species. However, recent improvements made to fish passage at the railway weir may result in improved redfin bully abundance near the intake weir during future surveys.

Overall, it is considered that there is no evidence indicating that the STDC water intake structure is impeding fish passage in the Kapuni Stream.

References

McDowall, RM, 2000: The Reed Field Guide to New Zealand Freshwater Fishes. Reed books, Reed Publishing (New Zealand) Ltd. 224pp.

Stark, JD, 2014: Kapuni Biomonitoring Electric-Fishing Survey (22-23 October 2014). Stark Environmental Report No. 2014-14, Nelson, New Zealand.

